

COOLANT REPORT

Sample Rating Trend

NORMAL



Coolant

CLARIANT ANTIFROGEN N (--- LTR)

DIAGNOSIS

Recommendation

The fluid is suitable for further service.

Corrosion

All metal levels are normal indicating no corrosion in the cooling system.

Contaminants

There is no indication of any contamination in the coolant.

Coolant Condition


Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.

				Jui2023		
SAMPLE INFORM	1ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		NX05981634		
Sample Date		Client Info		17 Jul 2023		
Machine Age	hrs	Client Info		0		
Dil Age	hrs	Client Info		0		
Dil Changed		Client Info		N/A		
Sample Status				NORMAL		
PHYSICAL TEST R	ESULTS	method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298	1.11	1.082		
Η	Scale 0-14	ASTM D1287	8.5	8.42		
Nitrites	ppm	AP-053:2009		448		
Reserve Alkalinity	Scale 0-20	*ASTM D1121	4.0			
Percentage Glycol	%	ASTM D3321	44	62.2		
Freezing Point	°F	ASTM D3321	-32	-61		
Total Dissolved Solids				349.0		
Carboxylate				n/a		
CORROSION INHI	BITORS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D6130	3	<1		
Phosphorus	ppm	ASTM D6130	5	18		
Boron	ppm	ASTM D6130	15	0		
Nolybdenum	ppm	ASTM D6130	110	174		
CORROSION		method	limit/base	current	history1	history2
ron	ppm	ASTM D6130	>15	3		
Aluminum	ppm	ASTM D6130	>10	3		
Copper	ppm	ASTM D6130	>10	0		
_ead	ppm	ASTM D6130	>10	0		
Гin	ppm	ASTM D6130	>10	0		
Zinc	ppm	ASTM D6130		<1		
CONTAMINANTS		method	limit/base	current	history1	history2
Chlorine	ppm	ASTM D6130		0		
CARRIER SALTS		method	limit/base	current	history1	history2
Sodium	ppm	ASTM D6130	2400	3828		
Potassium	ppm	ASTM D6130	5	0		
SCALE POTENTI	AL	method	limit/base	current	history1	history2
	ppm	ASTM D6130		0		
Calcium	ppin			-		



COOLANT REPORT



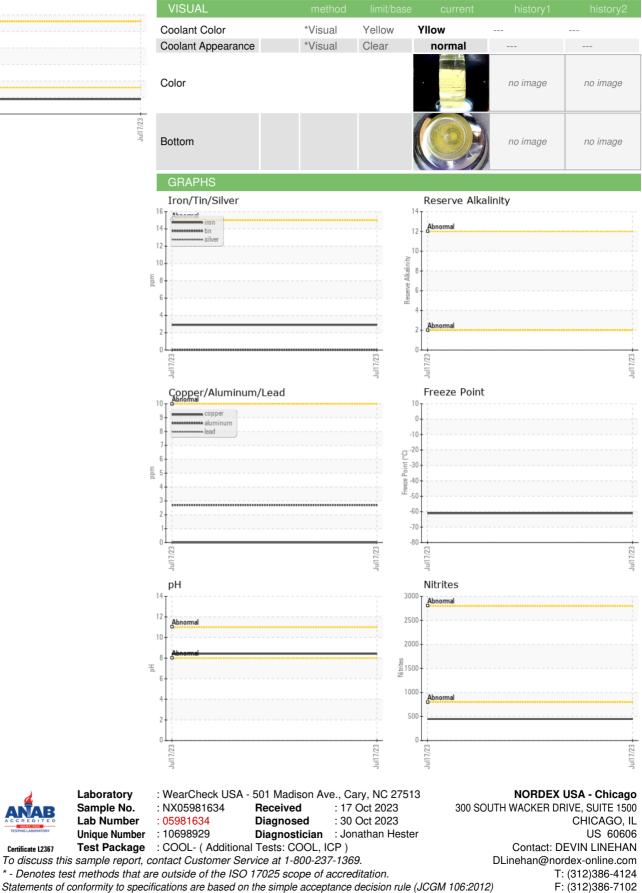

Certificate L2367

Contact/Location: DEVIN LINEHAN - NORDEX