



COOLANT REPORT

Sample Rating Trend

NORMAL



Area
AURORA [200006927]
 Machine Id
26WEA87230 - G03 - A (S/N 7802042)
 Component
Coolant
 Fluid
CLARIANT ANTIFROGEN N (--- LTR)



DIAGNOSIS

Recommendation

The fluid is suitable for further service.

Corrosion

All metal levels are normal indicating no corrosion in the cooling system.

Contaminants

There is no indication of any contamination in the coolant.

Coolant Condition

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	NX05981642	---	---
Sample Date	Client Info	14 Jul 2023	---	---
Machine Age	hrs Client Info	0	---	---
Oil Age	hrs Client Info	0	---	---
Oil Changed	Client Info	N/A	---	---
Sample Status		NORMAL	---	---

PHYSICAL TEST RESULTS

method	limit/base	current	history1	history2
Specific Gravity	*ASTM D1298 1.11	1.050	---	---
pH	Scale 0-14 ASTM D1287 8.5	8.05	---	---
Nitrites	ppm AP-053:2009	372	---	---
Reserve Alkalinity	Scale 0-20 *ASTM D1121 4.0	---	---	---
Percentage Glycol	% ASTM D3321 44	37.3	---	---
Freezing Point	°F ASTM D3321 -32	-7	---	---
Total Dissolved Solids		198.5	---	---
Carboxylate		n/a	---	---

CORROSION INHIBITORS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D6130 3	<1	---	---
Phosphorus	ppm ASTM D6130 5	15	---	---
Boron	ppm ASTM D6130 15	0	---	---
Molybdenum	ppm ASTM D6130 110	113	---	---

CORROSION

method	limit/base	current	history1	history2
Iron	ppm ASTM D6130 >15	3	---	---
Aluminum	ppm ASTM D6130 >10	1	---	---
Copper	ppm ASTM D6130 >10	0	---	---
Lead	ppm ASTM D6130 >10	0	---	---
Tin	ppm ASTM D6130 >10	0	---	---
Zinc	ppm ASTM D6130	<1	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Chlorine	ppm ASTM D6130	0	---	---

CARRIER SALTS


method	limit/base	current	history1	history2
Sodium	ppm ASTM D6130 2400	2615	---	---
Potassium	ppm ASTM D6130 5	0	---	---



SCALE POTENTIAL

method	limit/base	current	history1	history2
Calcium	ppm ASTM D6130	0	---	---
Magnesium	ppm ASTM D6130	0	---	---






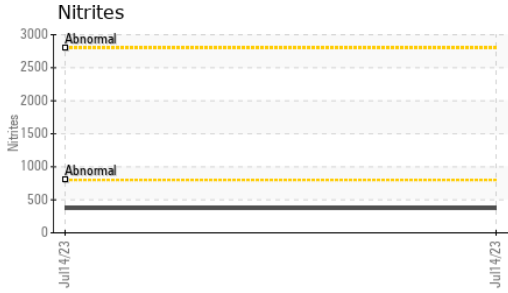


COOLANT REPORT



VISUAL	method	limit/base	current	history1	history2
Coolant Color	*Visual	Yellow	Yllow	---	---
Coolant Appearance	*Visual	Clear	normal	---	---
Color				no image	no image
Bottom				no image	no image

GRAPHS

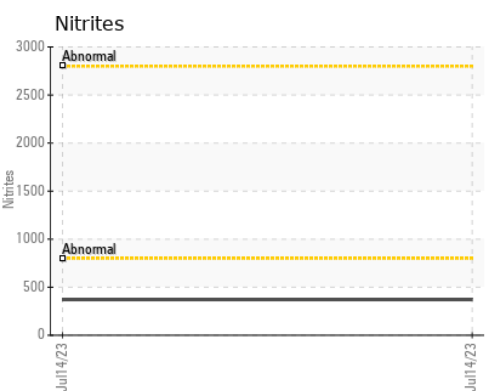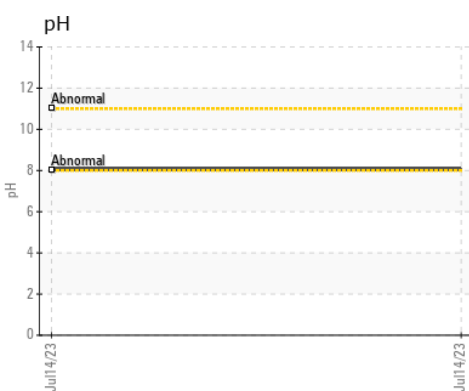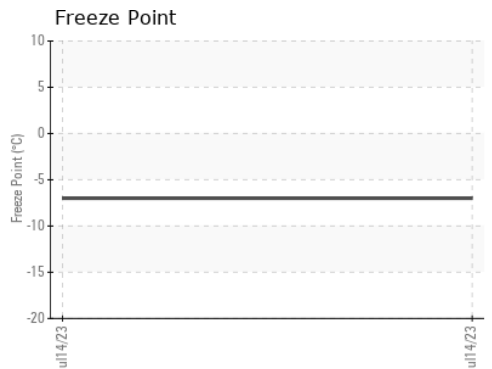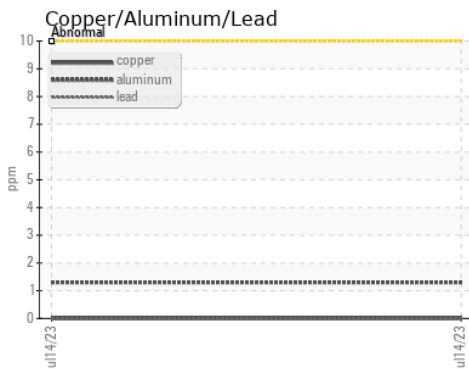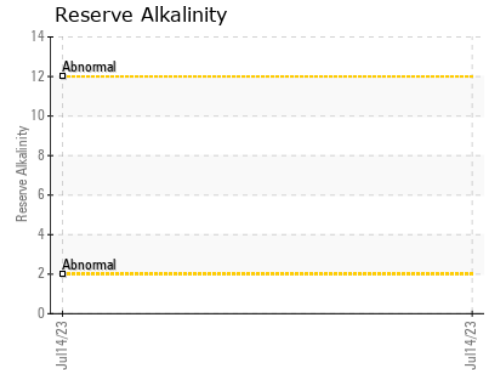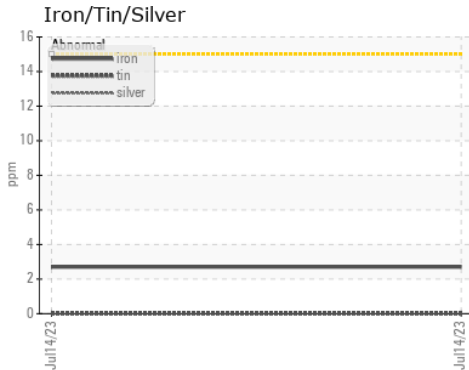

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : NX05981642 **Received** : 17 Oct 2023
Lab Number : **05981642** **Diagnosed** : 30 Oct 2023
Unique Number : 10698937 **Diagnostician** : Jonathan Hester
Test Package : COOL- (Additional Tests: COOL, ICP)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

NORDEX USA - Chicago
 300 SOUTH WACKER DRIVE, SUITE 1500
 CHICAGO, IL
 US 60606
 Contact: DEVIN LINEHAN
 DLinehan@nordex-online.com
 T: (312)386-4124
 F: (312)386-7102