

COOLANT REPORT

Sample Rating Trend

NORMAL

AURORA [200006927] 15WEA87219 - 103 - A Component

Coolant Fluic

CLARIANT ANTIFROGEN N (--- LTR)

Recommendation

The fluid is suitable for further service.

Corrosion

All metal levels are normal indicating no corrosion in the cooling system.

Contaminants

There is no indication of any contamination in the coolant.


Coolant Condition


Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.

				Jun2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		NX05981648		
Sample Date		Client Info		27 Jun 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
PHYSICAL TEST F	RESULTS	method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298	1.11	1.078		
pH	Scale 0-14	ASTM D1287	8.5	8.29		
Nitrites	ppm	AP-053:2009		300		
Reserve Alkalinity	Scale 0-20	*ASTM D1121	4.0			
Percentage Glycol	%	ASTM D3321	44	58.2		
Freezing Point	°F	ASTM D3321	-32	-54		
Total Dissolved Solids				351.0		
Carboxylate				n/a		
CORROSION INH	IBITORS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D6130	3	<1		
Phosphorus	ppm	ASTM D6130	5	16		
Boron	ppm	ASTM D6130	15	0		
Molybdenum	ppm	ASTM D6130	110	160		
CORROSION		method	limit/base	current	history1	history2
Iron	ppm	ASTM D6130	>15	<1		
Aluminum	ppm	ASTM D6130	>10	0		
Copper	ppm	ASTM D6130	>10	0		
Lead	ppm	ASTM D6130	>10	0		
Tin	ppm	ASTM D6130	>10	0		
Zinc	ppm	ASTM D6130		0		
CONTAMINANTS		method	limit/base	current	history1	history2
Chlorine	ppm	ASTM D6130		1		
CARRIER SALTS		method	limit/base	current	history1	history2
Sodium	ppm	ASTM D6130	2400	3785		
Potassium	ppm	ASTM D6130	5	0		
SCALE POTENTI	method	limit/base	current	history1	history2	
Calcium	ppm	ASTM D6130		6		
Magnesium	ppm	ASTM D6130		0		
0	1.1-			-		



COOLANT REPORT



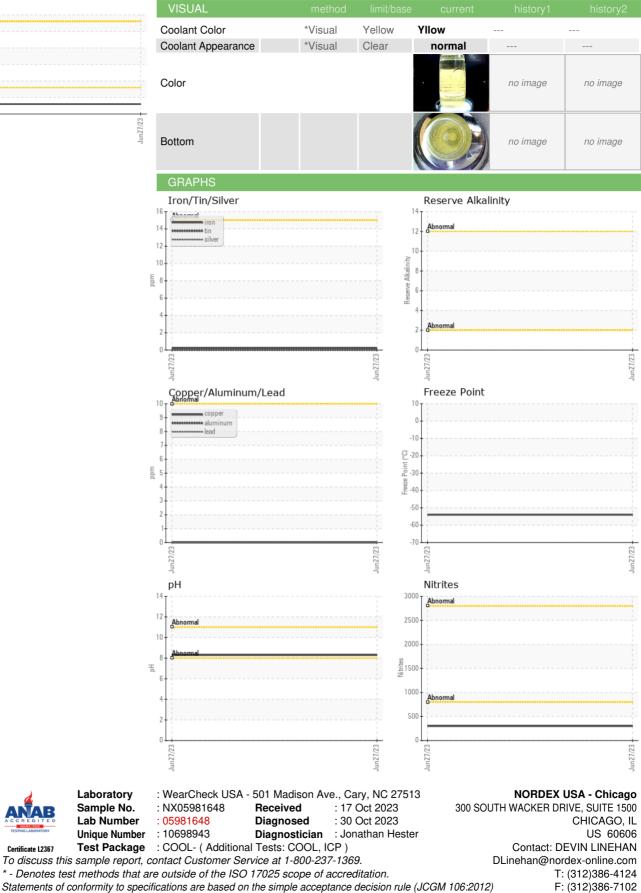

Contact/Location: DEVIN LINEHAN - NORDEX