




OIL ANALYSIS REPORT

Sample Rating Trend

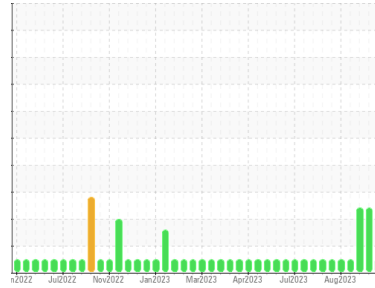

NORMAL



Area
WP 09
Machine Id
WP09TF01 3EFF MVR
Component
Reservoir Circulating System
Fluid
MOBIL DTE 25 (93 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0834876	WC0843039	WC0843038
Sample Date	Client Info	10 Oct 2023	02 Oct 2023	25 Sep 2023
Machine Age	days	Client Info	0	0
Oil Age	days	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	ABNORMAL	ATTENTION

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	0	1	<1
Chromium	ppm	ASTM D5185m	0	0	0
Nickel	ppm	ASTM D5185m	0	<1	<1
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m	0	0	0
Lead	ppm	ASTM D5185m	0	<1	0
Copper	ppm	ASTM D5185m	0	2	2
Tin	ppm	ASTM D5185m	0	<1	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	3	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m	<1	2	1
Calcium	ppm	ASTM D5185m	90	110	110
Phosphorus	ppm	ASTM D5185m	449	476	474
Zinc	ppm	ASTM D5185m	650	704	721
Sulfur	ppm	ASTM D5185m	2363	3252	3030

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	1	2	2
Sodium	ppm	ASTM D5185m	<1	0	0
Potassium	ppm	ASTM D5185m	>20	2	1


FLUID CLEANLINESS

method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>5000	331	---	▲ 6131
Particles >6µm	ASTM D7647	>1300	94	---	535
Particles >14µm	ASTM D7647	>160	11	---	1
Particles >21µm	ASTM D7647	>40	3	---	0
Particles >38µm	ASTM D7647	>10	0	---	0
Particles >71µm	ASTM D7647	>3	0	---	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	16/14/11	---	▲ 20/16/7


FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	0.81	0.92	0.87


Particle Trend

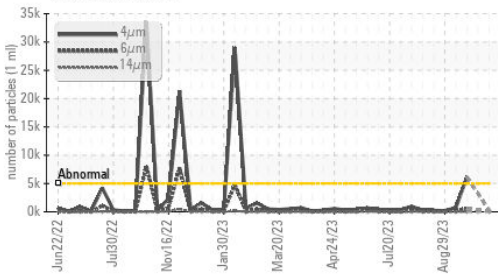


Acid Number

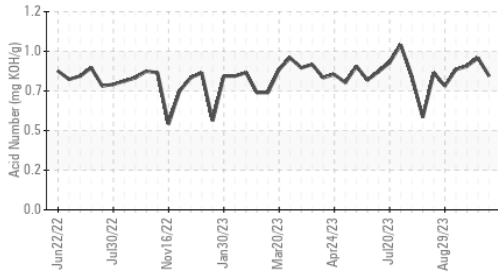

Viscosity @ 40°C

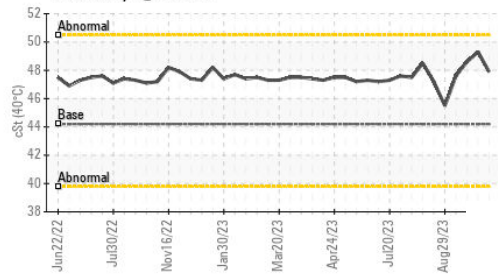


Particle Trend

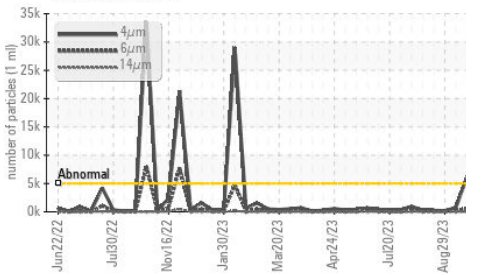






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	▲ MILKY	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	▲ 0.2%	▲ 0.2%
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	44.2	47.9	49.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

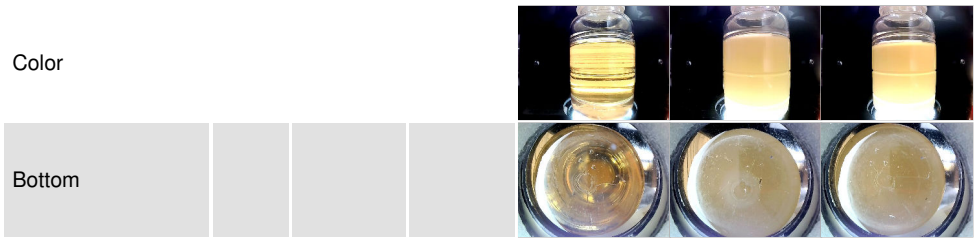

GRAPHS

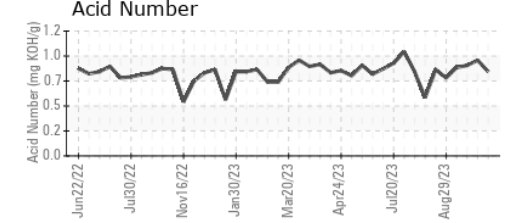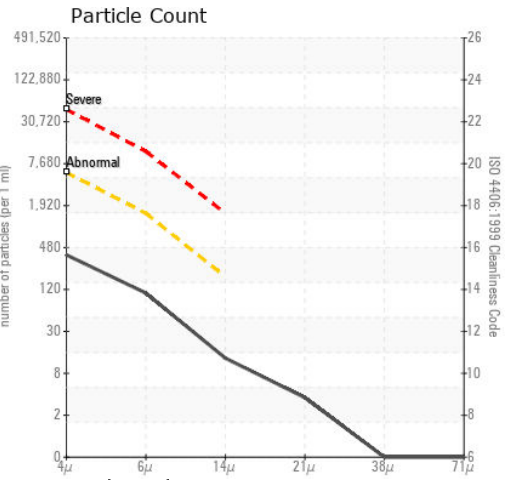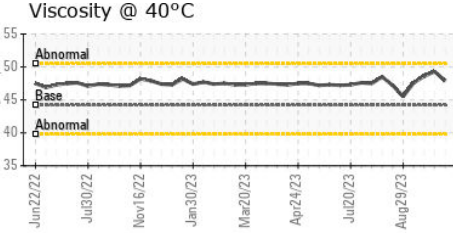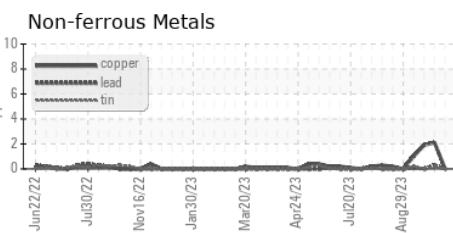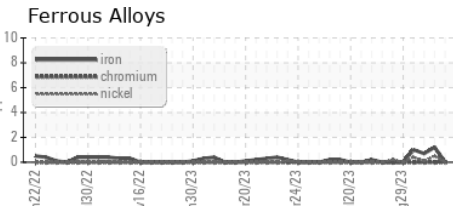

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0834876 **Received** : 17 Oct 2023
Lab Number : 05981883 **Diagnosed** : 19 Oct 2023
Unique Number : 10699178 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: PrtCount)

LEPRINO FOODS-ROSWELL
 5600 OMAHA RD
 ROSWELL, NM
 US 88203
 Contact: VINCENT MCINTIRE
 vmcintire@leprinofoods.com
 T:
 F: (505)347-5728

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)