




# OIL ANALYSIS REPORT

Sample Rating Trend

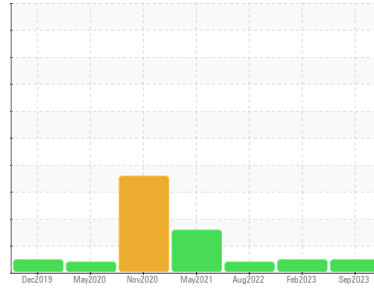

**NORMAL**



Machine Id  
**KAESER ASD 30 6437697 (S/N 1416)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

**SAMPLE INFORMATION**

method	limit/base	current	history1	history2	
Sample Number	Client Info	<b>KCPA004828</b>	KCP52433	KC107486	
Sample Date	Client Info	<b>13 Sep 2023</b>	08 Feb 2023	08 Aug 2022	
Machine Age	hrs	Client Info	<b>23903</b>	20476	17654
Oil Age	hrs	Client Info	<b>0</b>	5151	1528
Oil Changed	Client Info	<b>N/A</b>	Changed	Not Chngd	
Sample Status		<b>NORMAL</b>	NORMAL	ABNORMAL	

**WEAR METALS**

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	1
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>8</b>	7	10
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m	<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

**ADDITIVES**

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>8</b>	<1	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m 90	<b>3</b>	3	27
Calcium	ppm	ASTM D5185m 2	<b>0</b>	<1	<1
Phosphorus	ppm	ASTM D5185m	<b>6</b>	12	2
Zinc	ppm	ASTM D5185m	<b>41</b>	20	58
Sulfur	ppm	ASTM D5185m	<b>16719</b>	21238	17330

**CONTAMINANTS**

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>2</b>	1	11
Potassium	ppm	ASTM D5185m >20	<b>2</b>	<1	4
Water	%	ASTM D6304 >0.05	<b>0.009</b>	0.011	0.019
ppm Water	ppm	ASTM D6304 >500	<b>97.4</b>	110.7	191.9






**FLUID CLEANLINESS**

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>1908</b>	1983	---
Particles >6µm	ASTM D7647 >1300	<b>632</b>	679	---
Particles >14µm	ASTM D7647 >80	<b>48</b>	65	---
Particles >21µm	ASTM D7647 >20	<b>11</b>	21	---
Particles >38µm	ASTM D7647 >4	<b>0</b>	1	---
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c) >--/17/13	<b>18/16/13</b>	18/17/13	---

**FLUID DEGRADATION**

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.33</b>	0.37	0.37


# OIL ANALYSIS REPORT

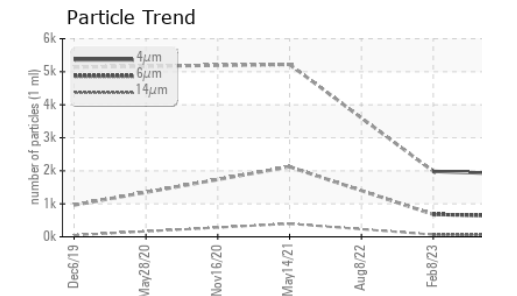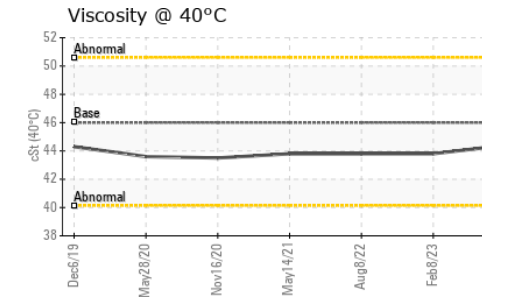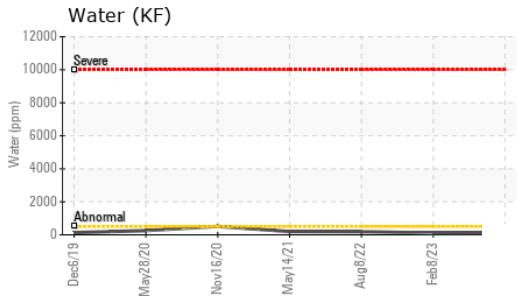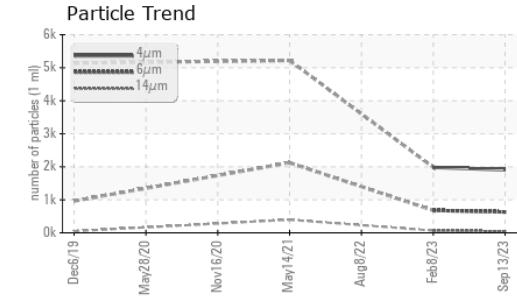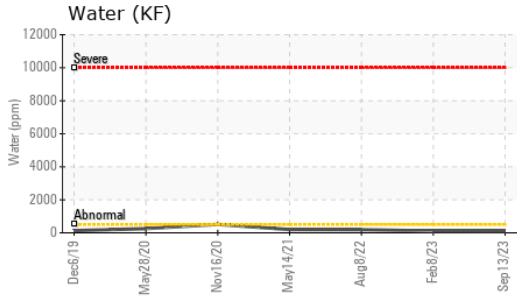





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.4	43.8	43.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

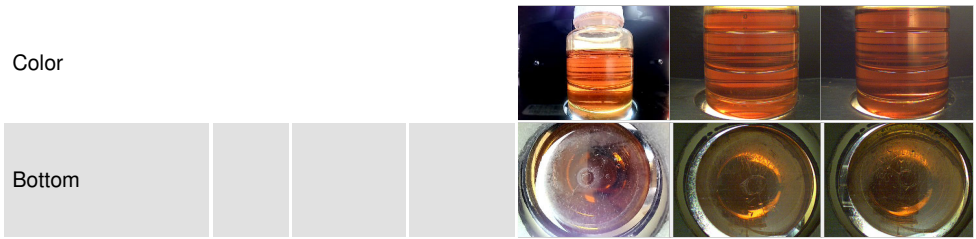

## GRAPHS

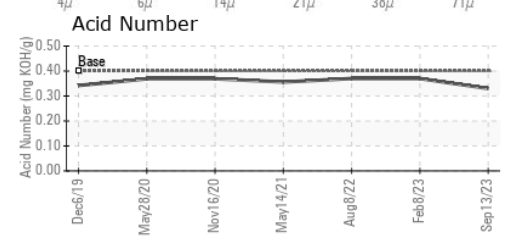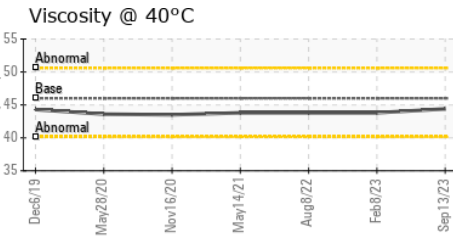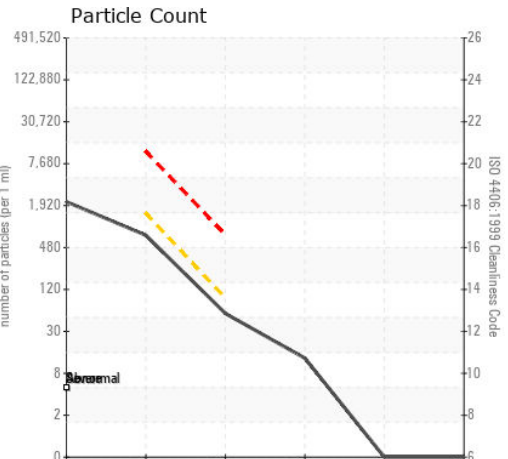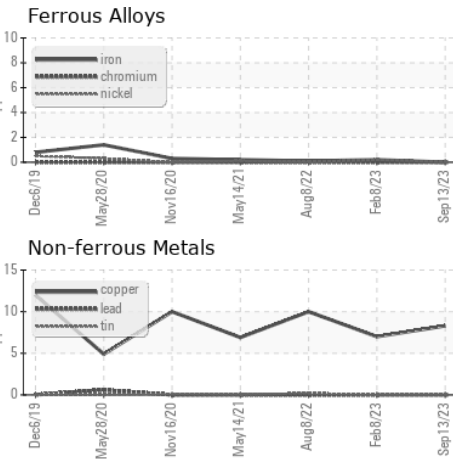

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA004828 **Received** : 17 Oct 2023  
**Lab Number** : 05981891 **Diagnosed** : 19 Oct 2023  
**Unique Number** : 10699186 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**BEKO TECHNOLOGIES**  
 900 GREAT SOUTHWEST PKWY  
 ATLANTA, GA  
 US 30336  
 Contact: COLIN CAMPBELL  
 colincampbell@bekousa.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: