




# OIL ANALYSIS REPORT

Sample Rating Trend

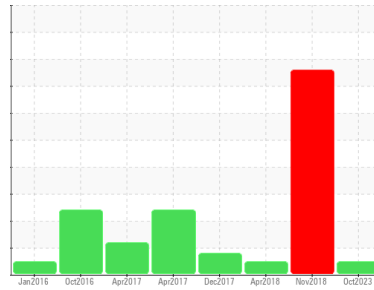

**NORMAL**



Machine Id  
**KAESER AS 30 4649477 (S/N 1135)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA006873</b>	KC67616	KC79585
Sample Date	Client Info			<b>16 Oct 2023</b>	12 Nov 2018	12 Apr 2018
Machine Age	hrs	Client Info		<b>10372</b>	6331	3169
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	Not Changd	Changed
Sample Status				<b>NORMAL</b>	SEVERE	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	1	1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	9	<1
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m		<b>---</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	<1	13
Barium	ppm	ASTM D5185m	90	<b>4</b>	0	5
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	7
Magnesium	ppm	ASTM D5185m	90	<b>40</b>	30	0
Calcium	ppm	ASTM D5185m	2	<b>0</b>	3	0
Phosphorus	ppm	ASTM D5185m		<b>2</b>	5	32
Zinc	ppm	ASTM D5185m		<b>21</b>	25	0
Sulfur	ppm	ASTM D5185m		<b>18585</b>	20161	1158

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	<1	0
Sodium	ppm	ASTM D5185m		<b>17</b>	4	19
Potassium	ppm	ASTM D5185m	>20	<b>4</b>	2	13
Water	%	ASTM D6304	>0.05	<b>0.016</b>	▲ 0.330	0.011
ppm Water	ppm	ASTM D6304	>500	<b>162.0</b>	▲ 3300	110

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>3185</b>	---	2811
Particles >6µm		ASTM D7647	>1300	<b>914</b>	---	798
Particles >14µm		ASTM D7647	>80	<b>67</b>	---	67
Particles >21µm		ASTM D7647	>20	<b>20</b>	---	22
Particles >38µm		ASTM D7647	>4	<b>2</b>	---	2
Particles >71µm		ASTM D7647	>3	<b>0</b>	---	0
Oil Cleanliness		ISO 4406 (c)	>17/13	<b>17/13</b>	---	17/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.31</b>	0.377	0.321


# OIL ANALYSIS REPORT

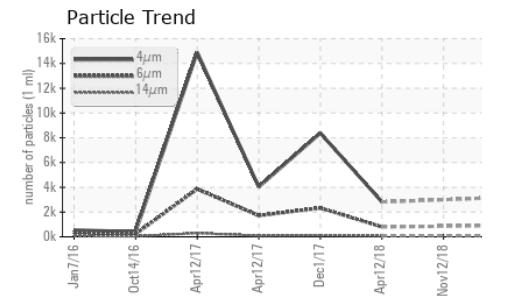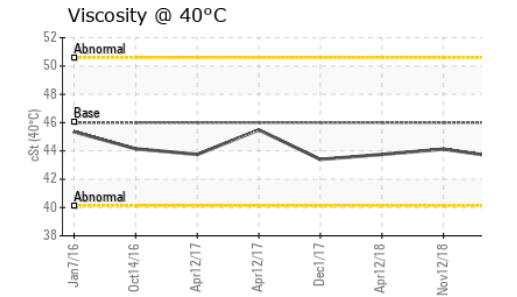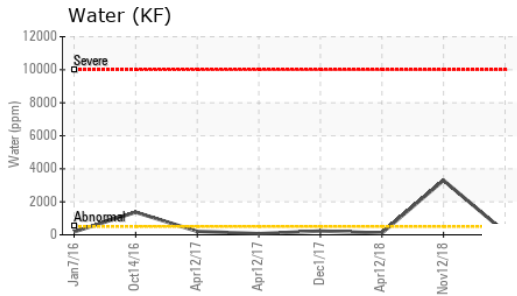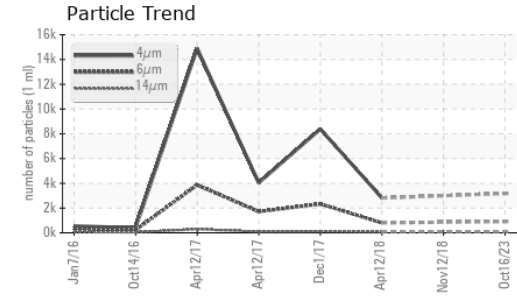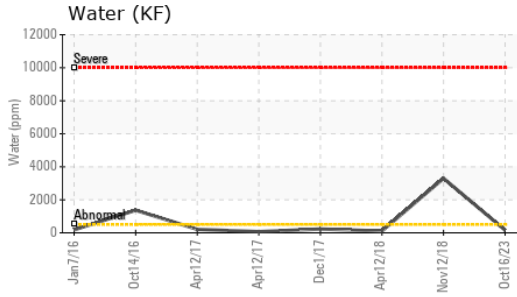






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	43.5	44.13

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

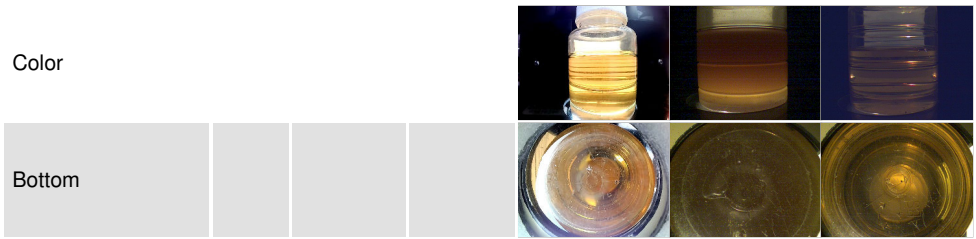

## GRAPHS

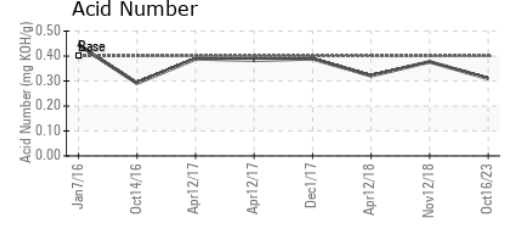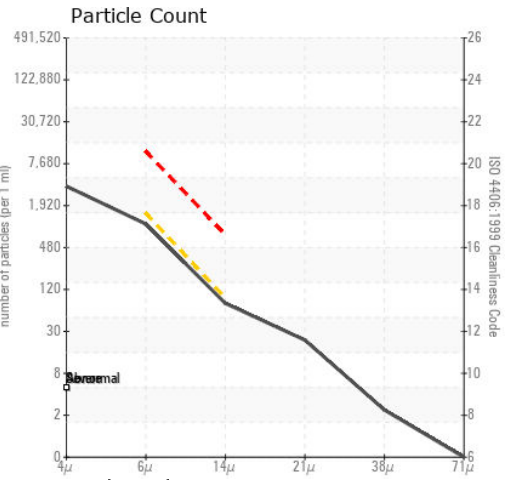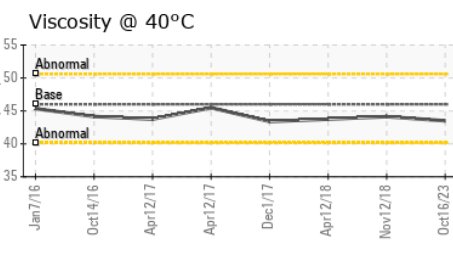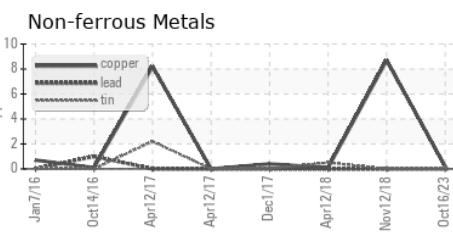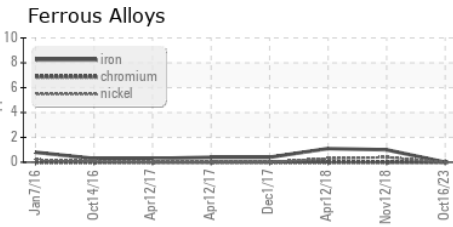

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA006873 **Received** : 17 Oct 2023  
**Lab Number** : 05981893 **Diagnosed** : 19 Oct 2023  
**Unique Number** : 10699188 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**ROCKWELL COLLINS**  
 22640 DAVIS DR  
 STERLING, VA  
 US 20164  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: