


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



$^{\text{Machine Id}}_{8034079}$ (S/N 1821)

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		May202	2 Oct2022	Apr2023	Oct2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC125445	KC110774	KC98086
Sample Date		Client Info		02 Oct 2023	10 Apr 2023	31 Oct 2022
Machine Age	hrs	Client Info		7773	6247	4637
Oil Age	hrs	Client Info		0	3715	2105
Oil Changed		Client Info		N/A	Changed	Not Changd
Sample Status				NORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	0	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	10	11	13
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	3	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	19	<1	13
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		<1	1	15
Zinc	ppm	ASTM D5185m		18	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	▲ 78
Sodium	ppm	ASTM D5185m		6	0	4
Potassium	ppm	ASTM D5185m	>20	3	<1	0
Water	%	ASTM D6304		0.012	0.010	0.023
ppm Water	ppm	ASTM D6304	>500	122.2	106.8	230.3
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		976	657	
Particles >6μm		ASTM D7647	>1300	439	288	
Particles >14μm		ASTM D7647	>80	68	30	
Particles >21µm		ASTM D7647	>20	26	5	
Particles >38μm		ASTM D7647	>4	2	0	
Particles >71μm		ASTM D7647		0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/16/13	17/15/12	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.32

0.31

0.32



OIL ANALYSIS REPORT

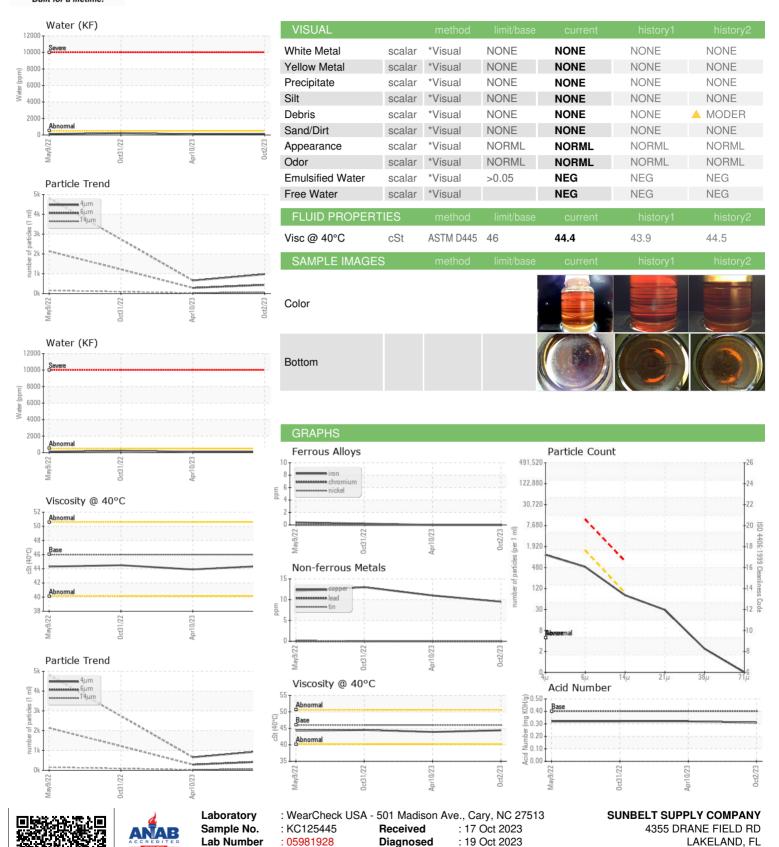

Certificate L2367

Unique Number

Test Package

: 10699223

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: IND 2

Diagnostician

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

: Don Baldridge

US 33811

T: F:

Contact: Service Manager