



PROBLEM SUMMARY

Sample Rating Trend




WATER



Machine Id
CHILLER 1 - AUGUSTA
Component
Chiller
Fluid
NOT GIVEN (--- GAL)



COMPONENT CONDITION SUMMARY

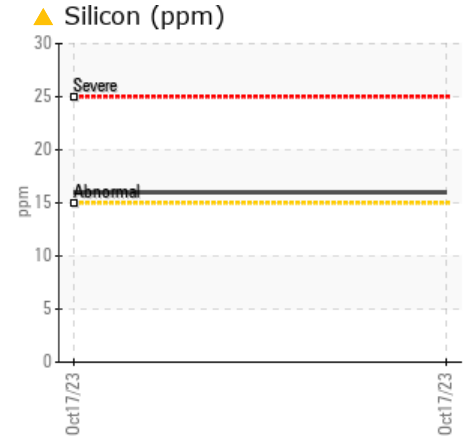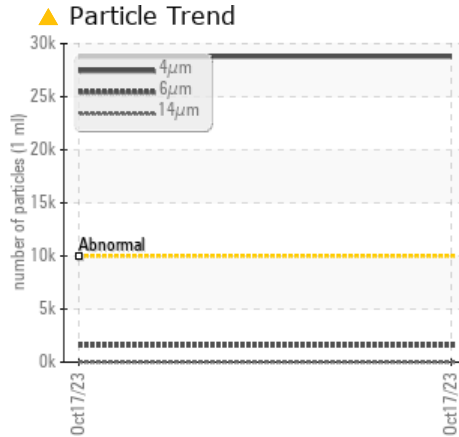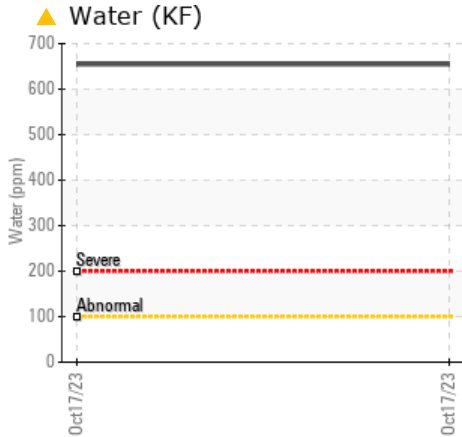

RECOMMENDATION

We recommend an early resample to monitor this condition. Please specify the brand and viscosity of the oil on your next sample.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	---	---
Silicon	ppm	ASTM D5185m	>15	▲ 16	---
Water	%	ASTM D6304	>0.01	▲ 0.065	---
ppm Water	ppm	ASTM D6304	>100	▲ 654.8	---
Particles >4µm		ASTM D7647	>10000	▲ 28791	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	▲ 22/18/11	---

Customer Id: XAEMID
Sample No.: WC05981956
Lab Number: 05981956
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Resample	---	---	?	We recommend an early resample to monitor this condition.
Information Required	---	---	?	Please specify the brand, type, and viscosity of the oil on your next sample.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend



WATER



Machine Id
CHILLER 1 - AUGUSTA

Component
Chiller
Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

▲ Recommendation

We recommend an early resample to monitor this condition. Please specify the brand and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of silt (particulates < 6 microns in size) present in the oil. There is a light concentration of water present in the oil. Elemental level of silicon (Si) above normal.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC05981956	---	---
Sample Date	Client Info		17 Oct 2023	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			ABNORMAL	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	0	---	---
Chromium	ppm	ASTM D5185m >2	0	---	---
Nickel	ppm	ASTM D5185m	0	---	---
Titanium	ppm	ASTM D5185m	0	---	---
Silver	ppm	ASTM D5185m >2	0	---	---
Aluminum	ppm	ASTM D5185m >3	0	---	---
Lead	ppm	ASTM D5185m >2	0	---	---
Copper	ppm	ASTM D5185m >8	0	---	---
Tin	ppm	ASTM D5185m >4	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	---	---
Barium	ppm	ASTM D5185m	3	---	---
Molybdenum	ppm	ASTM D5185m	0	---	---
Manganese	ppm	ASTM D5185m	0	---	---
Magnesium	ppm	ASTM D5185m	0	---	---
Calcium	ppm	ASTM D5185m	0	---	---
Phosphorus	ppm	ASTM D5185m	6	---	---
Zinc	ppm	ASTM D5185m	5	---	---
Sulfur	ppm	ASTM D5185m	5	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	▲ 16	---	---
Sodium	ppm	ASTM D5185m	0	---	---
Potassium	ppm	ASTM D5185m >20	2	---	---
Water	%	ASTM D6304 >0.01	▲ 0.065	---	---
ppm Water	ppm	ASTM D6304 >100	▲ 654.8	---	---

FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 28791	---	---
Particles >6µm	ASTM D7647	>2500	1580	---	---
Particles >14µm	ASTM D7647	>320	15	---	---
Particles >21µm	ASTM D7647	>80	2	---	---
Particles >38µm	ASTM D7647	>20	0	---	---
Particles >71µm	ASTM D7647	>4	0	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 22/18/11	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.014	---	---



OIL ANALYSIS REPORT

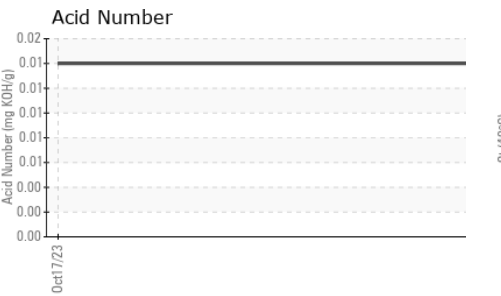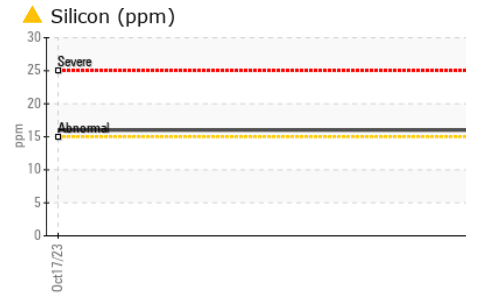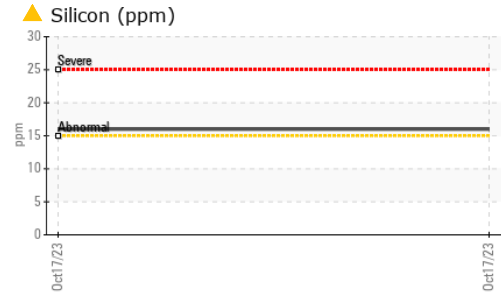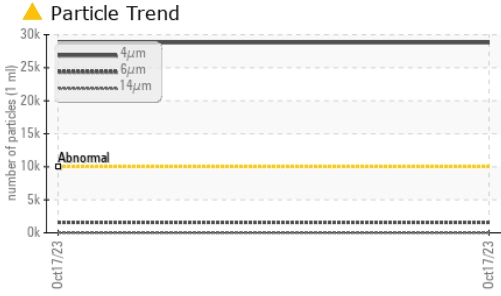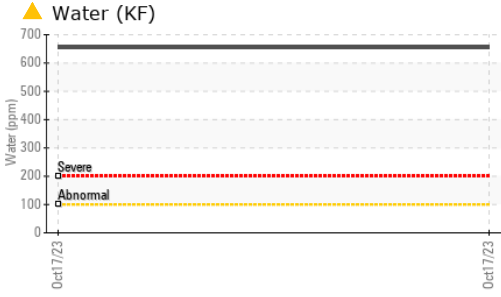





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	103	---	---

SAMPLE IMAGES

method	limit/base	current	history1	history2	
Color				no image	no image
Bottom				no image	no image

GRAPHS

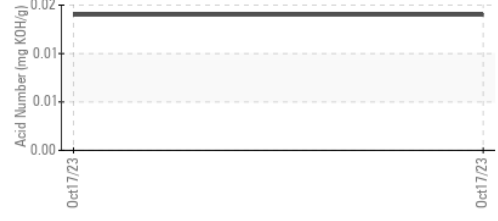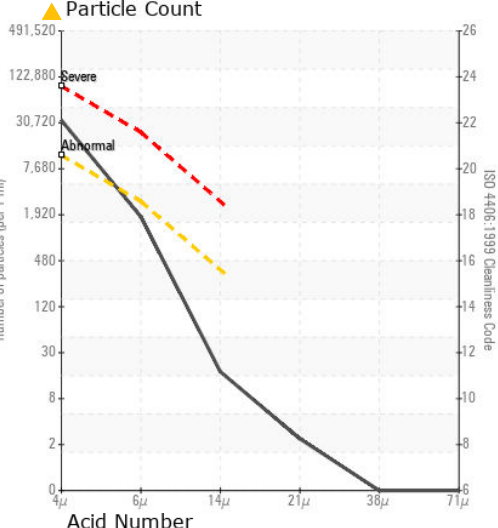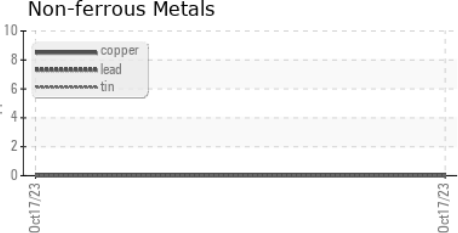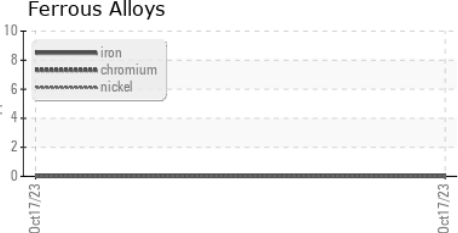

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC05981956 **Received** : 17 Oct 2023
Lab Number : 05981956 **Diagnosed** : 26 Oct 2023
Unique Number : 10699251 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KF, PrtCount)

XAERUS FLUIDS
 2825 SCHUETTE RD
 MIDLAND, MI
 US 48642
 Contact: BRYAN DOLE
 bdole@xaerusfluids.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)