


Area  
**PALASYN 45**  
Machine Id  
**SULLIVAN PALATEK 22HE003288 - ROBERT BOSCH/855 CAMP CREEK**  
Component  
**Compressor**

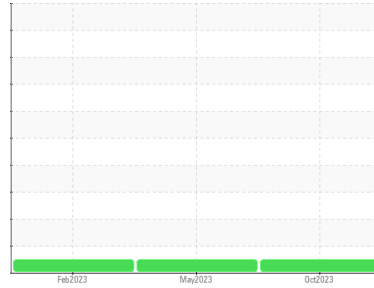

**DIAGNOSIS**

- Recommendation**  
Resample at the next service interval to monitor.
- Wear**  
All component wear rates are normal.
- Contamination**  
There is no indication of any contamination in the component.
- Fluid Condition**  
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCS05981960</b>	UCS05865735	UCS05799813
Sample Date	Client Info			<b>05 Oct 2023</b>	25 May 2023	22 Feb 2023
Machine Age	hrs Client Info			<b>1789</b>	937	934
Oil Age	hrs Client Info			<b>1789</b>	937	934
Oil Changed	Client Info			<b>Not Changed</b>	Not Changed	Not Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0



ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	0.0	<b>3</b>	11	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	0	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	0.0	<b>0</b>	2	0
Calcium	ppm	ASTM D5185m	0.0	<b>0</b>	3	0
Phosphorus	ppm	ASTM D5185m	966	<b>667</b>	675	577
Zinc	ppm	ASTM D5185m	0	<b>6</b>	17	0
Sulfur	ppm	ASTM D5185m	1309	<b>1225</b>	1504	1426

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>2</b>	2	3
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	0	0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.172	<b>0.082</b>	0.066	0.121


VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	LIGHT	MODER
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

# OIL ANALYSIS REPORT



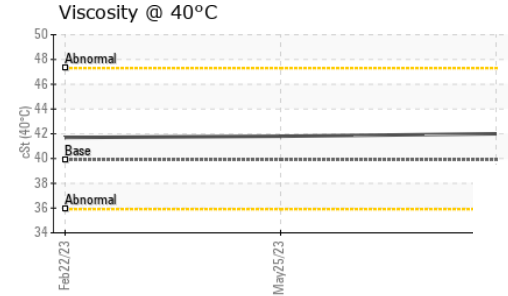
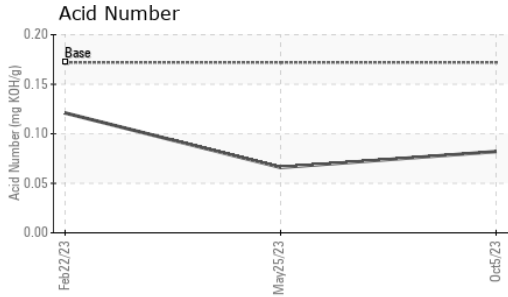


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	39.9	<b>42.0</b>	41.8	41.7

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

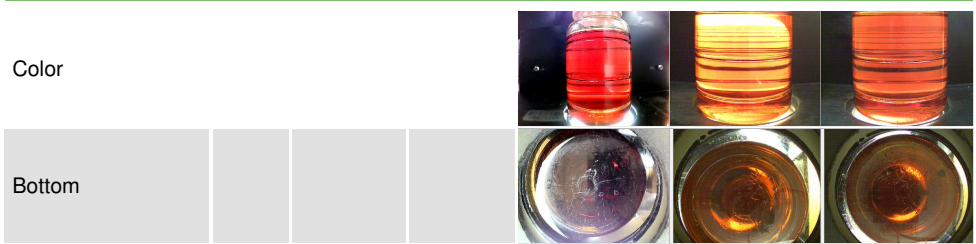

## GRAPHS

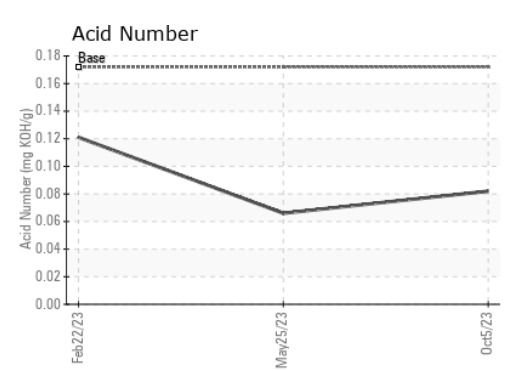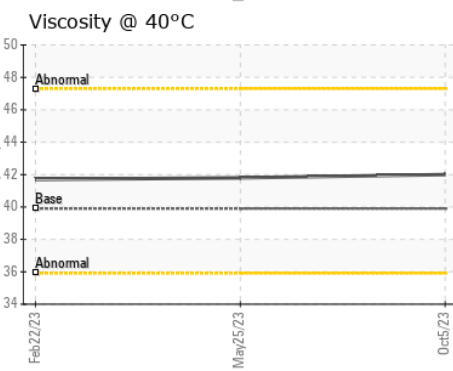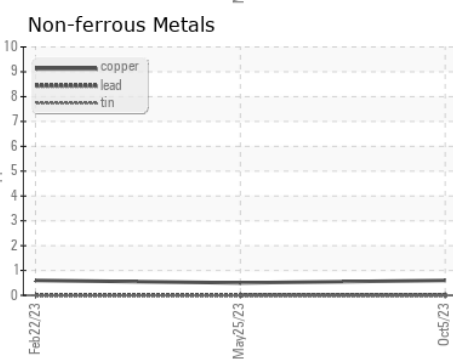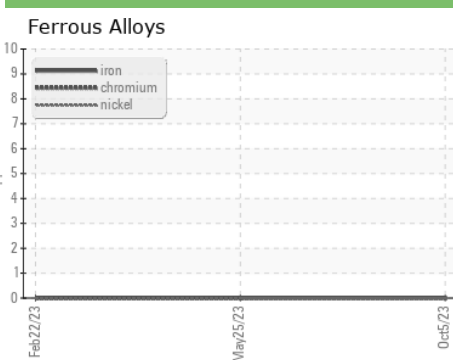

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCS05981960 **Received** : 17 Oct 2023  
**Lab Number** : **05981960** **Diagnosed** : 19 Oct 2023  
**Unique Number** : 10699255 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**ELITE COMPRESSED AIR SYSTEMS INC**  
MCDONOUGH, GA  
US 30252  
Contact: RONNY MINNIX  
elitecompressed@gmail.com  
T: (770)898-9594  
F:

Certificate L2367  
*To discuss this sample report, contact Customer Service at 1-800-237-1369.*  
*\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*  
*Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)*