


PROBLEM SUMMARY

Sample Rating Trend

ISO

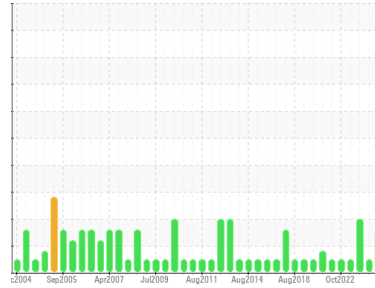


Machine Id
058CM12051

Component
Turbine

Fluid
ROYAL PURPLE SYNFILM GT 32 (500 GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

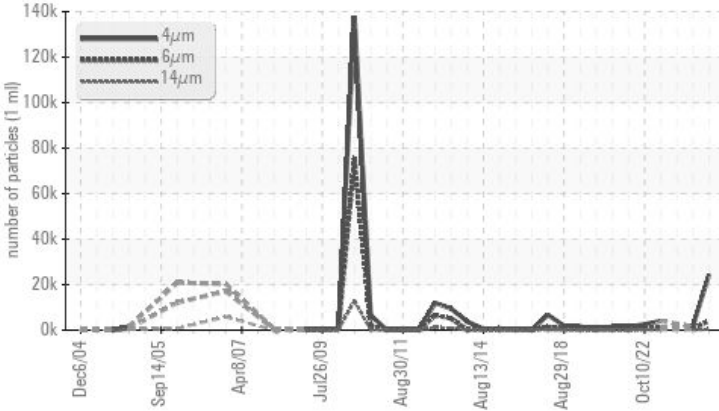

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	NORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 3959	706	---
Particles >14µm	ASTM D7647	>160	▲ 365	94	---
Particles >21µm	ASTM D7647	>40	▲ 119	26	---
Oil Cleanliness	ISO 4406 (c)	>--/17/14	▲ 22/19/16	18/17/14	---

Customer Id: ENTHOU
Sample No.: RP0020793
Lab Number: 05982354
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

09 Jul 2023 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



21 Mar 2023 Diag: Don Baldrige

WATER



We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. There is a trace of moisture present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



11 Jan 2023 Diag: Don Baldrige

NORMAL




Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

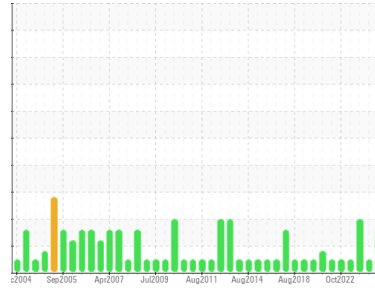

ISO



Machine Id
058CM12051

Component

Turbine

Fluid

ROYAL PURPLE SYNFILM GT 32 (500 GAL)

DIAGNOSIS

▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		RP0020793	RP0027350	RP0020763
Sample Date	Client Info		17 Oct 2023	09 Jul 2023	21 Mar 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	NORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >15	0	<1	1
Chromium	ppm	ASTM D5185m >4	0	0	0
Nickel	ppm	ASTM D5185m >2	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	2	1
Lead	ppm	ASTM D5185m	0	<1	<1
Copper	ppm	ASTM D5185m >5	3	3	3
Tin	ppm	ASTM D5185m >5	0	<1	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	0
Magnesium	ppm	ASTM D5185m	29	23	89
Calcium	ppm	ASTM D5185m	0	0	3
Phosphorus	ppm	ASTM D5185m	<1	2	<1
Zinc	ppm	ASTM D5185m	0	0	4

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	2	2	<1
Sodium	ppm	ASTM D5185m	4	2	0
Potassium	ppm	ASTM D5185m >20	0	1	0
Water	%	ASTM D6304 >0.03	0.010	0.017	▲ 0.077
ppm Water	ppm	ASTM D6304 >300	102.6	171.0	▲ 770

FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		24448	1587	---
Particles >6µm	ASTM D7647	>1300	▲ 3959	706	---
Particles >14µm	ASTM D7647	>160	▲ 365	94	---
Particles >21µm	ASTM D7647	>40	▲ 119	26	---
Particles >38µm	ASTM D7647	>10	5	1	---
Particles >71µm	ASTM D7647	>3	1	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/14	▲ 22/19/16	18/17/14	---

FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.32	0.32	0.42

OIL ANALYSIS REPORT


▲ Particle Trend

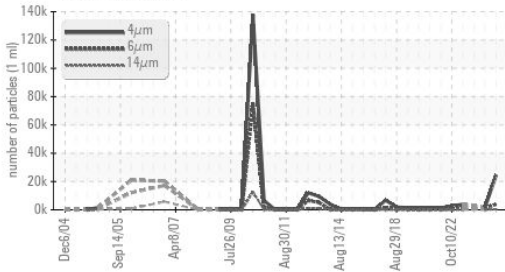


Water (KF)

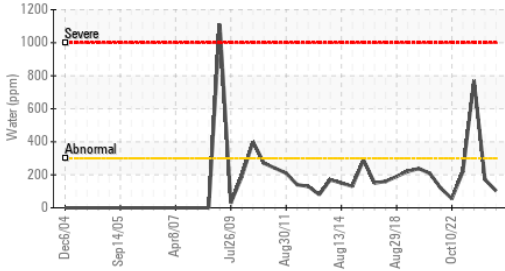


Acid Number

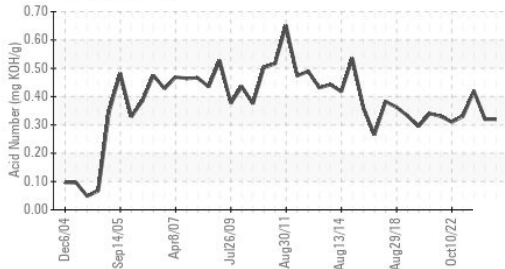

Water (KF)

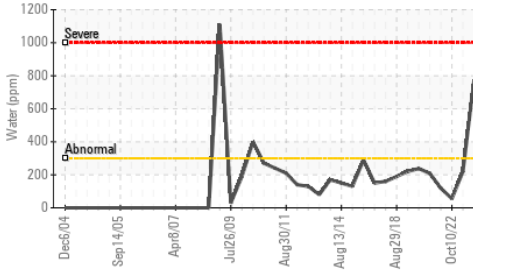


Viscosity @ 40°C

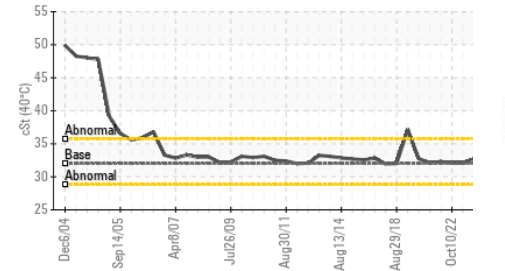






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.03	NEG	0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32	32.1	34.3

SAMPLE IMAGES

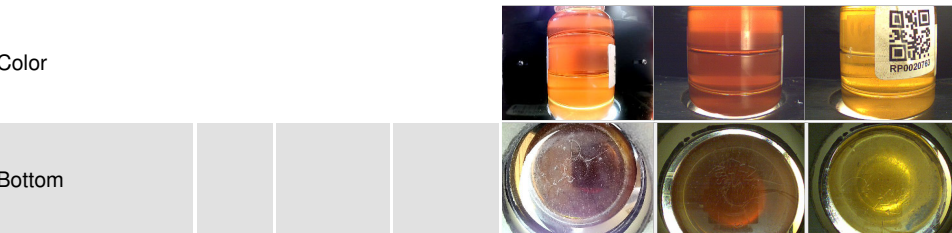

GRAPHS

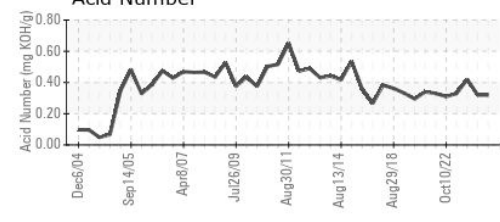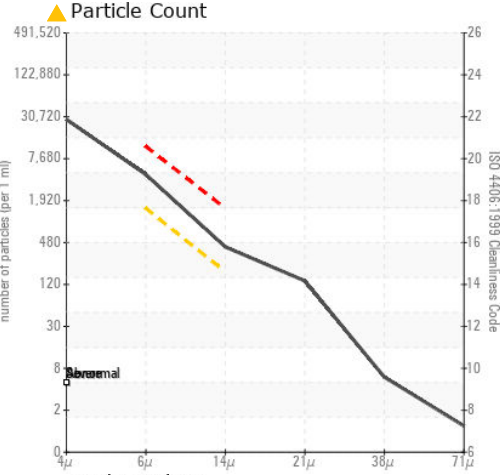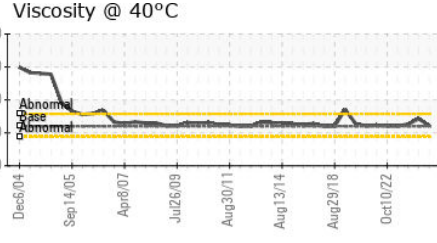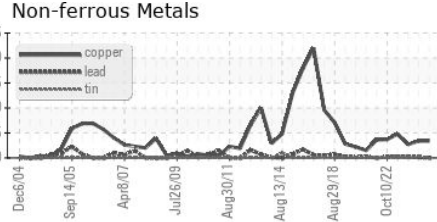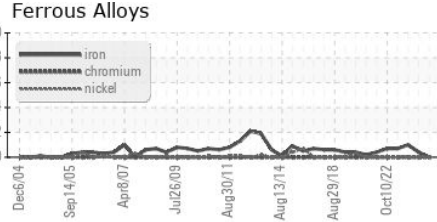

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0020793 **Received** : 18 Oct 2023
Lab Number : 05982354 **Diagnosed** : 20 Oct 2023
Unique Number : 10699649 **Diagnostician** : Angela Borella
Test Package : IND 2 (Additional Tests: PrtCount)

ENTERPRISE PRODUCTS
P.O. BOX 573
MONT BELVIEU, TX
US 77580
Contact: TOMMY EDWARDS
tedwards@eprod.com
T: (281)217-1411
F: (281)385-4327

Certificate L2367
To discuss this sample report, contact Customer Service at 1-800-237-1369.
* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)