




# OIL ANALYSIS REPORT

Sample Rating Trend

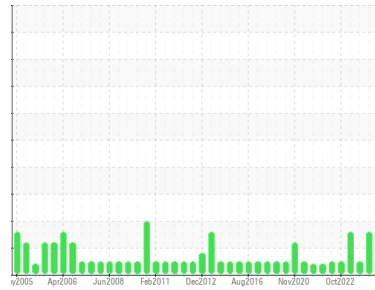

**NORMAL**



Machine Id  
**082CM12003**

Component  
**Turbine**

Fluid  
**ROYAL PURPLE SYNFILM GT 32 (250 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The water content is negligible. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>RP0020798</b>	RP0027355	RP0020768
Sample Date	Client Info		<b>17 Oct 2023</b>	09 Jul 2023	21 Mar 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	ATTENTION	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >15	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >2	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	2	<1
Lead	ppm	ASTM D5185m	<b>0</b>	<1	<1
Copper	ppm	ASTM D5185m >5	<b>5</b>	4	4
Tin	ppm	ASTM D5185m >5	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>81</b>	77	90
Calcium	ppm	ASTM D5185m	<b>0</b>	1	1
Phosphorus	ppm	ASTM D5185m	<b>4</b>	2	10
Zinc	ppm	ASTM D5185m	<b>0</b>	0	0

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>2</b>	<1	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	2	0
Water	%	ASTM D6304 >0.03	<b>0.013</b>	0.022	0.019
ppm Water	ppm	ASTM D6304 >300	<b>132.4</b>	225.2	198.7






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>2003</b>	4234	3901
Particles >6µm	ASTM D7647 >1300		<b>466</b>	▲ 1541	1249
Particles >14µm	ASTM D7647 >160		<b>35</b>	▲ 174	101
Particles >21µm	ASTM D7647 >40		<b>15</b>	▲ 51	35
Particles >38µm	ASTM D7647 >10		<b>2</b>	2	1
Particles >71µm	ASTM D7647 >3		<b>1</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/14	<b>18/16/12</b>	▲ 19/18/15	19/17/14

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.37</b>	0.31	0.35


# OIL ANALYSIS REPORT

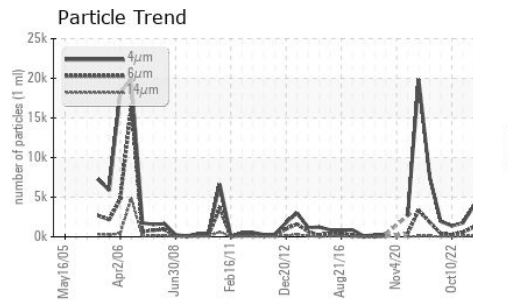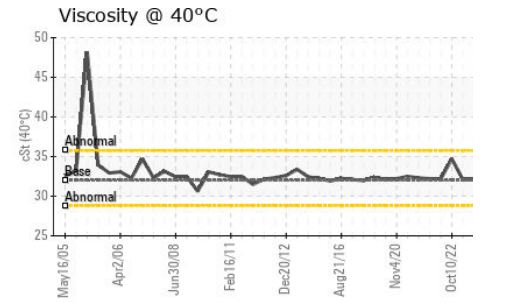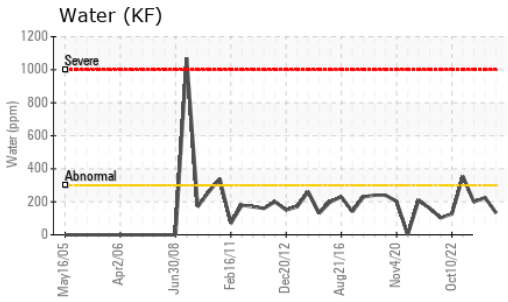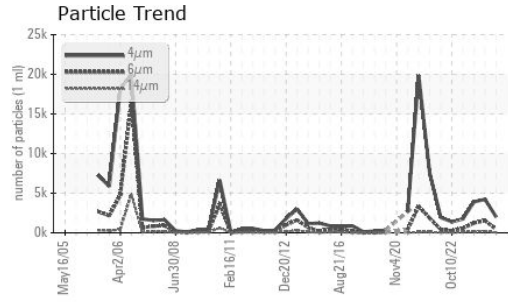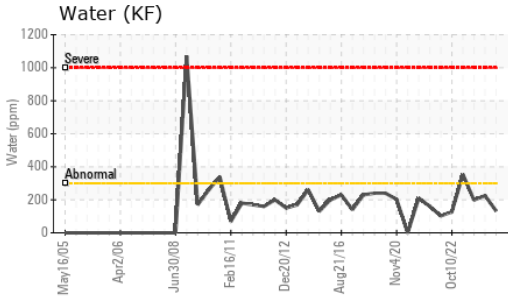






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	LIGHT	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.03	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32	32.3	32.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

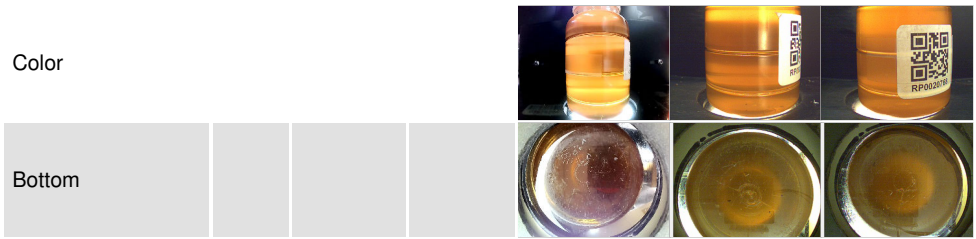

## GRAPHS

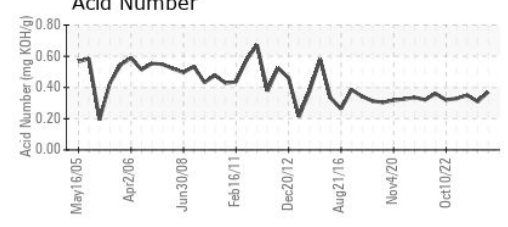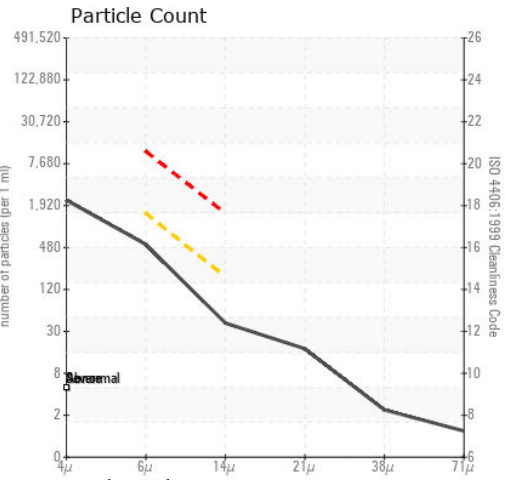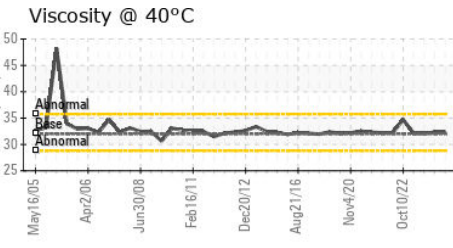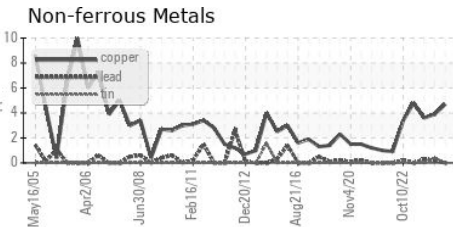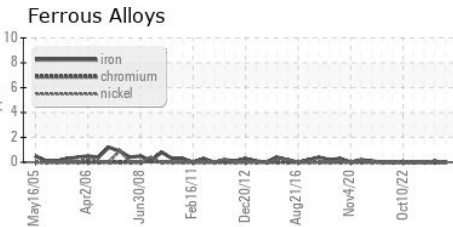

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0020798 **Received** : 18 Oct 2023  
**Lab Number** : 05982367 **Diagnosed** : 20 Oct 2023  
**Unique Number** : 10699662 **Diagnostician** : Angela Borella  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**ENTERPRISE PRODUCTS**  
P.O. BOX 573  
MONT BELVIEU, TX  
US 77580  
Contact: TOMMY EDWARDS  
tedwards@eproduct.com  
T: (281)217-1411  
F: (281)385-4327

Certificate L2367  
To discuss this sample report, contact Customer Service at 1-800-237-1369.  
\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)