


PROBLEM SUMMARY

Sample Rating Trend



ISO

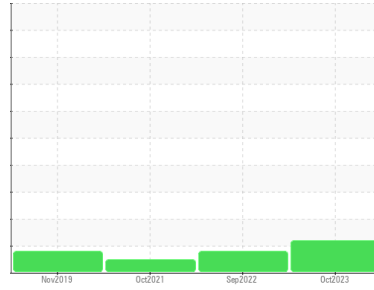


Machine Id
KAESER SK 15 5804877 (S/N 2095)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

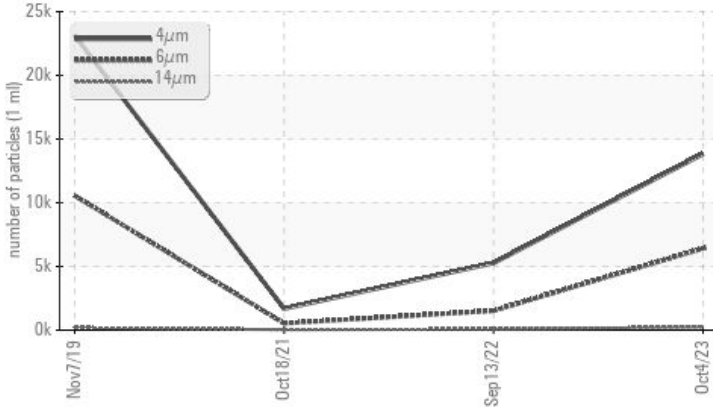

RECOMMENDATION

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ATTENTION	NORMAL
Particles >6µm	ASTM D7647	>1300	▲ 6421	▲ 1527	532
Particles >14µm	ASTM D7647	>80	▲ 237	73	30
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/20/15	▲ 20/18/13	16/12

Customer Id: LENCHE
Sample No.: KCPA007761
Lab Number: 05982374
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

13 Sep 2022 Diag: Don Baldrige

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



18 Oct 2021 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



07 Nov 2019 Diag: Angela Borella

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report



Machine Id
KAESER SK 15 5804877 (S/N 2095)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

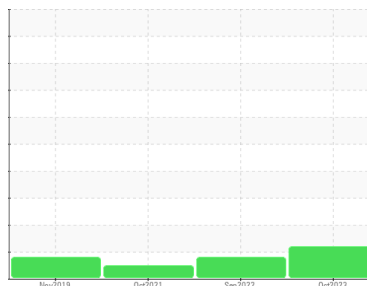

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA007761	KCP40956	KCP42934
Sample Date	Client Info			04 Oct 2023	13 Sep 2022	18 Oct 2021
Machine Age	hrs	Client Info		8420	7315	6432
Oil Age	hrs	Client Info		0	761	1151
Oil Changed	Client Info			N/A	Changed	N/A
Sample Status				ABNORMAL	ATTENTION	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	0	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	0	<1	<1
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m		---	---	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	<1
Barium	ppm	ASTM D5185m	90	13	20	24
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	100	84	87	85
Calcium	ppm	ASTM D5185m	0	0	1	<1
Phosphorus	ppm	ASTM D5185m	0	1	2	9
Zinc	ppm	ASTM D5185m	0	0	2	0
Sulfur	ppm	ASTM D5185m	23500	18769	22478	18064

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	<1	2
Sodium	ppm	ASTM D5185m		11	8	7
Potassium	ppm	ASTM D5185m	>20	<1	<1	<1
Water	%	ASTM D6304	>0.05	0.019	0.019	0.013
ppm Water	ppm	ASTM D6304	>500	190.3	196.5	131.0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		13823	5267	1679
Particles >6µm		ASTM D7647	>1300	▲ 6421	▲ 1527	532
Particles >14µm		ASTM D7647	>80	▲ 237	73	30
Particles >21µm		ASTM D7647	>20	24	9	6
Particles >38µm		ASTM D7647	>4	2	0	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 21/20/15	▲ 20/18/13	16/12

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.39	0.35	0.326

OIL ANALYSIS REPORT

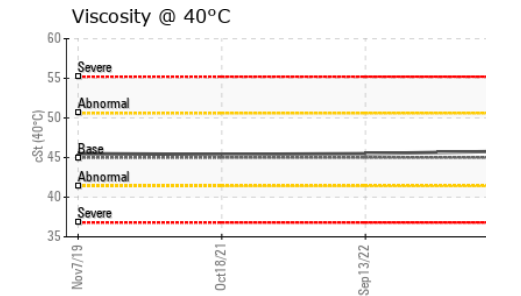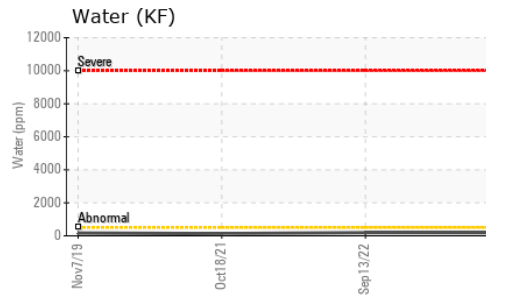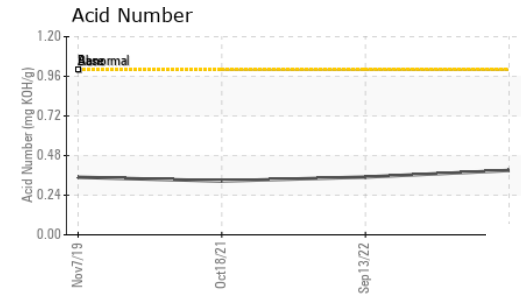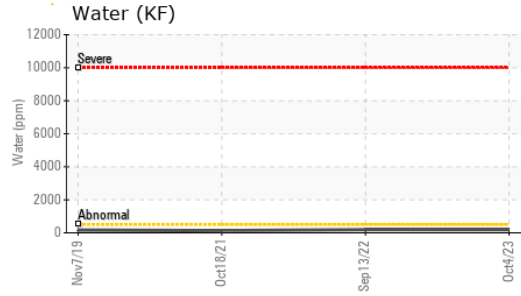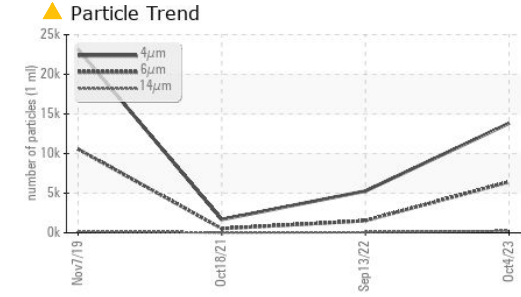





PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	45.8	45.5	45.4

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				
Bottom				

GRAPHS

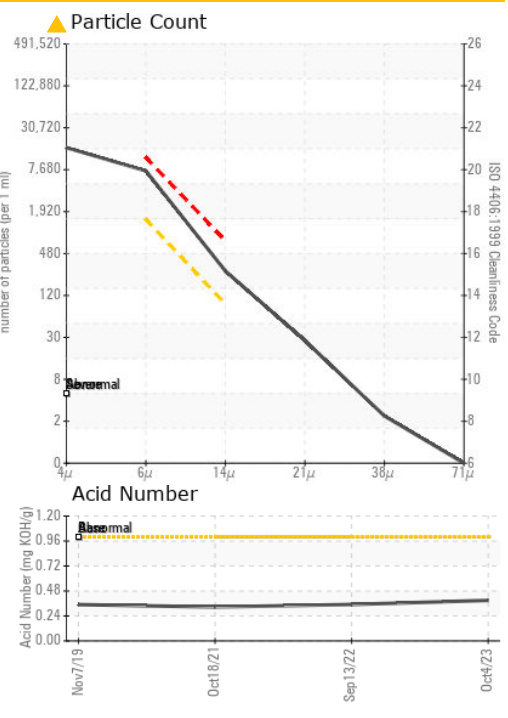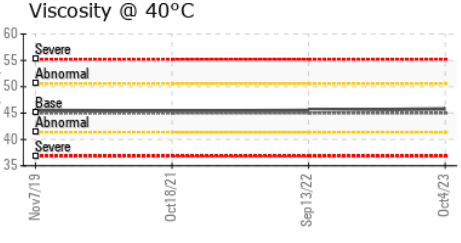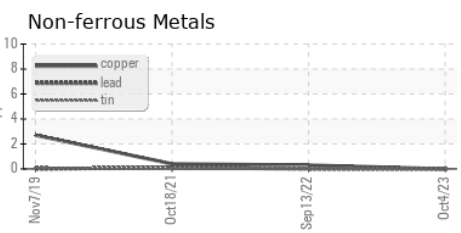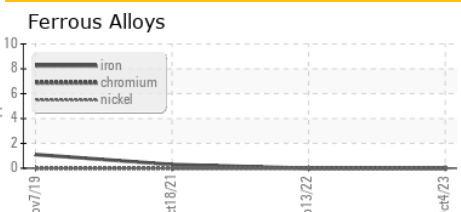

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA007761 **Received** : 18 Oct 2023
Lab Number : 05982374 **Diagnosed** : 20 Oct 2023
Unique Number : 10699669 **Diagnostician** : Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

LENNOX ENTERPRISES INC
 617 E PERSHING
 CHEYENNE, WY
 US 82001
 Contact: SERVICE MANAGER
 lennoxabr@gmail.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)