


PROBLEM SUMMARY

KAESER SM-15 3852429 (S/N 1253)

Compressor Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

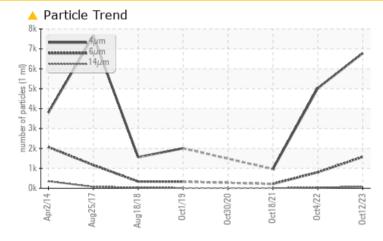

RECOMMENDATION

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS							
Sample Status			ATTENTION	NORMAL	NORMAL		
Particles >6µm	ASTM D7647	>1300	🔺 1574	802	216		
Particles >14µm	ASTM D7647	>80	<u> </u>	32	13		
Oil Cleanliness	ISO 4406 (c)	>/17/13	<u> </u>	20/17/12	15/11		


Customer Id: ADVAUR Sample No.: KCPA007827 Lab Number: 05982381 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Angela Borella +1 800-237-1369 angela.borella@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

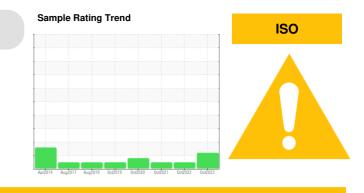

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

04 Oct 2022 Diag: Doug Bogart



Resample at the next service interval to monitor.All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

18 Oct 2021 Diag: Don Baldridge

30 Oct 2020 Diag: Jonathan Hester



Resample at the next service interval to monitor.All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The oil viscosity is higher than normal. The AN level is acceptable for this fluid.





Report Id: ADVAUR [WUSCAR] 05982381 (Generated: 10/20/2023 09:55:57) Rev: 1



OIL ANALYSIS REPORT



Compressor Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

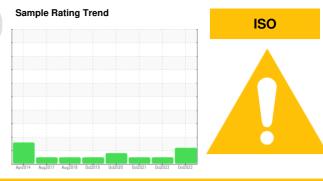


SAMPLE INFORM		method	limit/base	current	history1	history2
			in in base			
Sample Number		Client Info		KCPA007827	KCP50479	KCP42930
Sample Date		Client Info		12 Oct 2023	04 Oct 2022	18 Oct 2021
Machine Age	hrs	Client Info		32129	21965	24511
Oil Age	hrs	Client Info		0	3454	3659
Oil Changed		Client Info		N/A	Changed	Changed
Sample Status				ATTENTION	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	1
Aluminum	ppm	ASTM D5185m	>10	0	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	5	5	<1
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	<1
Barium	ppm	ASTM D5185m		13	13	52
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m	100	0	0	<1
Magnesium	ppm	ASTM D5185m	100	35	32	92
Calcium	ppm	ASTM D5185m		0	<1	2
Phosphorus	ppm	ASTM D5185m	0	<1	3	6
Zinc	ppm	ASTM D5185m		<1	11	0
Sulfur	ppm	ASTM D5185m	23500	18934	23498	17856
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		7	3	9
Potassium	ppm	ASTM D5185m	>20	0	0	1
Water	%	ASTM D6304	>0.05	0.010	0.014	0.017
ppm Water	ppm	ASTM D6304	>500	109.1	142.8	176.2
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		6781	5026	961
Particles >6µm		ASTM D7647	>1300	<u> </u>	802	216
Particles >14µm		ASTM D7647	>80	<u> </u>	32	13
Particles >21µm		ASTM D7647		17	4	3
Particles >38µm		ASTM D7647	>4	1	0	0
Particles >71µm		ASTM D7647		0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u> </u>	20/17/12	15/11
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.37	0.40	0.324
	ing itori/g	A01WI D0040	0.0	0.07 at/l a a at/a a a // a a		


Report Id: ADVAUR [WUSCAR] 05982381 (Generated: 10/20/2023 09:55:58) Rev: 1


Contact/Location: SERVICE MANAGER ? - ADVAUR


L L COMPRESSOR Built for a lifetime.

OIL ANALYSIS REPORT











VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	49.3	49.5	46.5
SAMPLE IMAGES	S	method	limit/base	current	history1	history2

Color



Bottom

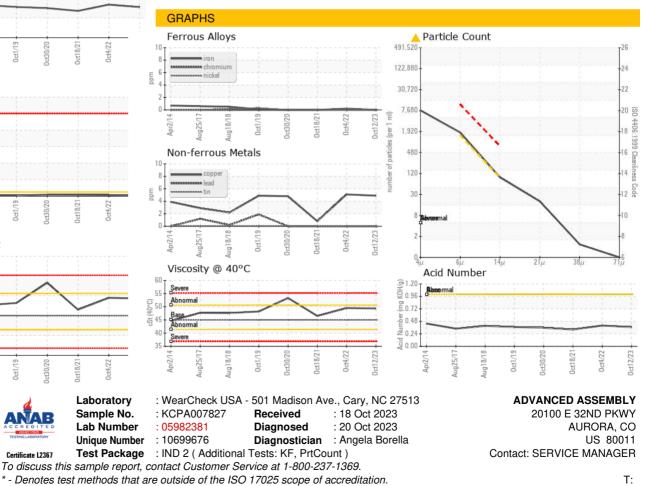

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

Contact/Location: SERVICE MANAGER ? - ADVAUR