




PROBLEM SUMMARY


Sample Rating Trend

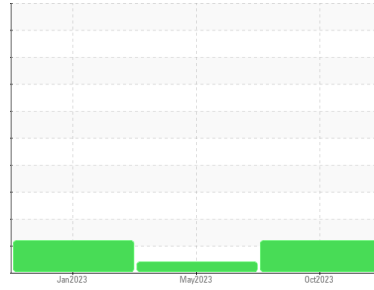

Machine Id
KAESER CSD75T 8529633 (S/N 1260)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

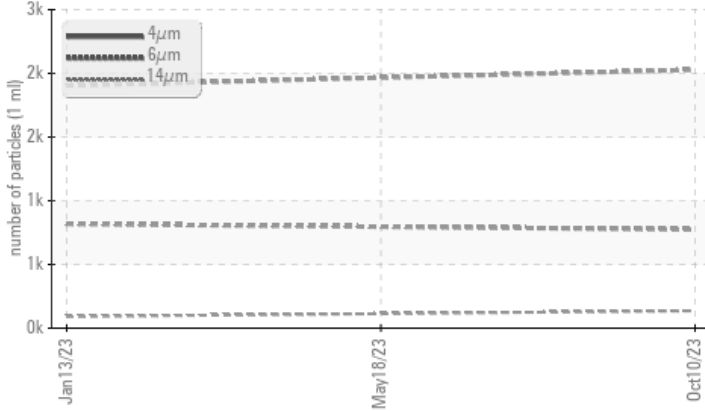

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	ABNORMAL	ATTENTION
Particles >14µm	ASTM D7647	>80	▲ 136	---	▲ 91
Particles >21µm	ASTM D7647	>20	▲ 48	---	▲ 27
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 18/17/14	---	▲ 18/17/14

Customer Id: DIGHAW
 Sample No.: KC125918
 Lab Number: 05982386
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

VIS DEBRIS



18 May 2023 Diag: Don Baldrige

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



ISO



13 Jan 2023 Diag: Don Baldrige


Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

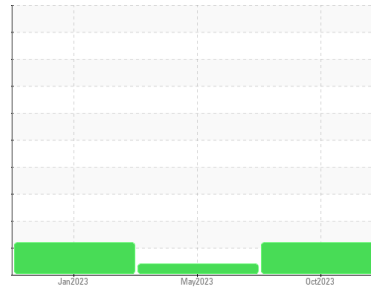

ISO



Machine Id
KAESER CSD75T 8529633 (S/N 1260)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KC125918	KC108364	KC101773
Sample Date	Client Info		10 Oct 2023	18 May 2023	13 Jan 2023
Machine Age	hrs	Client Info	9644	6214	3215
Oil Age	hrs	Client Info	0	3000	3215
Oil Changed	Client Info		N/A	Changed	Changed
Sample Status			ATTENTION	ABNORMAL	ATTENTION

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	<1	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	0	0
Lead	ppm	ASTM D5185m >10	0	2	0
Copper	ppm	ASTM D5185m >50	6	8	6
Tin	ppm	ASTM D5185m >10	0	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	0	<1	1
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 90	22	4	21
Calcium	ppm	ASTM D5185m 2	0	<1	0
Phosphorus	ppm	ASTM D5185m	2	2	6
Zinc	ppm	ASTM D5185m	5	9	10

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	0	1
Sodium	ppm	ASTM D5185m	10	2	4
Potassium	ppm	ASTM D5185m >20	3	1	<1
Water	%	ASTM D6304 >0.05	0.015	0.001	0.012
ppm Water	ppm	ASTM D6304 >500	153.2	13.8	122.7






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		2028	---	1904
Particles >6µm	ASTM D7647 >1300		774	---	818
Particles >14µm	ASTM D7647 >80		▲ 136	---	▲ 91
Particles >21µm	ASTM D7647 >20		▲ 48	---	▲ 27
Particles >38µm	ASTM D7647 >4		3	---	1
Particles >71µm	ASTM D7647 >3		0	---	0
Oil Cleanliness	ISO 4406 (c) >--/17/13		▲ 18/17/14	---	▲ 18/17/14

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.34	0.38	0.36


OIL ANALYSIS REPORT

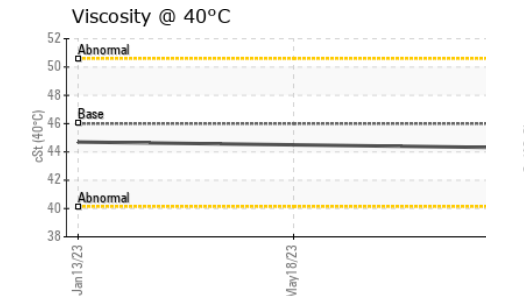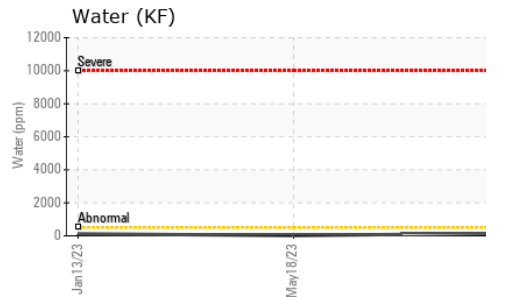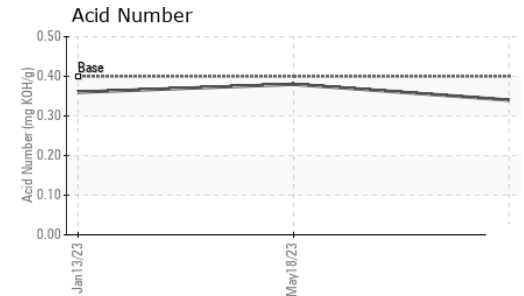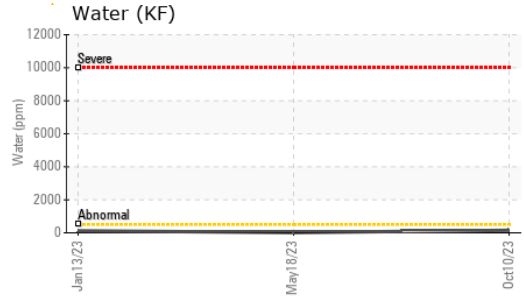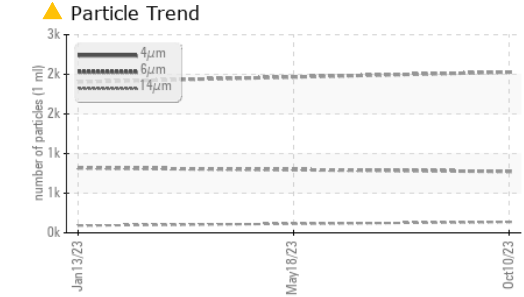





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.3	44.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

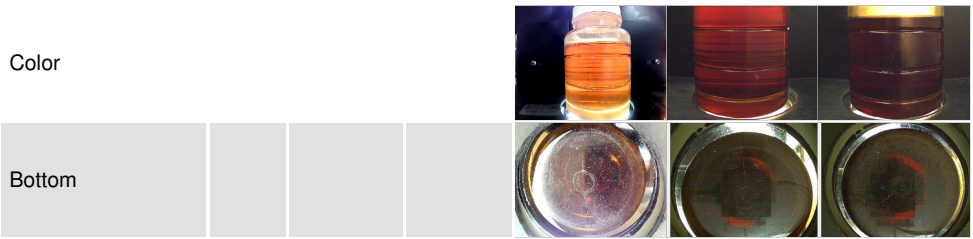

GRAPHS

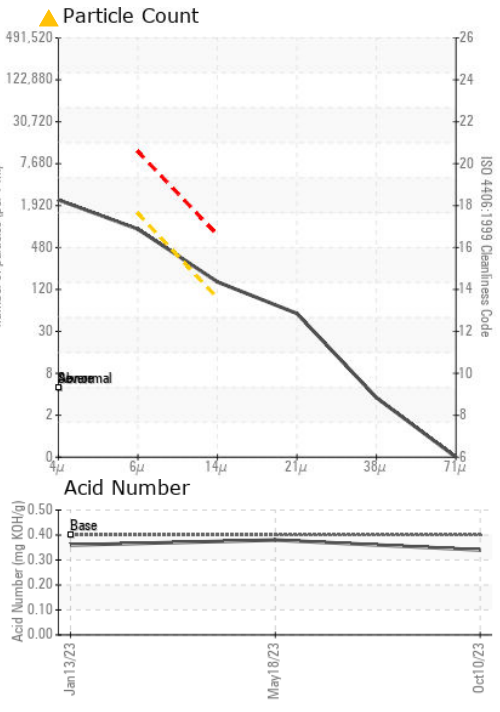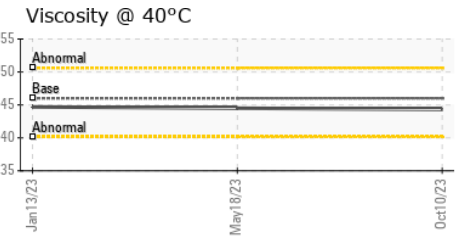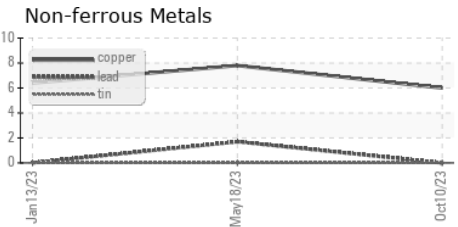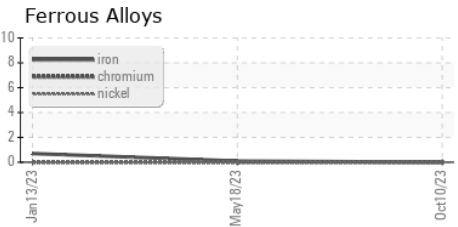

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC125918 **Received** : 18 Oct 2023
Lab Number : 05982386 **Diagnosed** : 20 Oct 2023
Unique Number : 10699681 **Diagnostician** : Angela Borella
Test Package : IND 2

DIGITAL EYE LAB
 4 SKYLINE DR
 HAWTHORNE, NY
 US 10532
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)