



# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**



Machine Id  
**KAESER SFC 75ST 1031**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (9 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0854631</b>	---	---
Sample Date	Client Info			<b>10 Oct 2023</b>	---	---
Machine Age	hrs	Client Info		<b>4984</b>	---	---
Oil Age	hrs	Client Info		<b>2800</b>	---	---
Oil Changed	Client Info			<b>Changed</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	---	---
Lead	ppm	ASTM D5185m	>10	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>50	<b>7</b>	---	---
Tin	ppm	ASTM D5185m	>10	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	90	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m	100	<b>13</b>	---	---
Calcium	ppm	ASTM D5185m	0	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m	0	<b>&lt;1</b>	---	---
Zinc	ppm	ASTM D5185m	0	<b>46</b>	---	---
Sulfur	ppm	ASTM D5185m	23500	<b>18763</b>	---	---



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m		<b>2</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.45</b>	---	---

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	---	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---







# OIL ANALYSIS REPORT

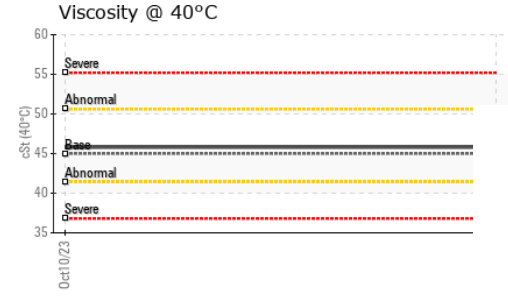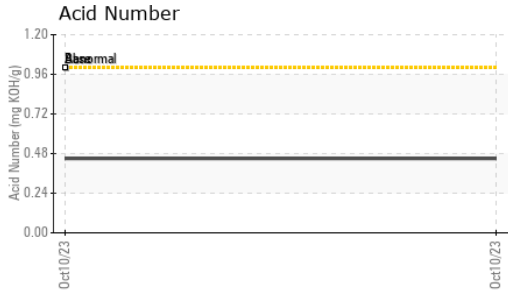

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	<b>45.8</b>	---	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color					no image	no image
Bottom					no image	no image

## GRAPHS

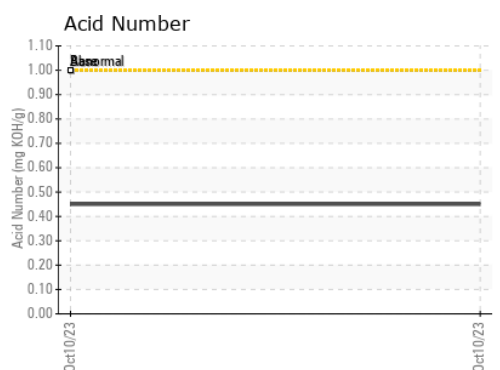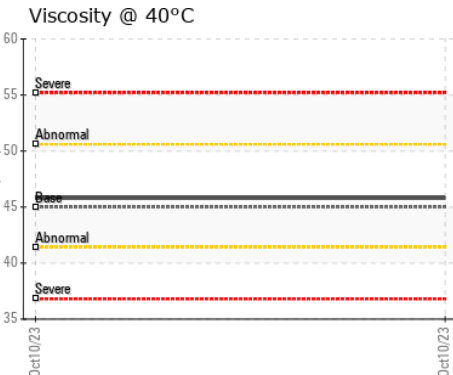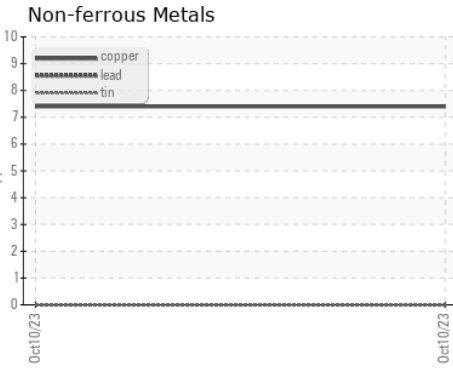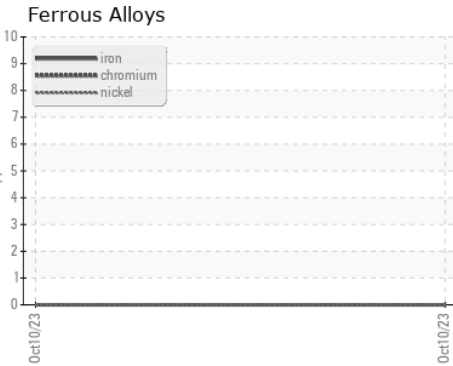

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0854631 **Received** : 18 Oct 2023  
**Lab Number** : **05982435** **Diagnosed** : 20 Oct 2023  
**Unique Number** : 10699730 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**ELEVATED INDUSTRIAL SOLUTIONS**  
 120 LAWTON AVE.  
 MONROE, OH  
 US 45050  
 Contact: ROBIN PRICHARD  
 r.prichard@compressedairtechnologies.com  
 T: (513)539-5155  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)