

## **OIL ANALYSIS REPORT**

### **KAESER S-460 [6856] KAESER 1184 - ISS FACILITY SERVICE - JOHN CRANE INC** Component

Compressor

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear


All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



SAMPLE INFORM	<b>IATION</b>	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH05982453	UCH05633074	UCH05485202
Sample Date		Client Info		10 Oct 2023	18 Aug 2022	17 Feb 2022
Machine Age	hrs	Client Info		24205	20746	19219
Oil Age	hrs	Client Info		4986	1527	2022
Oil Changed		Client Info		Changed	Not Changd	Changed
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	2
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	9	4	4
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2

Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	<1	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	1	40	36
Calcium	ppm	ASTM D5185m	2	0	0	<1
Phosphorus	ppm	ASTM D5185m		1	2	2
Zinc	ppm	ASTM D5185m		0	10	21
Sulfur	ppm	ASTM D5185m		16266	16497	16246
CONTAMINANTS	\$	method	limit/base	current	history1	history2

Silicon	ppm	ASTM D5185m	>25	0	<1	0
Sodium	ppm	ASTM D5185m		<1	8	9
Potassium	ppm	ASTM D5185m	>20	0	2	4


FLUID DEGRADA	ATION	method	limit/base	C
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.3

0.39 0.36 0.46 White Metal scalar \*Visual NONE NONE NONE NONE NONE Yellow Metal \*Visual NONE NONE NONE scalar Precipitate scalar \*Visual NONE NONE NONE NONE Silt \*Visual NONE NONE scalar NONE NONE Debris scalar \*Visual NONE NONE MODER VLITE Sand/Dirt scalar \*Visual NONE NONE NONE NONE Appearance \*Visual NORML NORML NORML NORML scalar NORML NORML NORML Odor scalar \*Visual NORML \*Visual **Emulsified Water** scalar >0.05 NEG NEG NEG CHANDLOFERRIS - UQDGLDOW scalar \*Visual NEG

ŧ



# **OIL ANALYSIS REPORT**

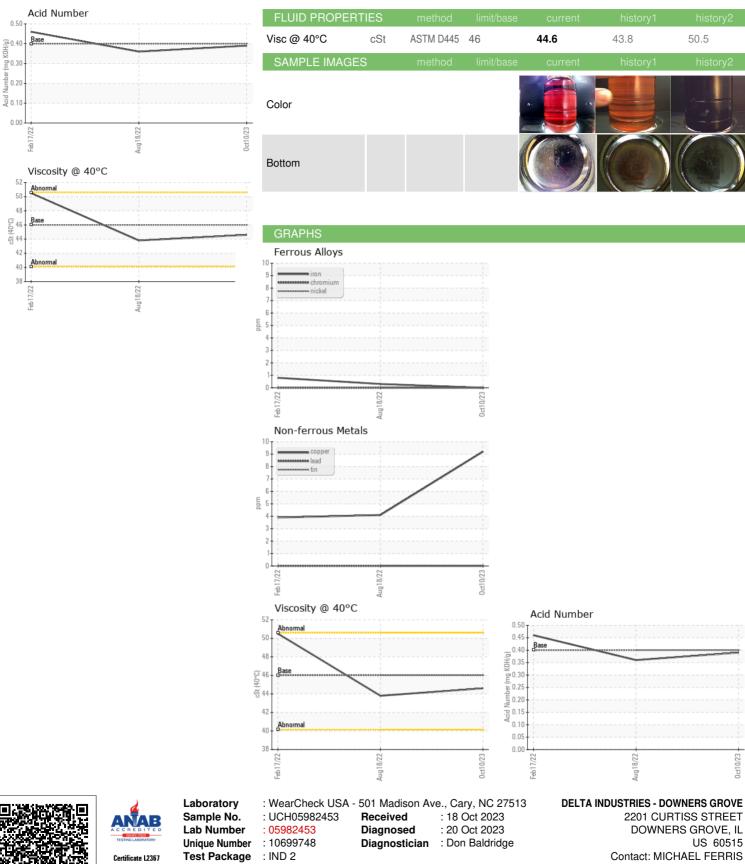

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: (630)960-3931

US 60515

2201 CURTISS STREET

Contact: MICHAEL FERRIS

DOWNERS GROVE, IL

Aug18/22 -

43.8

50.5