




PROBLEM SUMMARY

Sample Rating Trend


WEAR

Area
DPO [6815]
Machine Id
KAESER 1778 - STAMPEDE MEAT
Component
Compressor

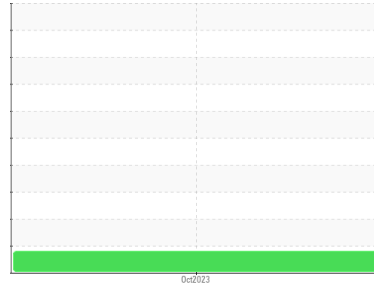

COMPONENT CONDITION SUMMARY

▲ Aluminum (ppm)

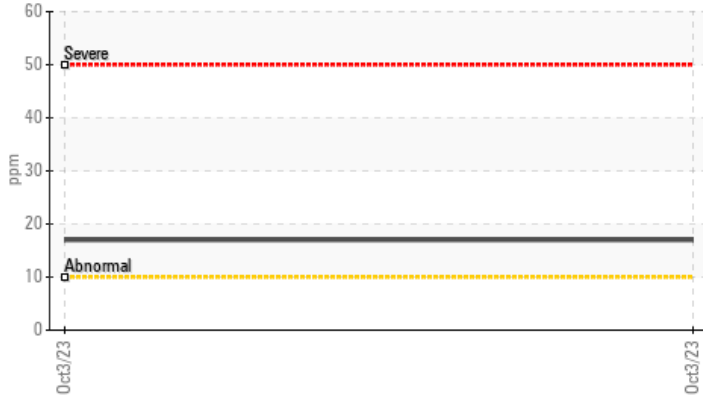

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ATTENTION	---	---
Aluminum	ppm	ASTM D5185m	>10	▲ 17	---	---

Customer Id: UCDEL DOW
Sample No.: UCH05982464
Lab Number: 05982464
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS




OIL ANALYSIS REPORT

Sample Rating Trend

WEAR

Area
DPO [6815]
Machine Id
KAESER 1778 - STAMPEDE MEAT
Component
Compressor

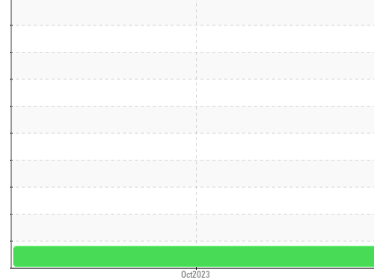

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

The aluminum level is abnormal. All other component wear rates are normal.

Contamination

There is a moderate amount of visible silt present in the sample.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		UCH05982464	---	---
Sample Date	Client Info		03 Oct 2023	---	---
Machine Age	hrs	Client Info	71311	---	---
Oil Age	hrs	Client Info	550	---	---
Oil Changed	Client Info		Changed	---	---
Sample Status			ATTENTION	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	---
Chromium	ppm	ASTM D5185m	>10	0	---
Nickel	ppm	ASTM D5185m	>3	0	---
Titanium	ppm	ASTM D5185m	>3	0	---
Silver	ppm	ASTM D5185m	>2	0	---
Aluminum	ppm	ASTM D5185m	>10	▲ 17	---
Lead	ppm	ASTM D5185m	>10	0	---
Copper	ppm	ASTM D5185m	>50	38	---
Tin	ppm	ASTM D5185m	>10	0	---
Vanadium	ppm	ASTM D5185m		0	---
Cadmium	ppm	ASTM D5185m		0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.1	0	---
Barium	ppm	ASTM D5185m	0.8	0	---
Molybdenum	ppm	ASTM D5185m	0	0	---
Manganese	ppm	ASTM D5185m	0.9	<1	---
Magnesium	ppm	ASTM D5185m	0	0	---
Calcium	ppm	ASTM D5185m	0	0	---
Phosphorus	ppm	ASTM D5185m	409	81	---
Zinc	ppm	ASTM D5185m	0	94	---
Sulfur	ppm	ASTM D5185m	1290	3427	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	---
Sodium	ppm	ASTM D5185m		2	---
Potassium	ppm	ASTM D5185m	>20	0	---

FLUID DEGRADATION




	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.537	0.31	---

VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	MODER	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---







OIL ANALYSIS REPORT

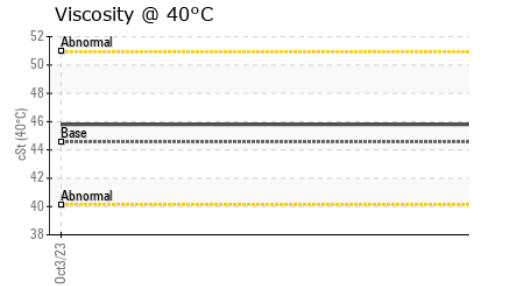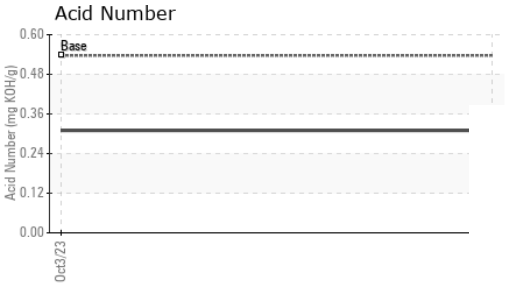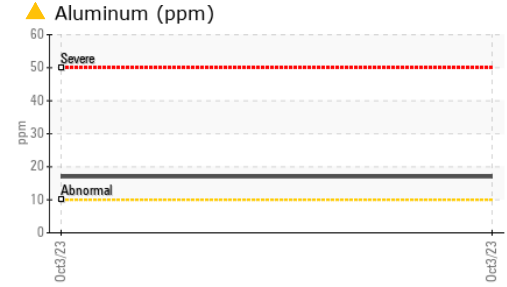

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	44.56	45.8	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

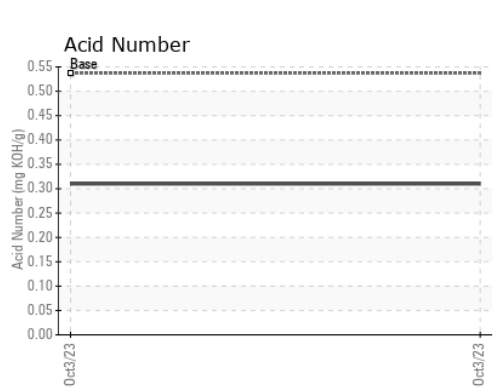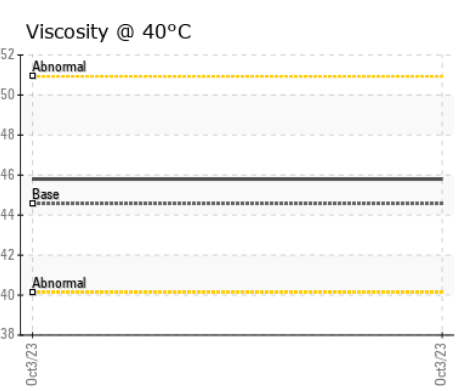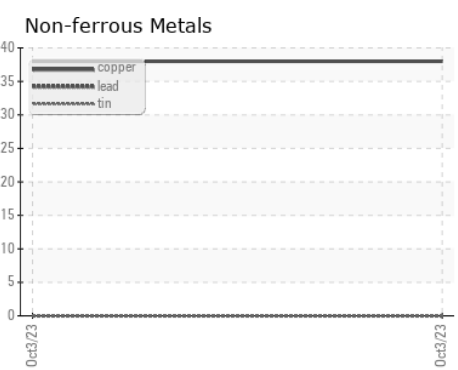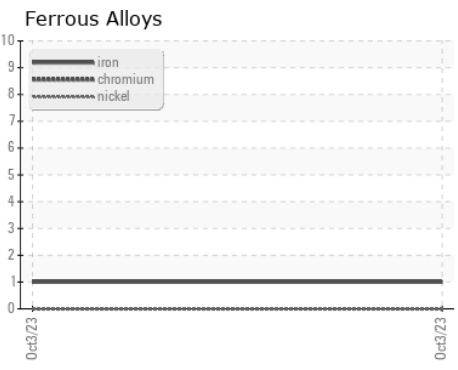

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCH05982464 **Received** : 18 Oct 2023
Lab Number : **05982464** **Diagnosed** : 20 Oct 2023
Unique Number : 10699759 **Diagnostician** : Don Baldrige
Test Package : IND 2

DELTA INDUSTRIES - DOWNERS GROVE
 2201 CURTISS STREET
 DOWNERS GROVE, IL
 US 60515
 Contact: MICHAEL FERRIS

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
 F: (630)960-3931