

## **OIL ANALYSIS REPORT**

Sample Rating Trend

## NORMAL

#### Area DF8 PLUS [6562] Machine Id KAESER 1002 - CORPLEX USA Component

Compressor

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.


### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Sep2022	0ct2023		
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH05982467	UCH05658629	
Sample Date		Client Info		02 Oct 2023	14 Sep 2022	
Machine Age	hrs	Client Info		14273	10077	
Oil Age	hrs	Client Info		3596	0	
Oil Changed		Client Info		Changed	N/A	
Sample Status				NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	2	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m		1	1	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1	0	0	
Barium	ppm	ASTM D5185m	0.3	0	0	
Volybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m	0	0	0	
Vagnesium	ppm	ASTM D5185m	0	0	0	
Calcium	ppm	ASTM D5185m	0.5	0	0	
Phosphorus	ppm	ASTM D5185m	536	78	302	
Zinc	ppm	ASTM D5185m	0.2	22	29	
Sulfur	ppm	ASTM D5185m	649	1527	1031	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		0	0	
Potassium	ppm	ASTM D5185m	>20	0	0	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.337	0.15	0.31	
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
Precipitate	scalar	*Visual	NONE	NONE	NONE	
Silt	scalar	*Visual	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	LIGHT	NONE	
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
Appearance	scalar	*Visual	NORML	NORML	NORML	
Odor	scalar	*Visual	NORML	NORML	NORML	
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	
Free Water	scalar	*Visual		NEG	NEG	
:11:09) Rev: 1			Cont	act/Location: MI	CHAEL FERRIS	- LICDEL DOV



# **OIL ANALYSIS REPORT**

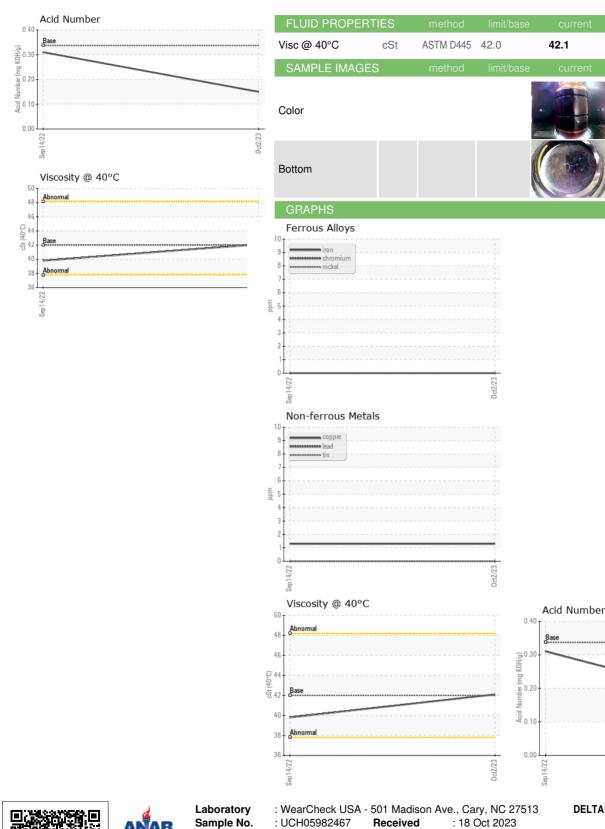

DELTA INDUSTRIES - DOWNERS GROVE 2201 CURTISS STREET DOWNERS GROVE, IL US 60515 Contact: MICHAEL FERRIS

Certificate 12367 Test Package : IND 2 To discuss this sample report, contact Customer Service at 1-800-237-1369.

: 05982467

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Diagnosed

: 20 Oct 2023

Diagnostician : Don Baldridge

T: F: (630)960-3931

Lab Number

Unique Number : 10699762

39.8

no image

no image