




# OIL ANALYSIS REPORT



Area  
**IRIG [6219515]**  
 Machine Id  
**IRIG-GENR-GN-1102 IRIG-GENR-GN-1102 RIG POWER MODULE-GEN SET #2**  
 Component  
**Genset**  
 Fluid  
**CHEVRON DELO 400 MULTIGRADE 15W40 (--- GAL)**

Sample Rating Trend

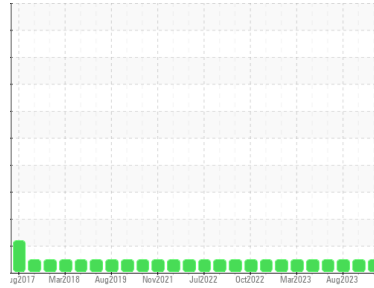

**NORMAL**



## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	<b>HLC0002833</b>	HLC0002740	HLC0002743	
Sample Date	Client Info	<b>22 Oct 2023</b>	06 Sep 2023	09 Aug 2023	
Machine Age	hrs	Client Info	<b>12535</b>	12048	11536
Oil Age	hrs	Client Info	<b>500</b>	500	500
Oil Changed	Client Info	<b>Changed</b>	Changed	N/A	
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL	

## CONTAMINATION

method	limit/base	current	history1	history2
Fuel	WC Method >4.0	<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >50	<b>23</b>	25	29
Chromium	ppm ASTM D5185m >4	<b>&lt;1</b>	<1	<1
Nickel	ppm ASTM D5185m >2	<b>&lt;1</b>	<1	<1
Titanium	ppm ASTM D5185m	<b>0</b>	<1	<1
Silver	ppm ASTM D5185m >5	<b>0</b>	0	0
Aluminum	ppm ASTM D5185m >12	<b>1</b>	3	<1
Lead	ppm ASTM D5185m >17	<b>&lt;1</b>	<1	<1
Copper	ppm ASTM D5185m >70	<b>1</b>	1	1
Tin	ppm ASTM D5185m >15	<b>0</b>	<1	0
Vanadium	ppm ASTM D5185m	<b>0</b>	<1	<1
Cadmium	ppm ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m 151	<b>59</b>	58	62
Barium	ppm ASTM D5185m 0.4	<b>0</b>	0	0
Molybdenum	ppm ASTM D5185m 250	<b>&lt;1</b>	<1	<1
Manganese	ppm ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm ASTM D5185m 0	<b>731</b>	716	849
Calcium	ppm ASTM D5185m 2046	<b>1376</b>	1337	1504
Phosphorus	ppm ASTM D5185m 1043	<b>773</b>	699	779
Zinc	ppm ASTM D5185m 943	<b>814</b>	824	920
Sulfur	ppm ASTM D5185m 5012	<b>2910</b>	3322	3889

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	<b>4</b>	4	4
Sodium	ppm ASTM D5185m	<b>3</b>	2	2
Potassium	ppm ASTM D5185m >20	<b>4</b>	3	4



## INFRA-RED

method	limit/base	current	history1	history2
Soot %	% *ASTM D7844	<b>0.7</b>	0.1	0.7
Nitration	Abs/cm *ASTM D7624 >20	<b>9.1</b>	9.7	8.8
Sulfation	Abs/.1mm *ASTM D7415 >30	<b>19.7</b>	22.6	19.0

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414 >25	<b>14.2</b>	15.0	13.4
Base Number (BN)	mg KOH/g ASTM D2896 12.5	<b>9.36</b>	9.21	9.29





# OIL ANALYSIS REPORT

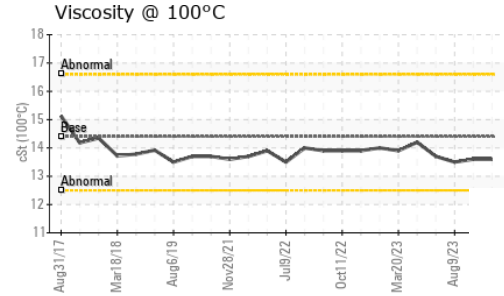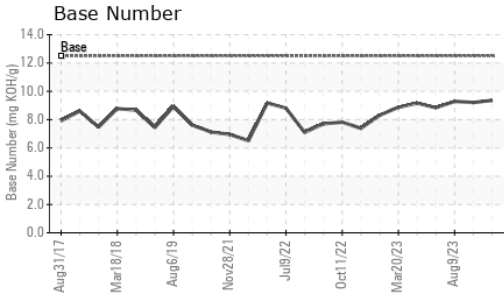

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.4	<b>13.6</b>	13.6	13.5

## GRAPHS

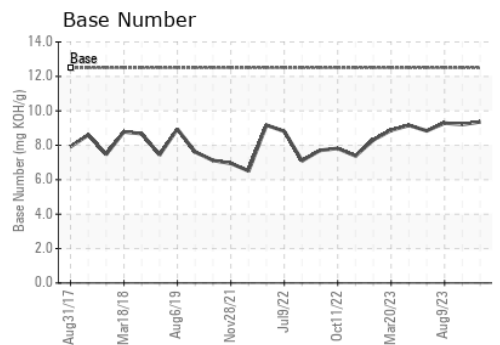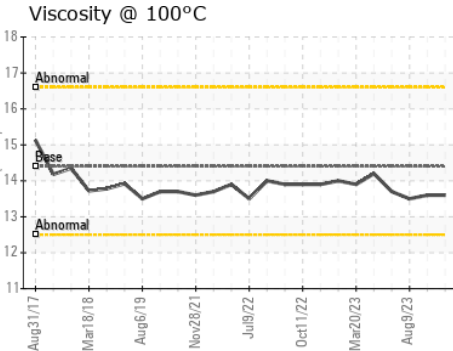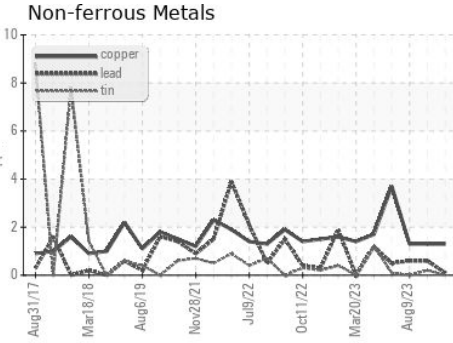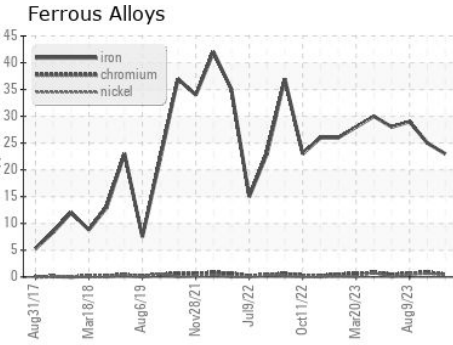

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : HLC0002833 **Received** : 30 Oct 2023  
**Lab Number** : **05993790** **Diagnosed** : 01 Nov 2023  
**Unique Number** : 10722150 **Diagnostician** : Sean Felton  
**Test Package** : IND 2

**HILCORP EXPLORATION ALASKA - MILN POINT**  
 1000 MILN POINT RD  
 PRUDOE BAY, AK  
 US 99734  
 Contact: Evan Reilly  
 evan.reilly@hilcorp.com  
 T: (907)670-3231  
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)