

FUEL REPORT

Sample Rating Trend

NORMAL

KIOTI SK3510 SK3510 (S/N NOT GIVEN)

Diesel Fuel

NOT GIVEN (--- GAL)

Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.


Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

				Oct2023		
OAMBLE INCORN	ATION				11.4	1::
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KT0000607		
Sample Date		Client Info		23 Oct 2023		
Machine Age	hrs	Client Info		449		
Sample Status				NORMAL		
PHYSICAL PROP	ERTIES	method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298		0.836		
Fuel Color	text	*Visual Screen		Yllow		
ASTM Color	scalar	*ASTM D1500		L1.5		
Visc @ 40°C	cSt	ASTM D445		2.59		
Pensky-Martens Flash Point	°C	*PMCC Calculated		57		
SULFUR CONTENT m		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		12		
Sulfur (UVF)	ppm	ASTM D5453		10		
DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86		160		
5% Distillation Point	°C	ASTM D86		187		
10% Distill Point	°C	ASTM D86		198		
15% Distillation Point	°C	ASTM D86		209		
20% Distill Point	°C	ASTM D86		217		
30% Distill Point	°C	ASTM D86		234		
40% Distill Point	°C	ASTM D86		247		
50% Distill Point	°C	ASTM D86		261		
60% Distill Point	°C	ASTM D86		275		
70% Distill Point	°C	ASTM D86		291		
80% Distill Point	°C	ASTM D86		308		
85% Distillation Point	°C	ASTM D86		319		
90% Distill Point	°C	ASTM D86		331		
95% Distillation Point	°C	ASTM D86		350		
Final Boiling Point	°C	ASTM D86		359		
Distillation Residue	%	ASTM D86		1.4		
Distillation Loss	%	ASTM D86		0.7		
IGNITION QUALIT	ΓΥ	method	limit/base	current	history1	history2
API Gravity		ASTM D7777		37.8		
Cetane Index		ASTM D4737	<40.0	50.1		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0		
Sodium	ppm	ASTM D5185m	<0.1	2		
Potassium	ppm	ASTM D5185m	<0.1	0		
Water	%	ASTM D6304	< 0.05	0.002		
ppm Water	ppm	ASTM D6304	<500	24.8		
% Gasoline	%	*In-House	< 0.50	0.0		
% Biodiesel	%	*In-House	<20.0	0.0		
- -						



FUEL REPORT

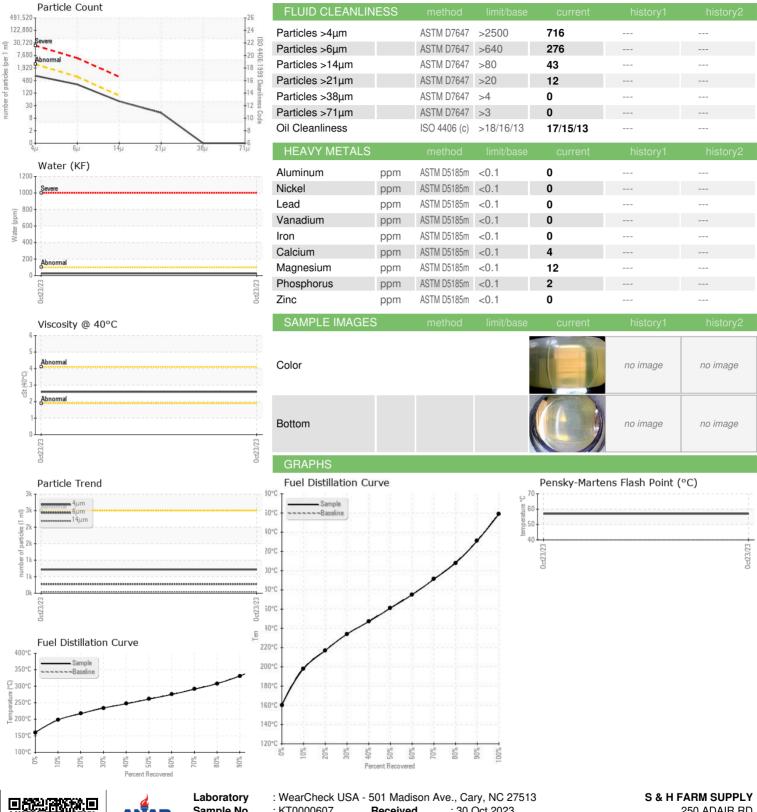



Certificate L2367

Sample No. Lab Number Unique Number

: KT0000607 : 05993924 : 10722284

Received : 30 Oct 2023 : 03 Nov 2023 Diagnosed

Diagnostician : Doug Bogart Test Package : DF-2 (Additional Tests: Screen)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

250 ADAIR RD

BRANSON, MO US 65616

Contact: JOSH PRIEST josh.priest@shfarmsupply.com

T:

F: