



# PROBLEM SUMMARY

Sample Rating Trend

ISO

Area

**Ryan**

Machine Id


**RYN06 Generator Thrust / Guide Bearing (S/N 695330)**

Component

**Reservoir Journal Bearing**


Fluid

**CONOCO TURBINE OIL 68 (30 GAL)**

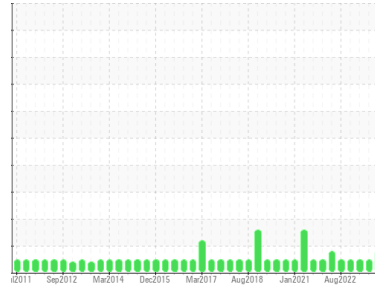

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

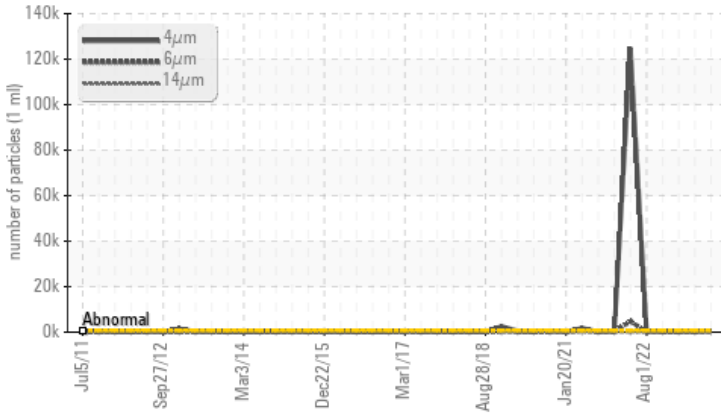

## RECOMMENDATION

Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	NORMAL	NORMAL
Particles >6µm	ASTM D7647	>160	▲ 186	77	110
Oil Cleanliness	ISO 4406 (c)	>16/14/12	▲ 16/15/12	15/13/10	15/14/10

Customer Id: PPLBUT  
 Sample No.: WC0757835  
 Lab Number: 05994342  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Angela Borella +1 800-237-1369  
[angela.borella@wearcheckusa.com](mailto:angela.borella@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 01 May 2023 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 18 Jan 2023 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 27 Oct 2022 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the sample. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the sample is suitable for further service.

view report






# OIL ANALYSIS REPORT

Sample Rating Trend

ISO

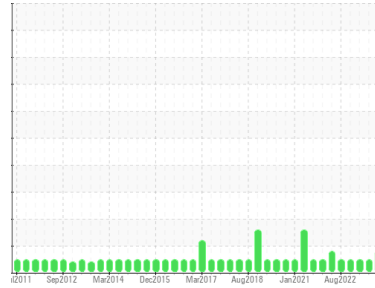

Area

**Ryan**

Machine Id

**RYN06 Generator Thrust / Guide Bearing (S/N 695330)**

Component

**Reservoir Journal Bearing**

Fluid

**CONOCO TURBINE OIL 68 (30 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0757835</b>	WC0757818	WC0536016
Sample Date	Client Info	<b>17 Oct 2023</b>	01 May 2023	18 Jan 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>ATTENTION</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >60	<1	<1	<1
Chromium	ppm	ASTM D5185m >20	<1	0	0
Nickel	ppm	ASTM D5185m >20	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >4	<1	0	0
Lead	ppm	ASTM D5185m >250	0	<1	0
Copper	ppm	ASTM D5185m >125	<1	0	0
Tin	ppm	ASTM D5185m >80	<1	<1	<1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	19	0	1
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m	0	<1	<1
Calcium	ppm	ASTM D5185m	0	0	0
Phosphorus	ppm	ASTM D5185m	56	26	31
Zinc	ppm	ASTM D5185m	22	<1	4
Sulfur	ppm	ASTM D5185m	0	0	0

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >50	1	1	1
Sodium	ppm	ASTM D5185m	3	0	0
Potassium	ppm	ASTM D5185m >20	0	<1	<1





## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >640	<b>636</b>	279	292
Particles >6µm	ASTM D7647 >160	<b>▲ 186</b>	77	110
Particles >14µm	ASTM D7647 >40	<b>21</b>	8	10
Particles >21µm	ASTM D7647 >10	<b>5</b>	2	3
Particles >38µm	ASTM D7647 >3	<b>0</b>	0	1
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >16/14/12	<b>▲ 16/15/12</b>	15/13/10	15/14/10

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.08	<b>0.12</b>	0.13	0.13

# OIL ANALYSIS REPORT


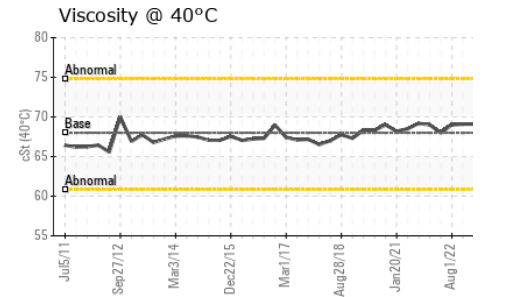
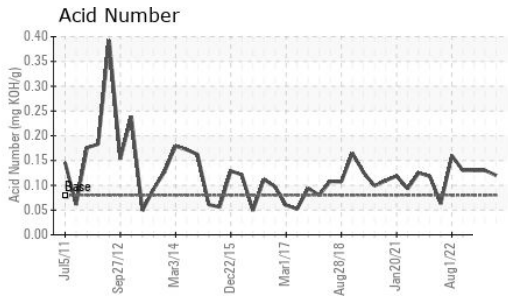
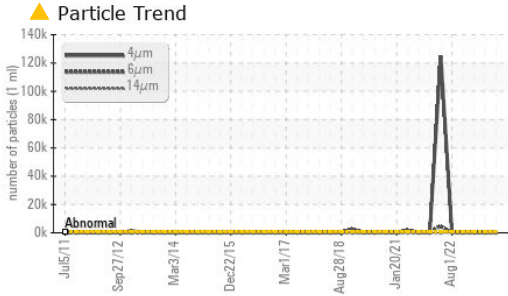
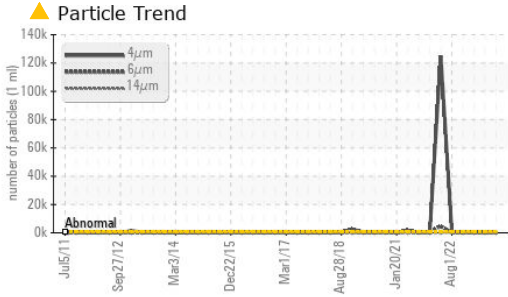


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 68	69.4	68.7	69.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

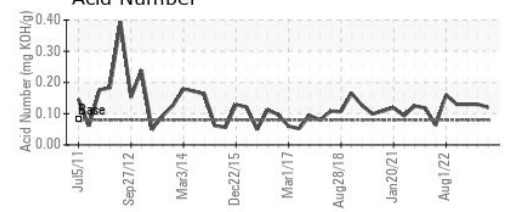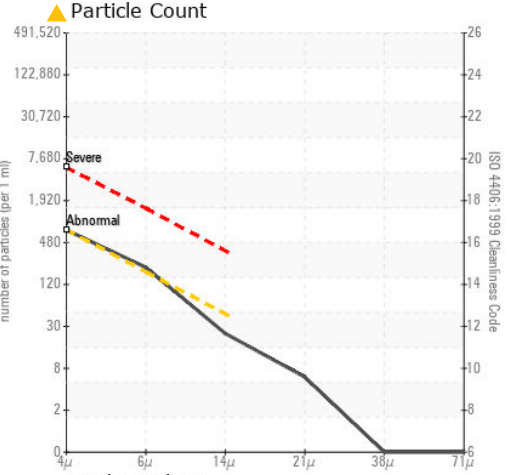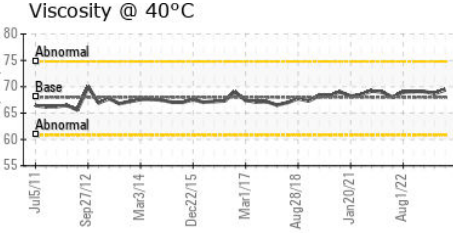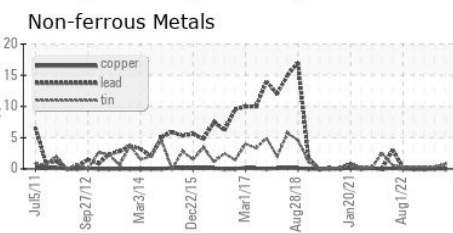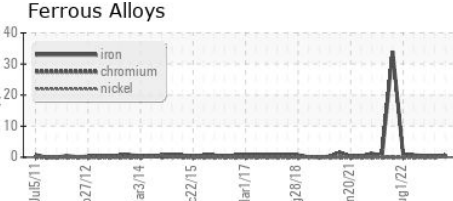

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0757835 **Received** : 31 Oct 2023  
**Lab Number** : 05994342 **Diagnosed** : 01 Nov 2023  
**Unique Number** : 10722702 **Diagnostician** : Angela Borella  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**NORTHWESTERN ENERGY**  
 6700 RAINBOW DAM RD  
 GREAT FALLS, MT  
 US 59404  
 Contact: STANLEY BOGNATZ  
 srb@mbesi.com  
 T: (570)575-9252  
 F: (570)227-0014

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)