


# PROBLEM SUMMARY

Sample Rating Trend




ISO

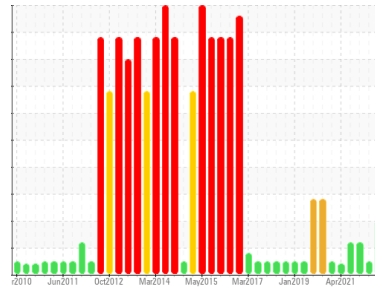

Area  
**TM 11**  
Machine Id  
**TM 11 YANKEE HOOD FANS**  
Component  
**Lube System**  
Fluid  
**AW HYDRAULIC OIL ISO 68 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

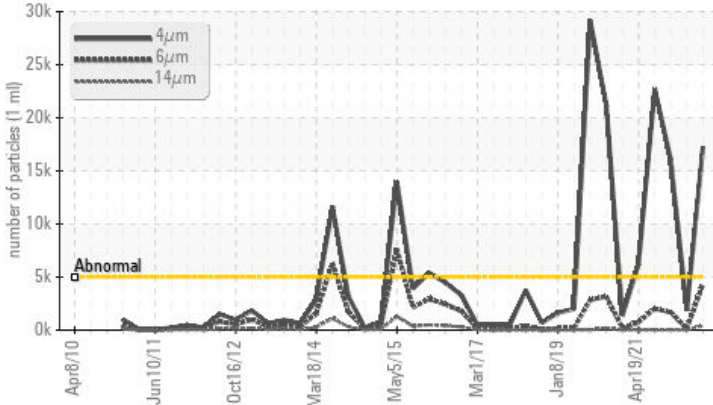

## RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	NORMAL	SEVERE
Particles >4µm	ASTM D7647	>5000	▲ 17271	1861	● 16090
Particles >6µm	ASTM D7647	>1300	▲ 4339	141	▲ 1682
Particles >14µm	ASTM D7647	>160	▲ 406	7	39
Particles >21µm	ASTM D7647	>40	▲ 110	2	6
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 21/19/16	18/14/10	● 21/18/12

Customer Id: KIMMOBTM11  
Sample No.: RP0034373  
Lab Number: 05994355  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

05 May 2023 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



30 Mar 2022 Diag: Doug Bogart

ISO



We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



08 Oct 2021 Diag: Doug Bogart

ISO



We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

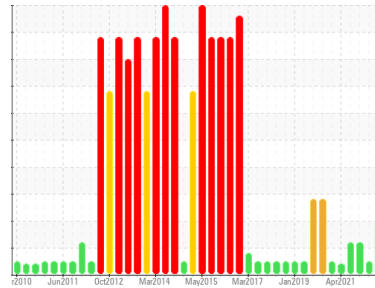

ISO



Area  
**TM 11**  
 Machine Id  
**TM 11 YANKEE HOOD FANS**  
 Component  
**Lube System**  
 Fluid  
**AW HYDRAULIC OIL ISO 68 (--- GAL)**

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>RP0034373</b>	RP0023582	RP0016700
Sample Date	Client Info		<b>09 Aug 2023</b>	05 May 2023	30 Mar 2022
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	NORMAL	SEVERE

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		<b>15</b>	11	---
Iron	ppm	ASTM D5185m >20	<b>2</b>	1	2
Chromium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m >20	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185m >20	<b>2</b>	<1	2
Copper	ppm	ASTM D5185m >20	<b>30</b>	25	30
Tin	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m	<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	<b>0</b>	0	3
Barium	ppm	ASTM D5185m 5	<b>20</b>	0	0
Molybdenum	ppm	ASTM D5185m 5	<b>&lt;1</b>	<1	<1
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m 25	<b>33</b>	30	23
Calcium	ppm	ASTM D5185m 200	<b>34</b>	39	42
Phosphorus	ppm	ASTM D5185m 300	<b>297</b>	287	306
Zinc	ppm	ASTM D5185m 370	<b>318</b>	317	335

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>3</b>	<1	<1
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	0
Water	%	ASTM D6304 >0.05	<b>0.006</b>	0.005	0.002
ppm Water	ppm	ASTM D6304 >500	<b>68.5</b>	52.3	22.3

## FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	<b>▲ 17271</b>	1861	● 16090
Particles >6µm	ASTM D7647	>1300	<b>▲ 4339</b>	141	▲ 1682
Particles >14µm	ASTM D7647	>160	<b>▲ 406</b>	7	39
Particles >21µm	ASTM D7647	>40	<b>▲ 110</b>	2	6
Particles >38µm	ASTM D7647	>10	<b>5</b>	0	0
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>▲ 21/19/16</b>	18/14/10	● 21/18/12

## FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.57	<b>0.42</b>	0.41	0.35

# OIL ANALYSIS REPORT


## ▲ Particle Trend

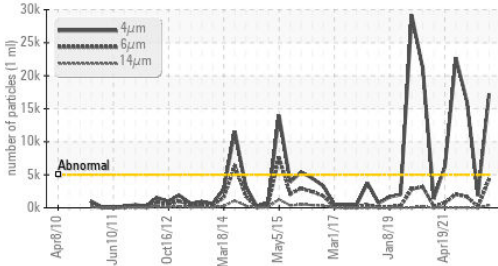


## Water (KF)

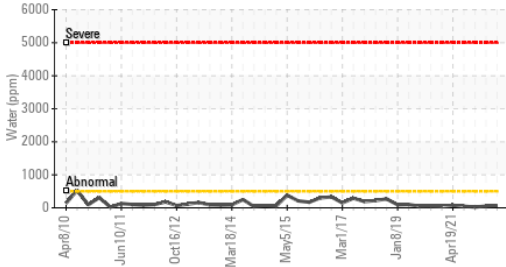


## PQ

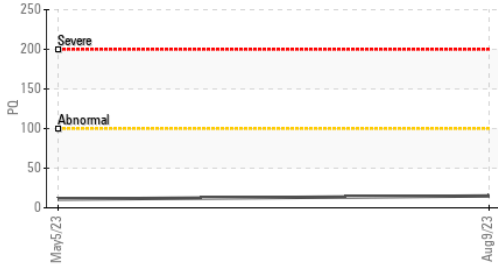

## Water (KF)

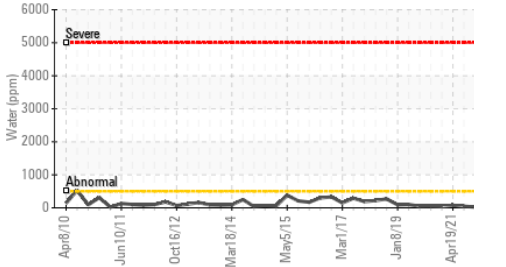

## Viscosity @ 40°C

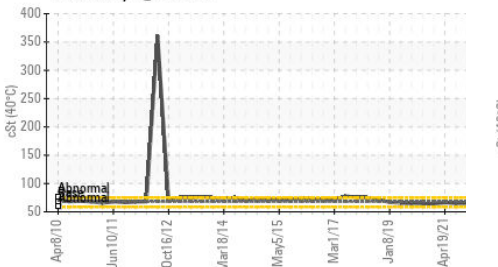

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 68	63.5	65.2	64.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




## GRAPHS


### Ferrous Alloys

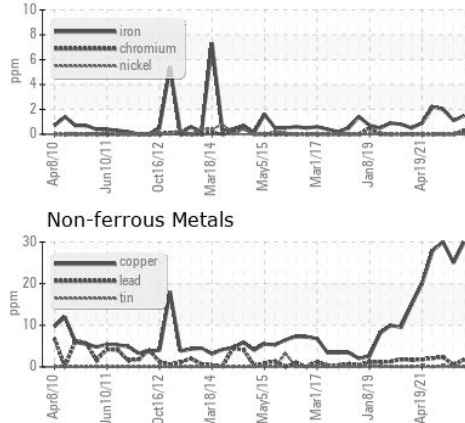


### Non-ferrous Metals

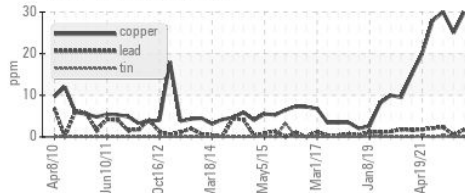


### Viscosity @ 40°C

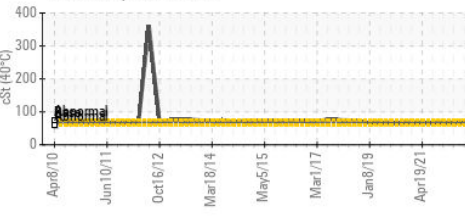

### ▲ Particle Count

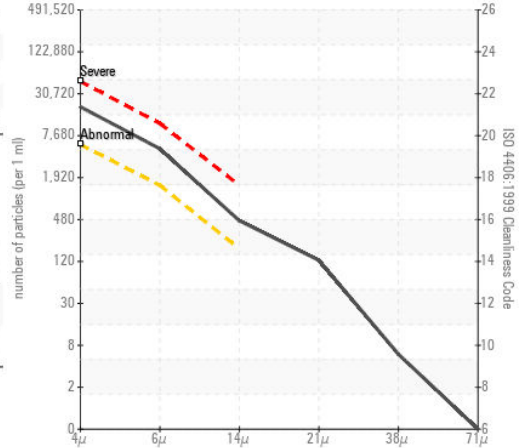

### Acid Number

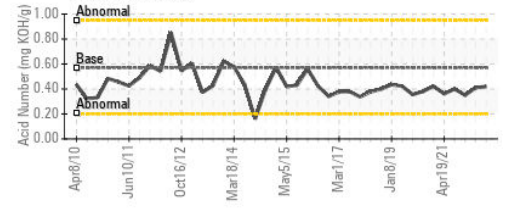

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0034373 **Received** : 31 Oct 2023  
**Lab Number** : 05994355 **Diagnosed** : 01 Nov 2023  
**Unique Number** : 10722715 **Diagnostician** : Don Baldrige

**Kimberly-Clark - Mobile - TM 11**  
 200 BAYBRIDGE RD  
 MOBILE, AL  
 US 36610  
 Contact: LARRY WEAVER  
 Larry.D.Weaver@kcc.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (251)452-6335