

PROBLEM SUMMARY

KAESER 8263046


Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

Sample Rating Trend ISO Sp.023

COMPONENT CONDITION SUMMARY

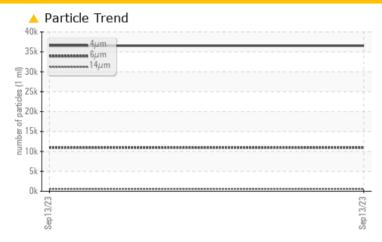

RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

| PROBLEMATIC TEST RESULTS | | | | | | | | |
|--------------------------|--------------|---------|-----------------|--|--|--|--|--|
| Sample Status | | | ABNORMAL | | | | | |
| Particles >6μm | ASTM D7647 | >1300 | <u> </u> | | | | | |
| Particles >14µm | ASTM D7647 | >80 | ▲ 568 | | | | | |
| Particles >21µm | ASTM D7647 | >20 | <u> </u> | | | | | |
| Particles >38µm | ASTM D7647 | >4 | <u> </u> | | | | | |
| Oil Cleanliness | ISO 4406 (c) | >/17/13 | <u>22/21/16</u> | | | | | |

Customer Id: PARHUNCA Sample No.: KCP40072D Lab Number: 05994366 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Angela Borella +1 800-237-1369 angela.borella@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

| RECOMMENDED ACTIONS | | | | | | | |
|---------------------|--------|------|---------|---|--|--|--|
| Action | Status | Date | Done By | Description | | | |
| Change Fluid | | | ? | Oil and filter change at the time of sampling has been noted. | | | |
| Change Filter | | | ? | Oil and filter change at the time of sampling has been noted. | | | |

HISTORICAL DIAGNOSIS




OIL ANALYSIS REPORT

KAESER 8263046

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)



DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

| | | | | Sep.2023 | | |
|----------------------|------------|---------------|----------------|-------------------|----------|----------|
| SAMPLE INFORM | MATION | method | limit/base | current | history1 | history2 |
| Sample Number | | Client Info | | KCP40072D | | |
| Sample Date | | Client Info | | 13 Sep 2023 | | |
| Machine Age | hrs | Client Info | | 6047 | | |
| Oil Age | hrs | Client Info | | 0 | | |
| Oil Changed | | Client Info | | Changed | | |
| Sample Status | | | | ABNORMAL | | |
| WEAR METALS | | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >50 | <1 | | |
| Chromium | ppm | ASTM D5185m | >10 | <1 | | |
| Nickel | ppm | ASTM D5185m | >3 | 0 | | |
| Titanium | ppm | ASTM D5185m | >3 | 0 | | |
| Silver | ppm | ASTM D5185m | >2 | 0 | | |
| Aluminum | ppm | ASTM D5185m | >10 | <1 | | |
| Lead | ppm | ASTM D5185m | >10 | 0 | | |
| Copper | ppm | ASTM D5185m | >50 | 10 | | |
| Tin | ppm | ASTM D5185m | >10 | <1 | | |
| Vanadium | ppm | ASTM D5185m | | 0 | | |
| Cadmium | ppm | ASTM D5185m | | 0 | | |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | 0 | 0 | | |
| Barium | ppm | ASTM D5185m | 90 | 20 | | |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | | |
| Manganese | ppm | ASTM D5185m | | <1 | | |
| Magnesium | ppm | ASTM D5185m | 100 | 9 | | |
| Calcium | ppm | ASTM D5185m | 0 | 0 | | |
| Phosphorus | ppm | ASTM D5185m | 0 | 45 | | |
| Zinc | ppm | ASTM D5185m | 0 | 71 | | |
| Sulfur | ppm | ASTM D5185m | 23500 | 23085 | | |
| CONTAMINANTS | 6 | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >25 | 2 | | |
| Sodium | ppm | ASTM D5185m | <i>></i> 25 | 5 | | |
| Potassium | ppm | ASTM D5185m | >20 | 0 | | |
| Water | % | ASTM D6304 | >0.05 | 0.009 | | |
| ppm Water | ppm | ASTM D6304 | | 91.7 | | |
| FLUID CLEANLIN | | method | limit/base | current | history1 | history2 |
| Particles >4µm | | ASTM D7647 | | 36542 | | |
| Particles >6μm | | ASTM D7647 | >1300 | △ 10955 | | |
| Particles >14µm | | ASTM D7647 | >80 | <u>▲</u> 568 | | |
| Particles >21µm | | ASTM D7647 | | △ 143 | | |
| Particles >38µm | | ASTM D7647 | >4 | <u> </u> | | |
| Particles >71µm | | ASTM D7647 | | 1 | | |
| Oil Cleanliness | | ISO 4406 (c) | >/17/13 | <u>^</u> 22/21/16 | | |
| FLUID DEGRADA | ATION | method | limit/base | current | history1 | history2 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 1.0 | 0.39 | | |
| ACIO INUITIDEI (AIN) | iliy NOH/ÿ | 49 LINI D0049 | 1.0 | 0.33 | | |



OIL ANALYSIS REPORT

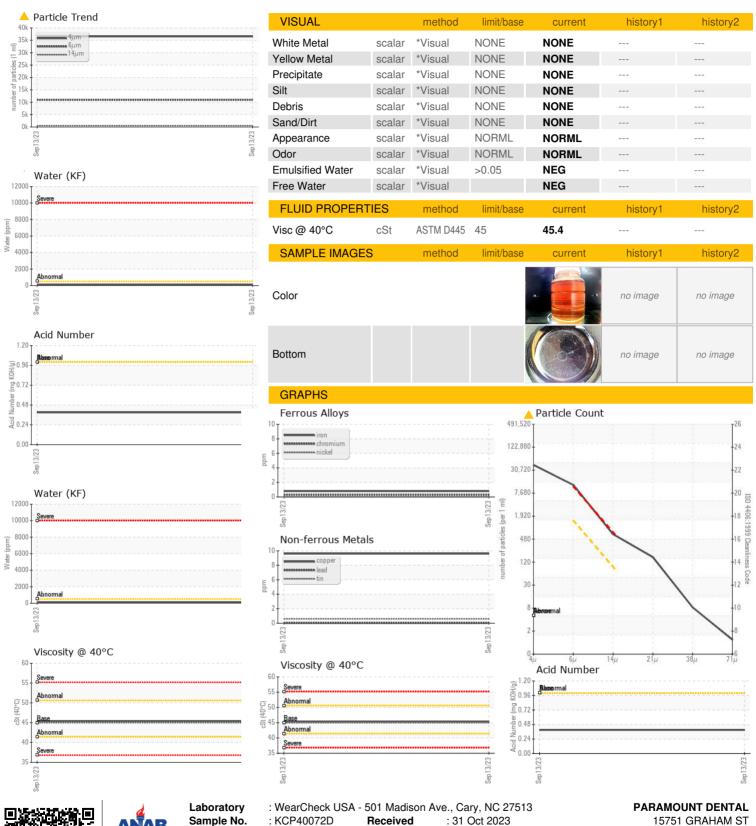



Certificate L2367

Sample No. Lab Number **Unique Number**

: KCP40072D : 05994366

: 10722726

Received Diagnosed

: 01 Nov 2023 Diagnostician : Angela Borella

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

15751 GRAHAM ST HUNTINGTON BEACH, CA

US 92649

Contact: Service Manager