PROBLEM SUMMARY

Sample Rating Trend

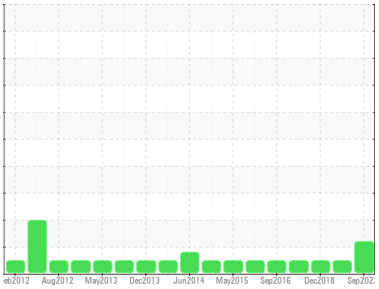

ISO

Machine Id
KAESER DSD 250 4025089 (S/N 1035)
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

COMPONENT CONDITION SUMMARY

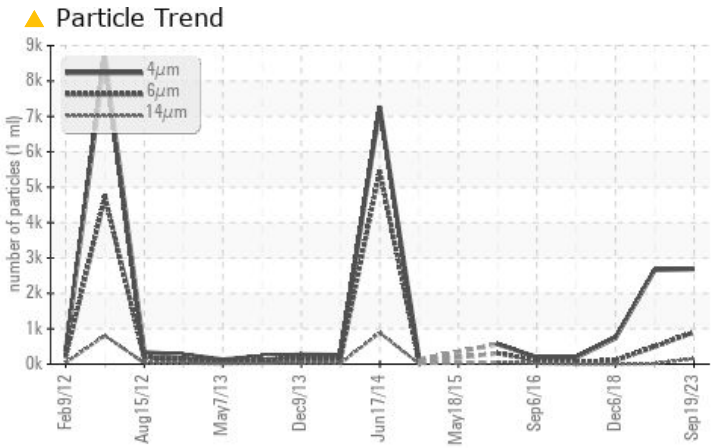

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				**ATTENTION**	NORMAL	NORMAL
Particles >14µm		ASTM D7647	>80	▲ **153**	17	5
Particles >21µm		ASTM D7647	>20	▲ **56**	8	3
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ **19/17/14**	16/11	14/10

Customer Id: HAAOXN
Sample No.: KCPA003657
Lab Number: 05994400
Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldridge +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

27 Feb 2020 Diag: Don Baldridge

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

06 Dec 2018 Diag: Jonathan Hester

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

06 Jun 2018 Diag: Angela Borella

NORMAL

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Sample Rating Trend

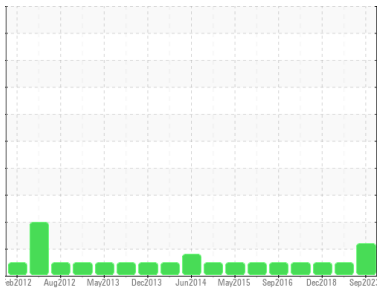

ISO

Machine Id
KAESER DSD 250 4025089 (S/N 1035)
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation
No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is a moderate amount of particulates present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**KCPA003657**	KCP07309	KCP13144
Sample Date		Client Info		**19 Sep 2023**	27 Feb 2020	06 Dec 2018
Machine Age	hrs	Client Info		**75015**	58178	49406
Oil Age	hrs	Client Info		**0**	7772	10002
Oil Changed		Client Info		**N/A**	Changed	Changed
Sample Status				**ATTENTION**	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**0**	0	0
Chromium	ppm	ASTM D5185m	>10	**<1**	0	<1
Nickel	ppm	ASTM D5185m	>3	**0**	0	0
Titanium	ppm	ASTM D5185m	>3	**0**	0	<1
Silver	ppm	ASTM D5185m	>2	**0**	<1	<1
Aluminum	ppm	ASTM D5185m	>10	**<1**	0	<1
Lead	ppm	ASTM D5185m	>10	**0**	0	0
Copper	ppm	ASTM D5185m	>50	**13**	6	5
Tin	ppm	ASTM D5185m	>10	**<1**	0	<1
Antimony	ppm	ASTM D5185m		**---**	<1	0
Vanadium	ppm	ASTM D5185m		**0**	0	<1
Cadmium	ppm	ASTM D5185m		**0**	0	<1

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**0**	<1	2
Barium	ppm	ASTM D5185m	90	**20**	0	0
Molybdenum	ppm	ASTM D5185m		**0**	0	<1
Manganese	ppm	ASTM D5185m		**0**	0	0
Magnesium	ppm	ASTM D5185m	90	**<1**	0	0
Calcium	ppm	ASTM D5185m	2	**0**	<1	9
Phosphorus	ppm	ASTM D5185m		**36**	7	0
Zinc	ppm	ASTM D5185m		**20**	0	0
Sulfur	ppm	ASTM D5185m		**21715**	10833	11271

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**0**	4	0
Sodium	ppm	ASTM D5185m		**4**	0	0
Potassium	ppm	ASTM D5185m	>20	**0**	<1	0
Water	%	ASTM D6304	>0.05	**0.006**	0.004	0.004
ppm Water	ppm	ASTM D6304	>500	**62.9**	47.5	40

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		**2686**	2663	735
Particles >6µm		ASTM D7647	>1300	**904**	496	109
Particles >14µm		ASTM D7647	>80	▲ **153**	17	5
Particles >21µm		ASTM D7647	>20	▲ **56**	8	3
Particles >38µm		ASTM D7647	>4	**3**	0	1
Particles >71µm		ASTM D7647	>3	**0**	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ **19/17/14**	16/11	14/10

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	**0.49**	0.584	0.518

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Particle Trend

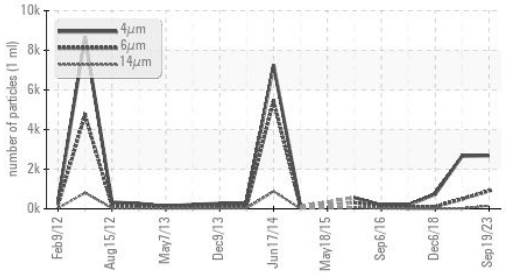

Water (KF)

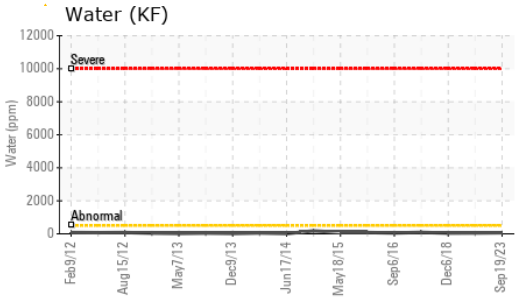

Acid Number

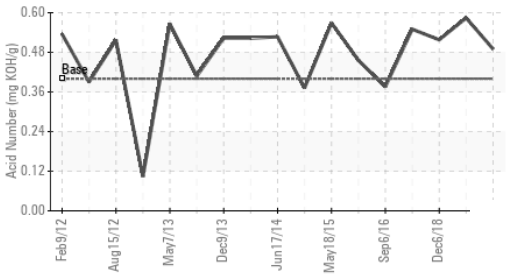

Water (KF)

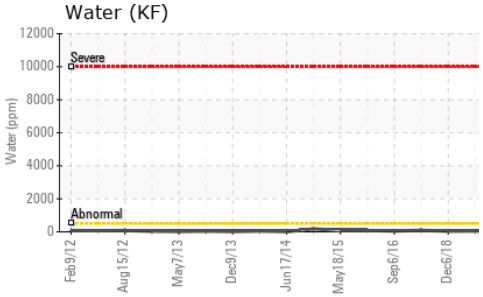

Viscosity @ 40°C

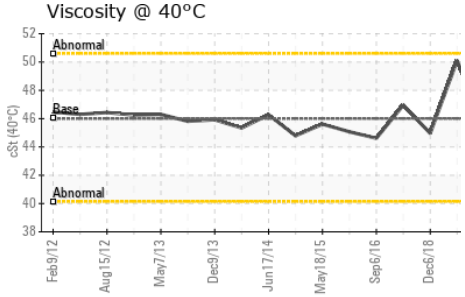

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	**45.6**	50.1	44.96

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

Ferrous Alloys

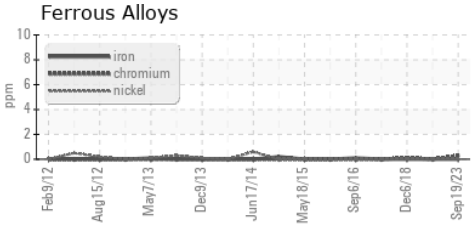

Non-ferrous Metals

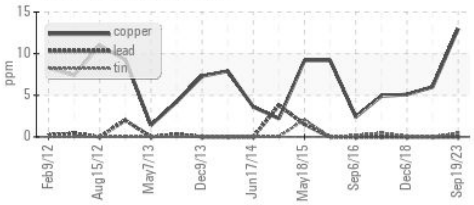

Viscosity @ 40°C

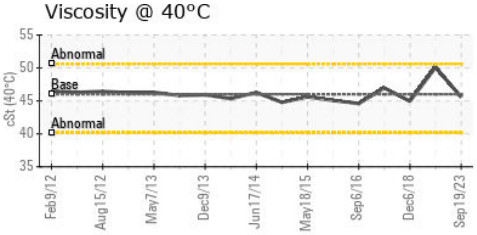

Particle Count

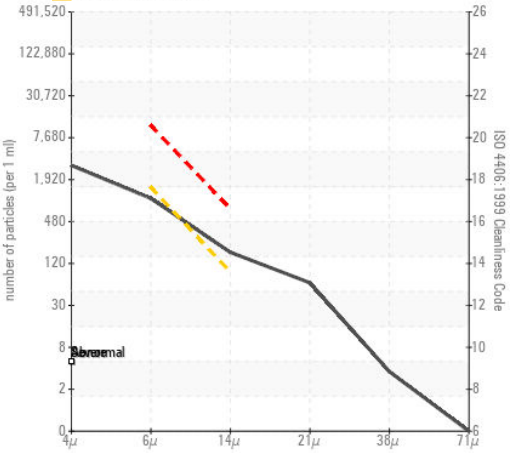

Acid Number

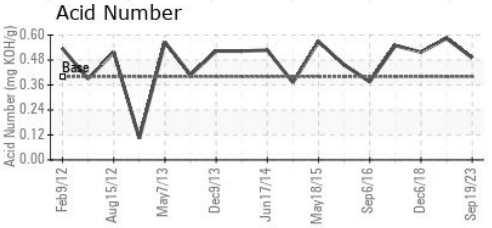

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA003657 **Received** : 31 Oct 2023
Lab Number : 05994400 **Diagnosed** : 02 Nov 2023
Unique Number : 10722760 **Diagnostician** : Don Baldridge
Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

HAAS AUTOMATION
2800 STURGIS RD
OXNARD, CA
US 93033
Contact:
T:
F: