


PROBLEM SUMMARY

Sample Rating Trend



ISO

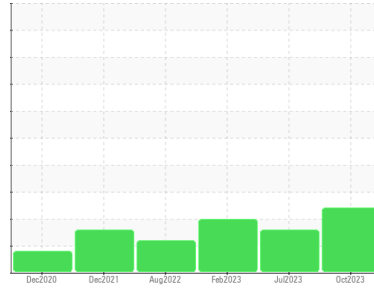


Machine Id
6893557 (S/N 1532)

Component
Compressor

Fluid
KAESER SIGMA (OEM) FG-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

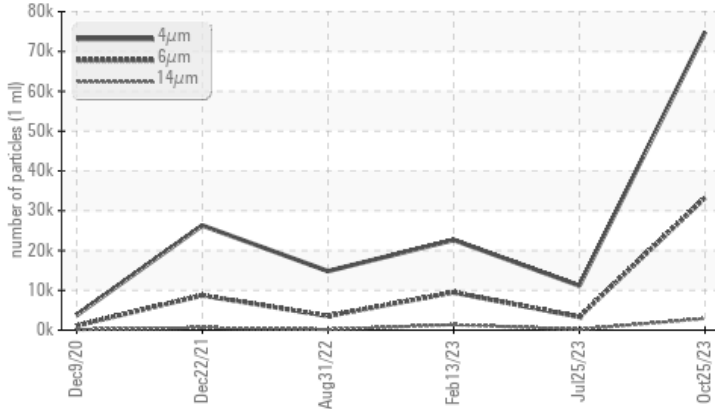

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status	ASTM D7647	ISO 4406 (c)	ABNORMAL	ABNORMAL	ABNORMAL
Particles >6µm	>1300	▲ 33251	▲ 3342	▲ 9482	
Particles >14µm	>80	▲ 2921	▲ 190	▲ 1377	
Particles >21µm	>20	▲ 728	▲ 43	▲ 325	
Particles >38µm	>4	▲ 27	2	▲ 20	
Particles >71µm	>3	▲ 3	0	1	
Oil Cleanliness	>--/17/13	▲ 23/22/19	▲ 21/19/15	▲ 22/20/18	

Customer Id: NICLOG
Sample No.: KC108004
Lab Number: 05994405
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

25 Jul 2023 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



13 Feb 2023 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



31 Aug 2022 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

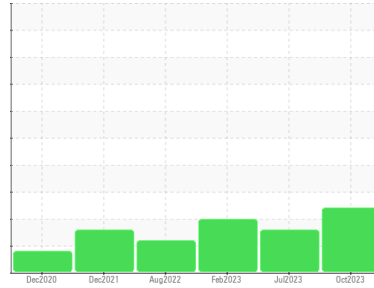

Machine Id
6893557 (S/N 1532)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) FG-460 (--- GAL)

DIAGNOSIS

Recommendation
 We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a high amount of particulates present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KC108004	KC101623	KC94576
Sample Date	Client Info			25 Oct 2023	25 Jul 2023	13 Feb 2023
Machine Age	hrs Client Info			16963	15709	13332
Oil Age	hrs Client Info			1254	2377	2293
Oil Changed	Client Info			Not Chngd	Changed	Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	<1	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	4	3
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	7	3	9
Tin	ppm	ASTM D5185m	>10	<1	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		20	2	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m		2	<1	<1
Calcium	ppm	ASTM D5185m		<1	0	2
Phosphorus	ppm	ASTM D5185m	500	212	84	173
Zinc	ppm	ASTM D5185m		135	83	136

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	<1
Sodium	ppm	ASTM D5185m		5	0	0
Potassium	ppm	ASTM D5185m	>20	0	<1	<1
Water	%	ASTM D6304	>0.05	0.002	0.002	0.023
ppm Water	ppm	ASTM D6304	>500	18.1	22.2	233.6

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		74869	11167	22647
Particles >6µm		ASTM D7647	>1300	▲ 33251	▲ 3342	▲ 9482
Particles >14µm		ASTM D7647	>80	▲ 2921	▲ 190	▲ 1377
Particles >21µm		ASTM D7647	>20	▲ 728	▲ 43	▲ 325
Particles >38µm		ASTM D7647	>4	▲ 27	2	▲ 20
Particles >71µm		ASTM D7647	>3	▲ 3	0	1
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 23/22/19	▲ 21/19/15	▲ 22/20/18

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	0.49	0.30	0.51

OIL ANALYSIS REPORT

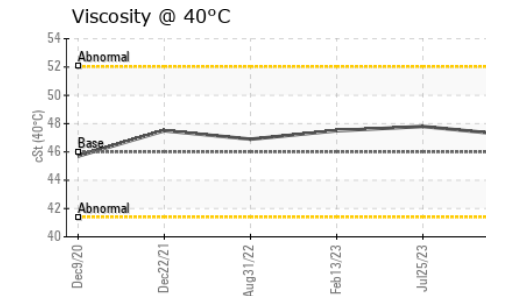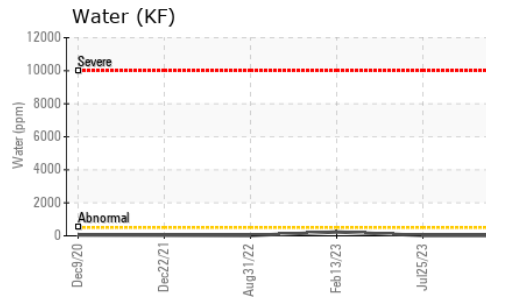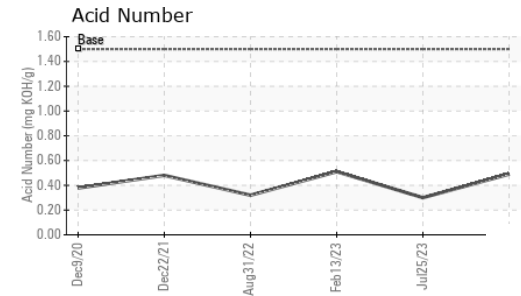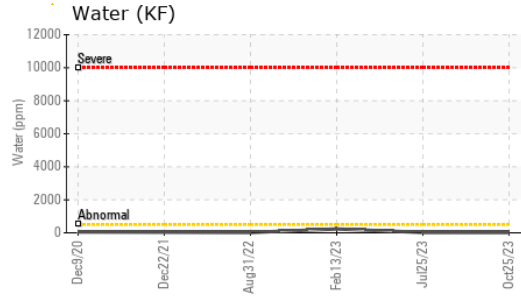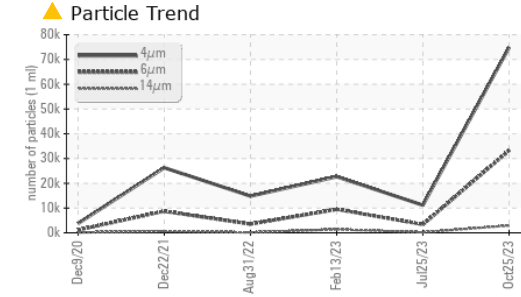





PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	47.2	47.8	47.5

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color				
Bottom				

GRAPHS

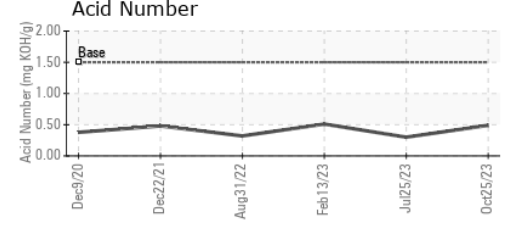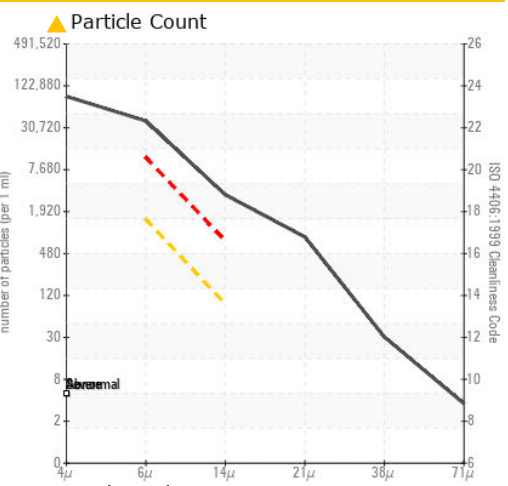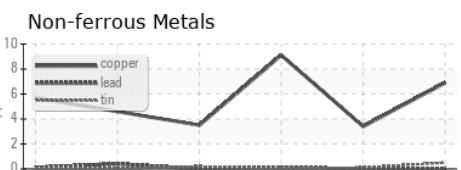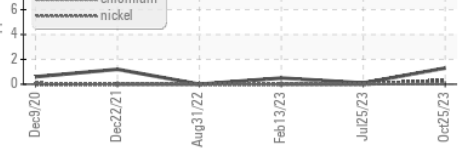

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC108004 **Received** : 31 Oct 2023
Lab Number : 05994405 **Diagnosed** : 02 Nov 2023
Unique Number : 10722765 **Diagnostician** : Don Baldrige
Test Package : IND 2

NICHOLAS MEATS
 508 E VALLEY RD
 LOGANTON, PA
 US 17747
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: