




# OIL ANALYSIS REPORT

Sample Rating Trend

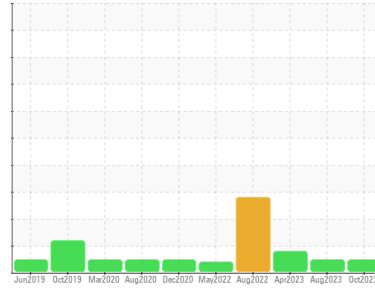

**NORMAL**



Machine Id  
**INGERSOLL RAND AC 5 (S/N CK6129U04118)**

Component  
**Air Compressor**

Fluid  
**INGERSOLL-RAND ULTRA FG (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

A decrease in the viscosity is noted. Confirmed. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP0002937</b>	USP237855	USP245944
Sample Date	Client Info		<b>25 Oct 2023</b>	13 Aug 2023	14 Apr 2023
Machine Age	hrs	Client Info	<b>14074</b>	12481	10027
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>50	<b>0</b>	1	0
Chromium	ppm	ASTM D5185m	>4	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>4	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	<1	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>40	<b>&lt;1</b>	<1	1
Tin	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>21</b>	39	37
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>0</b>	0	0
Calcium	ppm	ASTM D5185m		<b>0</b>	4	23
Phosphorus	ppm	ASTM D5185m		<b>310</b>	187	196
Zinc	ppm	ASTM D5185m		<b>22</b>	0	0
Sulfur	ppm	ASTM D5185m		<b>370</b>	307	442

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Sodium	ppm	ASTM D5185m		<b>6</b>	17	22
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	3	2
Water	%	ASTM D6304	>0.6	<b>0.008</b>	0.032	0.034
ppm Water	ppm	ASTM D6304	>6000	<b>84.9</b>	324.8	341.9

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	<b>195</b>	456	---
Particles >6µm	ASTM D7647	>2500	<b>70</b>	149	---
Particles >14µm	ASTM D7647	>320	<b>11</b>	24	---
Particles >21µm	ASTM D7647	>80	<b>4</b>	7	---
Particles >38µm	ASTM D7647	>20	<b>0</b>	0	---
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c)	>21/18/15	<b>15/13/11</b>	16/14/12	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.47</b>	0.91	0.67




# OIL ANALYSIS REPORT

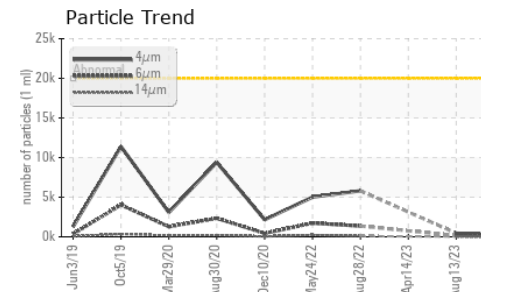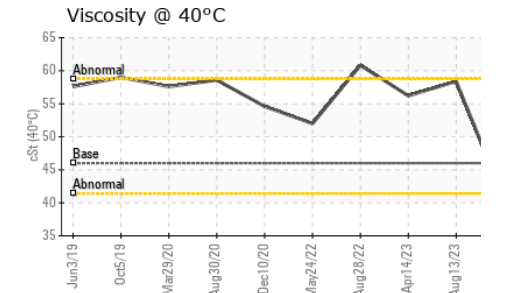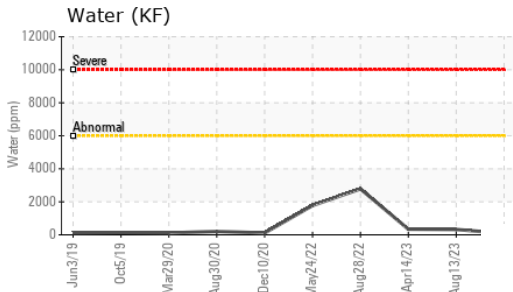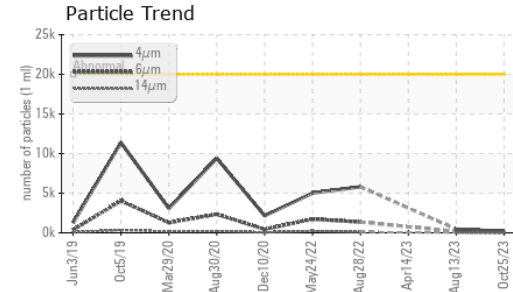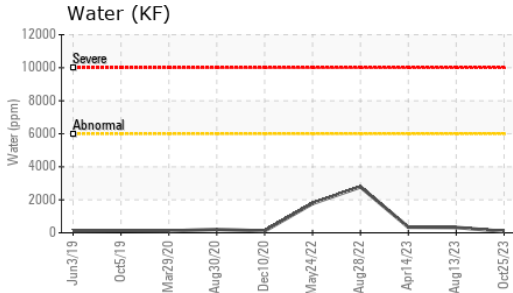






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	▲ MODER
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46.0	40.6	58.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

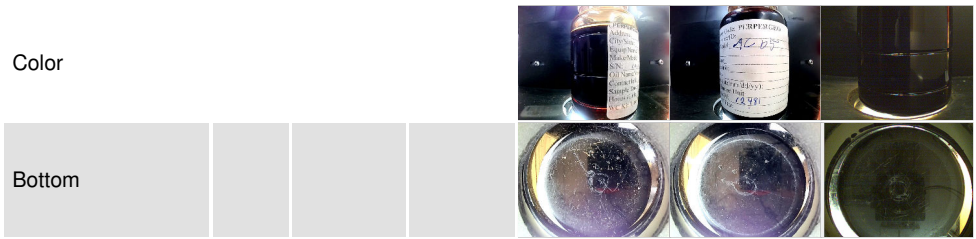

## GRAPHS

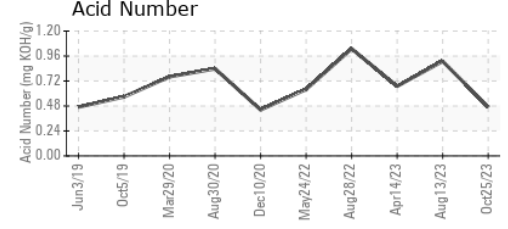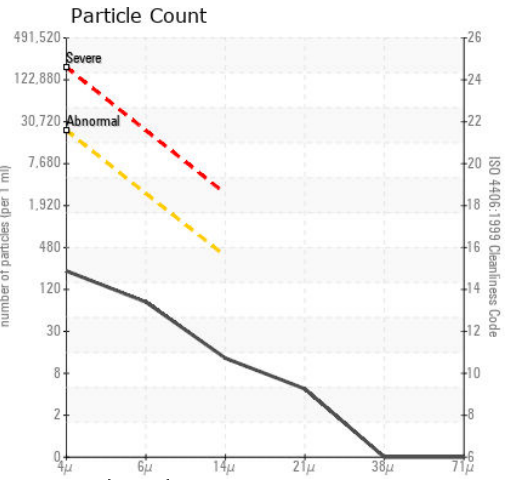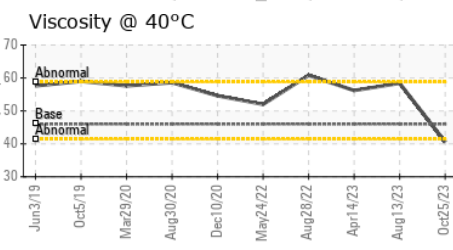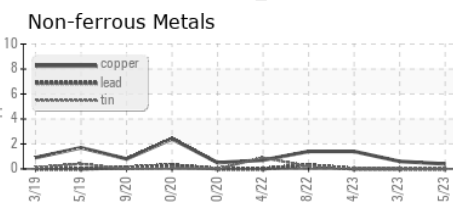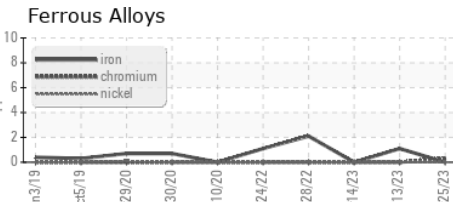

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0002937  
**Lab Number** : 05994409  
**Unique Number** : 10722769  
**Test Package** : IND 2

**PERDUE FARMS INC**  
 250 GEORGIA HWY 247 SPUR  
 PERRY, GA  
 US 31069  
 Contact: JAMES EAST  
 james.east@perdue.com  
 T: (478)988-6048  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)