

PROBLEM SUMMARY

Sample Rating Trend


ISO

INGERSOLL RAND AC 2 (S/N CK2626U00014)

Air Compressor

INGERSOLL-RAND ULTRA FG (10 GAL)

COMPONENT CONDITION SUMMARY

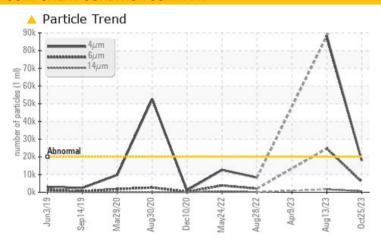

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS								
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL			
Particles >6μm	ASTM D7647	>2500	△ 5908	<u>4</u> 24697				
Particles >14μm	ASTM D7647	>320	601	<u> </u>				
Particles >21µm	ASTM D7647	>80	138	△ 359				
Oil Cleanliness	ISO 4406 (c)	>21/18/15	21/20/16	24/22/18				

Customer Id: PERPERUSP Sample No.: USP0002909 Lab Number: 05994412 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter			?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

13 Aug 2023 Diag: Doug Bogart





We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



09 Apr 2023 Diag: Doug Bogart

SEDIMENT



We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. There is a moderate amount of visible silt present in the sample. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

28 Aug 2022 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend

ISO

INGERSOLL RAND AC 2 (S/N CK2626U00014)

Air Compressor

INGERSOLL-RAND ULTRA FG (10 GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jun2019 Sep2	019 Mar2020 Aug2020 Dec2	020 May2022 Aug2022 Apr2023 Aug2	023 0e2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0002909	USP237852	USP218705
Sample Date		Client Info		25 Oct 2023	13 Aug 2023	09 Apr 2023
Machine Age	hrs	Client Info		8288	7244	5307
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	1	2
Chromium	ppm	ASTM D5185m	>4	<1	0	0
Nickel	ppm	ASTM D5185m	>4	0	0	0
Titanium	ppm	ASTM D5185m		0	<1	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	0	0
Lead	ppm	ASTM D5185m	>20	0	0	0
Copper	ppm	ASTM D5185m	>40	1	2	<1
Tin	ppm	ASTM D5185m	>5	<1	0	0
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		44	13	48
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m		2	<1	0
Calcium	ppm	ASTM D5185m		17	19	41
Phosphorus	ppm	ASTM D5185m		253	298	289
Zinc	ppm	ASTM D5185m		96	25	6
Sulfur	ppm	ASTM D5185m		369	525	634
CONTAMINANTS	1	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	10	<1	13
Sodium	ppm	ASTM D5185m		25	14	17
Potassium	ppm	ASTM D5185m	>20	<1	2	<1
Water	%	ASTM D6304	>0.6	0.063	0.013	0.033
ppm Water	ppm	ASTM D6304	>6000	639.5	132.7	332.2
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647	>20000	17930	▲ 88232	
Particles >6µm		ASTM D7647	>2500	△ 5908	24697	
Particles >14μm		ASTM D7647	>320	<u>▲</u> 601	<u>▲</u> 1640	
Particles >21μm		ASTM D7647	>80	<u> </u>	▲ 359	
Particles >38μm		ASTM D7647	>20	4	4	
Particles >71μm		ASTM D7647	>4	1	0	
Oil Cleanliness		ISO 4406 (c)	>21/18/15	<u>^</u> 21/20/16	<u>4</u> 24/22/18	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A = ! = ! N (A N !)		ACTM DODAE		0.40	0.20	0.00

Acid Number (AN)

mg KOH/g ASTM D8045

0.39

0.48

0.28



OIL ANALYSIS REPORT







Certificate L2367

Sample No. Lab Number **Unique Number**

: 05994412 : 10722772 Test Package : IND 2

: 31 Oct 2023 : USP0002909 Received Diagnosed

: 01 Nov 2023 Diagnostician : Doug Bogart

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

250 GEORGIA HWY 247 SPUR PERRY, GA

US 31069 Contact: JAMES EAST

james.east@perdue.com T: (478)988-6048

F: