

PROBLEM SUMMARY


ENGINE ROOM MYCOM C08-1 (S/N 2519367)

Refrigeration Compressor

FRICK COMPRESSOR OIL #3 (--- PNT)

Sample Rating Trend ISO

COMPONENT CONDITION SUMMARY

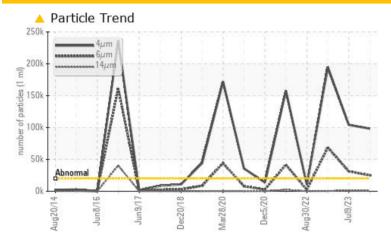

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS								
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL			
Particles >4µm	ASTM D7647 >	20000	<u> </u>	<u>▲</u> 104214	<u>194847</u>			
Particles >6µm	ASTM D7647 >	2500	<u>25038</u>	<u></u> 31200	<u>▲</u> 68460			
Particles >14μm	ASTM D7647 >	-320	<u> </u>	<u></u> 1048	△ 391			
Particles >21μm	ASTM D7647 >	-80	<u> </u>	<u>134</u>	18			
Oil Cleanliness	ISO 4406 (c) >	21/18/15	<u>4</u> 24/22/17	<u>4</u> 24/22/17	<u>\$\Delta\$ 25/23/16</u>			

Customer Id: PERPERUSP Sample No.: USP0002934 Lab Number: 05994454 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter			?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

09 Jul 2023 Diag: Doug Bogart





We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



09 Apr 2023 Diag: Doug Bogart

150



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



30 Aug 2022 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.






OIL ANALYSIS REPORT

ENGINE ROOM MYCOM C08-1 (S/N 2519367)

Refrigeration Compressor

FRICK COMPRESSOR OIL #3 (--- PNT)





DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		lug2014 Juni	016 Jun 2017 Dec 2018	Mar2020 Dec2020 Aug2022	Jul2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0002934	USP245925	USP218709
Sample Date		Client Info		25 Oct 2023	09 Jul 2023	09 Apr 2023
Machine Age	hrs	Client Info		52502	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	Not Changd	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	3	4	1
Chromium	ppm	ASTM D5185m	>2	<1	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		<1	<1	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	<1	0	0
Tin	ppm	ASTM D5185m	>4	<1	0	0
Vanadium	ppm	ASTM D5185m		<1	<1	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m		0	<1	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m		11	<1	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	0	0
Sodium	ppm	ASTM D5185m		1	<1	0
Potassium	ppm	ASTM D5185m	>20	1	0	0
Water	%	ASTM D6304	>0.01	0.002	0.002	0.001
ppm Water	ppm	ASTM D6304	>100	21.9	22.4	9.7
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	98287	<u> 104214</u>	△ 194847
Particles >6µm		ASTM D7647	>2500	<u>^</u> 25038	▲ 31200	<u></u> 68460
Particles >14μm		ASTM D7647	>320	759	▲ 1048	△ 391
Particles >21μm		ASTM D7647	>80	<u></u> 84	<u></u> 134	18
Particles >38μm		ASTM D7647	>20	0	1	0
Particles >71μm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>21/18/15	<u>4</u> 24/22/17	4 24/22/17	<u>△</u> 25/23/16
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974		0.012	0.014	0.015



OIL ANALYSIS REPORT







Certificate L2367

Lab Number **Unique Number**

Test Package : IND 2

: 05994454 : 10722814 Diagnosed : 01 Nov 2023 Diagnostician : Doug Bogart

PERRY, GA US 31069

Contact: JAMES EAST james.east@perdue.com T: (478)988-6048

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: