

PROBLEM SUMMARY


ENGINE ROOM MYCOM C01-1 (S/N 2035507)

Sample Rating Trend

ISO

Refrigeration Compressor FRICK COMPRESSOR OIL #3 (--- PNT)

COMPONENT CONDITION SUMMARY

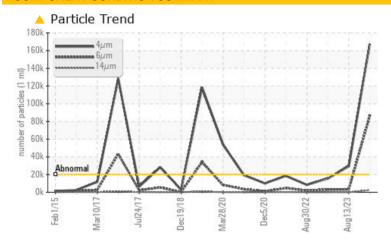

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	ATTENTION	ATTENTION				
Particles >4μm	ASTM D7647	>20000	<u> </u>	29416	15492				
Particles >6µm	ASTM D7647	>2500	A 86133	▲ 3276	△ 3082				
Particles >14μm	ASTM D7647	>320	2474	36	105				
Particles >21μm	ASTM D7647	>80	192	7	18				
Oil Cleanliness	ISO 4406 (c)	>21/18/15	25/24/18	<u>^</u> 22/19/12	<u>^</u> 21/19/14				

Customer Id: PERPERUSP Sample No.: USP0002936 Lab Number: 05994456 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter			?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

13 Aug 2023 Diag: Doug Bogart





Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



09 Apr 2023 Diag: Doug Bogart

ISO



Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

View report

30 Aug 2022 Diag: Doug Bogart

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.






OIL ANALYSIS REPORT

ENGINE ROOM MYCOM C01-1 (S/N 2035507)

Refrigeration Compressor

FRICK COMPRESSOR OIL #3 (--- PNT)





DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		eb2015 Mara	017 Jul2017 Dec2018	Mar2020 Dec2020 Aug2022	Aug2023	
SAMPLE INFORMA	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0002936	USP245927	USP245940
Sample Date		Client Info		25 Oct 2023	13 Aug 2023	09 Apr 2023
Machine Age	hrs	Client Info		37594	36139	33440
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ATTENTION	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<1	0	0
Chromium	ppm	ASTM D5185m	>2	<1	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		<1	<1	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	<1	<1	0
Tin	ppm	ASTM D5185m	>4	0	0	0
Vanadium	ppm	ASTM D5185m		<1	<1	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
	ppm	ASTM D5185m		<1	0	0
	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m		6	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	0	0
Sodium	ppm	ASTM D5185m		1	<1	<1
Potassium	ppm	ASTM D5185m	>20	<1	0	0
Water	%	ASTM D6304	>0.01	0.002	0.003	0.002
ppm Water	ppm	ASTM D6304	>100	17.9	26.5	15.3
FLUID CLEANLINE	SS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	△ 167334	<u>\$\text{29416}\$</u>	15492
Particles >6µm		ASTM D7647	>2500	A 86133	▲ 3276	▲ 3082
Particles >14µm		ASTM D7647	>320	<u> </u>	36	105
Particles >21µm		ASTM D7647	>80	<u>192</u>	7	18
Particles >38µm		ASTM D7647	>20	1	0	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>21/18/15	25/24/18	<u>22/19/12</u>	<u>\$\lambda\$</u> 21/19/14
FLUID DEGRADAT	ION	method	limit/base	current	history1	history2
Asid Number (ANI)	ma 1/011/a	ACTM DOZA		0.012	0.010	0.015

Acid Number (AN)

mg KOH/g ASTM D974

0.013

0.013

0.015



OIL ANALYSIS REPORT



To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F:

james.east@perdue.com

T: (478)988-6048