


OIL ANALYSIS REPORT

PALEXTRA 44

SULLIVAN PALATEK 23GE004307 - REFRESCO NORTH AMERICA

Component Compressor

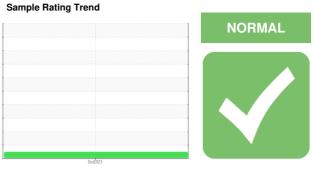

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCS05994494		
Sample Date		Client Info		26 Oct 2023		
Machine Age	hrs	Client Info		1833		
Oil Age	hrs	Client Info		1833		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	1		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		4		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		650		
Zinc	ppm	ASTM D5185m		1		
Sulfur	ppm	ASTM D5185m		1022		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2		
Sodium	ppm	ASTM D5185m		1		
Potassium	ppm	ASTM D5185m	>20	1		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.089		

Sullivan

OIL ANALYSIS REPORT

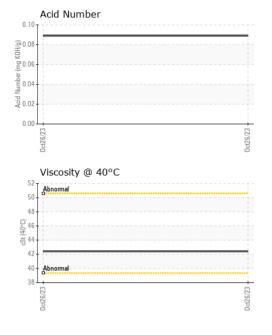

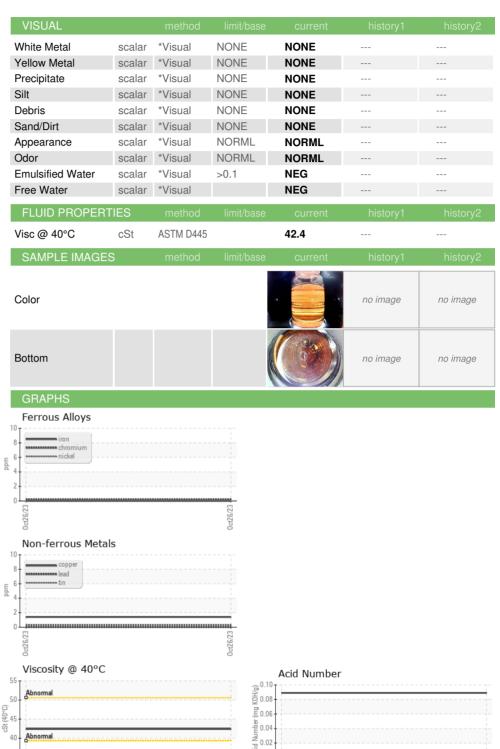





Sample No.

Laboratory

: UCS05994494 Lab Number : 05994494 Unique Number : 10722854

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 31 Oct 2023 **Tested**

: 01 Nov 2023 Diagnosed : 01 Nov 2023 - Don Baldridge

Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

0.00

Contact/Location: SCOTT - UCAIRGRESC

AIR COMPRESSOR SERVICES

scott@aircompressorservices.com

GREENVILLE, SC

Contact: SCOTT

T: (877)592-9892

US 29609