




# OIL ANALYSIS REPORT

Sample Rating Trend

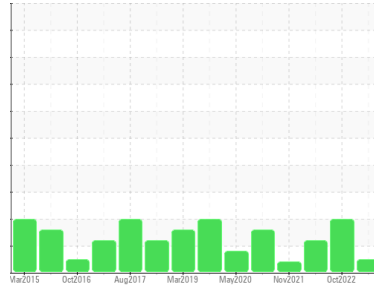

**NORMAL**



Machine Id  
**KAESER ASD 30 4768137 (S/N 1026)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA003836</b>	KCP46616D	KCP45089
Sample Date	Client Info			<b>12 Sep 2023</b>	19 Oct 2022	18 Apr 2022
Machine Age	hrs	Client Info		<b>40595</b>	37022	34875
Oil Age	hrs	Client Info		<b>0</b>	3853	3870
Oil Changed	Client Info			<b>N/A</b>	Not Changd	Changed
Sample Status				<b>NORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	1	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>50	<b>11</b>	13	10
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	90	<b>0</b>	<1	0
Calcium	ppm	ASTM D5185m	2	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>0</b>	10	21
Zinc	ppm	ASTM D5185m		<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m		<b>15697</b>	21128	13734

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	<1
Water	%	ASTM D6304	>0.05	<b>0.014</b>	0.006	0.005
ppm Water	ppm	ASTM D6304	>500	<b>147.8</b>	68.0	53.9

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>9243</b>	118515	19533
Particles >6µm		ASTM D7647	>1300	<b>1015</b>	▲ 38546	▲ 2891
Particles >14µm		ASTM D7647	>80	<b>78</b>	▲ 1082	▲ 141
Particles >21µm		ASTM D7647	>20	<b>30</b>	▲ 206	▲ 26
Particles >38µm		ASTM D7647	>4	<b>3</b>	▲ 16	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	1	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>20/17/13</b>	▲ 24/22/17	▲ 19/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.36</b>	0.34	0.30


# OIL ANALYSIS REPORT

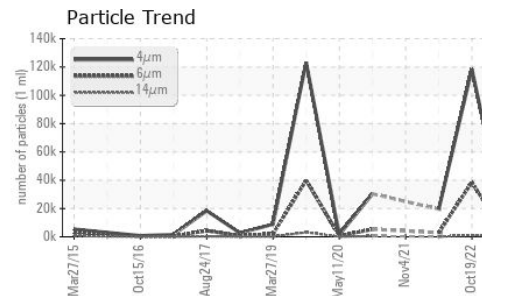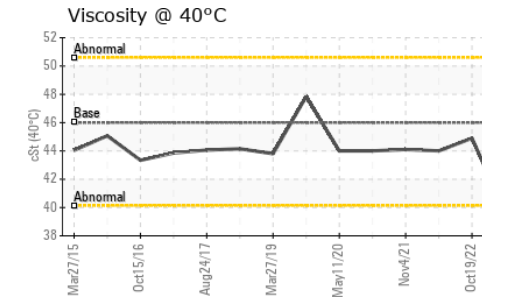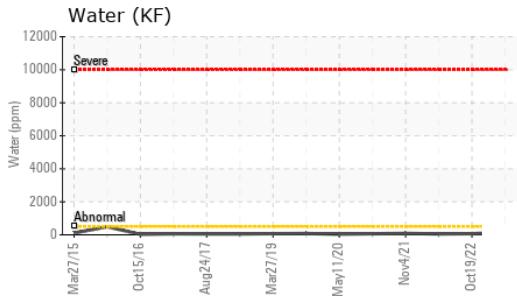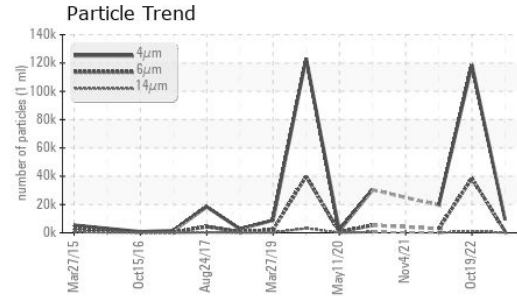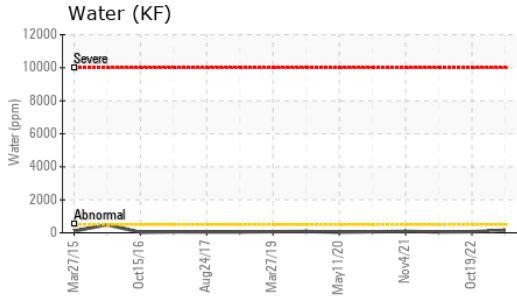






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	39.7	44.9	44.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

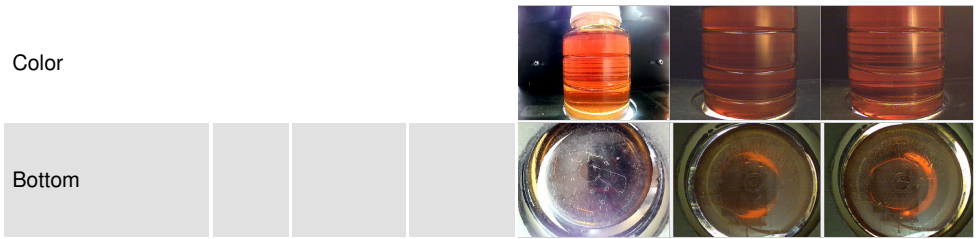

## GRAPHS

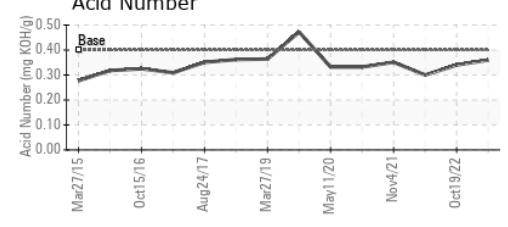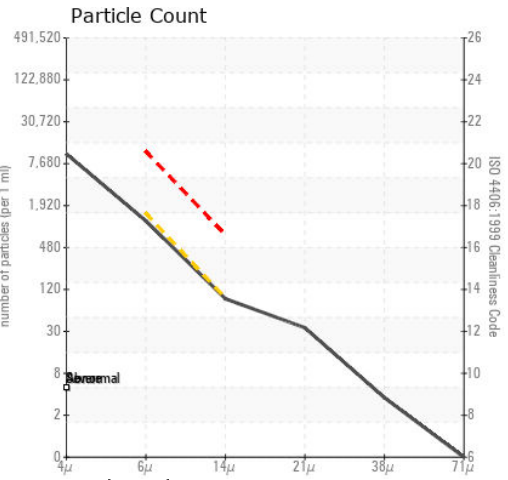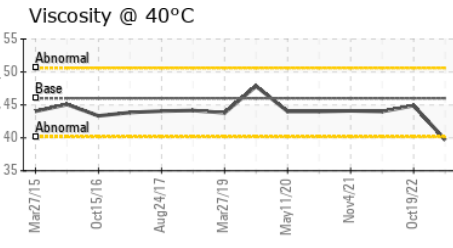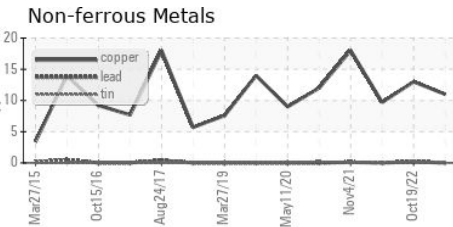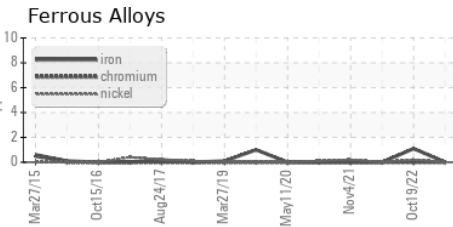

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA003836 **Received** : 31 Oct 2023  
**Lab Number** : 05995033 **Diagnosed** : 02 Nov 2023  
**Unique Number** : 10723393 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**RAPA - RAUSCH & PAUSCH**  
 2450 PAUL PARKS LN  
 AUBURN, AL  
 US 36832  
 Contact: S. SMITH  
 ssmith@rapa.com  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)