

PROBLEM SUMMARY

Sample Rating Trend




^{Machine Id} **2505019 (S/N 2822)**

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

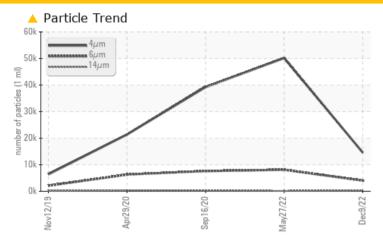

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL				
Particles >6µm	ASTM D7647	>1300	4028	▲ 8109	△ 7608				
Particles >14µm	ASTM D7647	>80	283	<u> </u>	<u> </u>				
Particles >21µm	ASTM D7647	>20	<u></u> 61	<u>^</u> 24	△ 33				
Oil Cleanliness	ISO 4406 (c)	>/17/13	21/19/15	23/20/14	<u>^</u> 20/15				

Customer Id: PERWHIKC Sample No.: KC93894 Lab Number: 05995607 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

27 May 2022 Diag: Jonathan Hester

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



16 Sep 2020 Diag: Angela Borella

ISO



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



29 Apr 2020 Diag: Angela Borella

ISO




No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT



ISO



2505019 (S/N 2822)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Nov2019	Apr2020	Sep 2020 May 2022	Dec2022	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC93894	KC93885	KC93883
Sample Date		Client Info		09 Dec 2022	27 May 2022	16 Sep 2020
Machine Age	hrs	Client Info		22892	22892	2289
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Not Changd	Changed	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m		<1	<1	0
Lead	ppm	ASTM D5185m	>10	0	2	<1
Copper	ppm	ASTM D5185m		0	0	<1
Tin	ppm	ASTM D5185m	>10	0	<1	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	<1
Barium	ppm	ASTM D5185m	90	57	76	71
Molybdenum	ppm	ASTM D5185m		0	0	<1
Manganese	ppm	ASTM D5185m	00	<1	0	<1
Magnesium	ppm	ASTM D5185m	90	93	90	78
Calcium	ppm	ASTM D5185m	2	3	2	6
Phosphorus	ppm	ASTM D5185m		<1	9	8
Zinc	ppm	ASTM D5185m		0		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	2	2
Sodium	ppm	ASTM D5185m		8	5	10
Potassium	ppm	ASTM D5185m		1	0	2
Water	%	ASTM D6304		0.029	0.043	0.026
ppm Water	ppm	ASTM D6304		293.5	434.0	269.4
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		14583	50166	39226
Particles >6µm		ASTM D7647		4028	<u>▲</u> 8109	<u>^</u> 7608
Particles >14µm		ASTM D7647	>80	<u>A</u> 283	<u>136</u>	<u> 185</u>
Particles >21µm		ASTM D7647	>20	<u>^</u> 61	<u>^</u> 24	<u>^</u> 33
Particles >38µm		ASTM D7647	>4	1	1	2
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 21/19/15	<u>\$\text{23}\20\/14\$</u>	<u>20/15</u>
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.37	0.35	0.396



OIL ANALYSIS REPORT

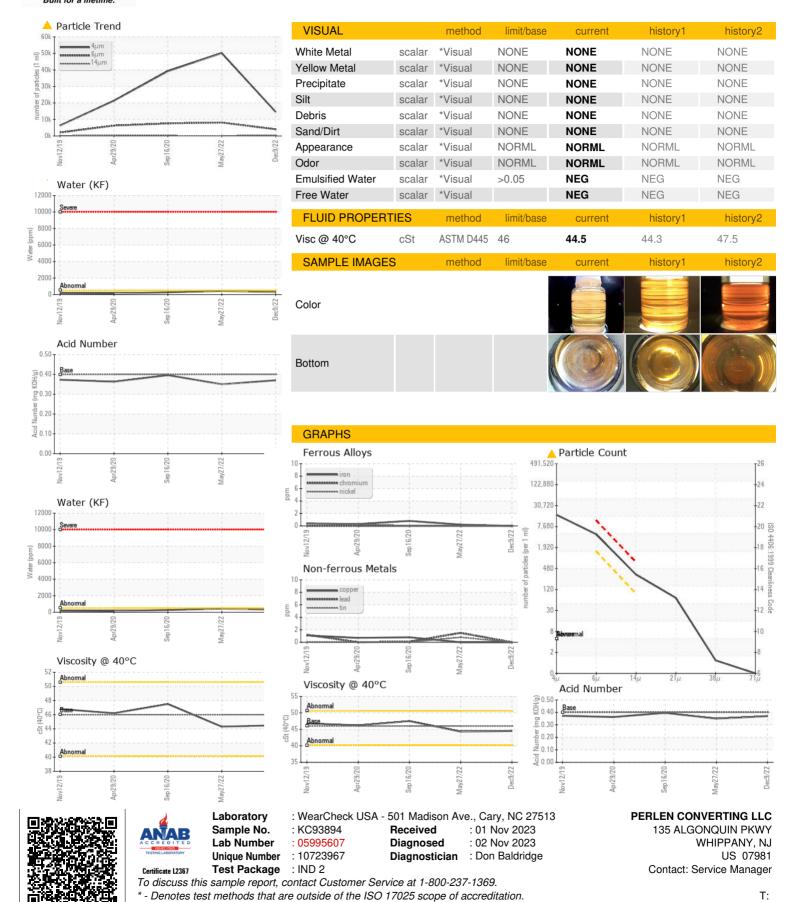

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: