




# PROBLEM SUMMARY


Sample Rating Trend

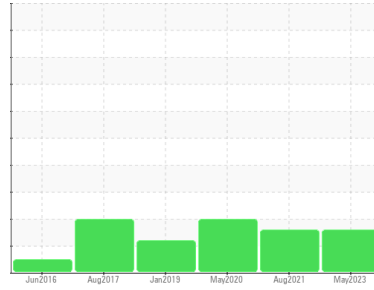

Machine Id  
**KAESER SK 26 02611705**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

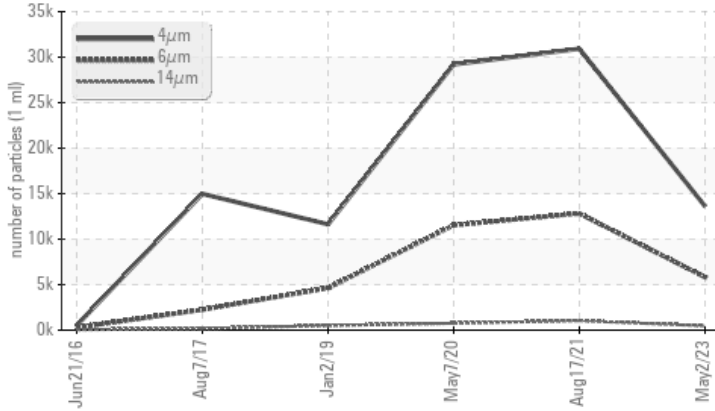

## RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ <b>5831</b>	▲ 12820	▲ 11528
Particles >14µm	ASTM D7647	>80	▲ <b>466</b>	▲ 1040	▲ 759
Particles >21µm	ASTM D7647	>20	▲ <b>97</b>	▲ 219	▲ 112
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>21/20/16</b>	▲ 21/17	▲ 21/17

Customer Id: ISOSTI  
 Sample No.: KC104999  
 Lab Number: 05995613  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

## HISTORICAL DIAGNOSIS

### 17 Aug 2021 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 07 May 2020 Diag: Angela Borella

ISO



We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 02 Jan 2019 Diag: Jonathan Hester

ISO




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



Machine Id  
**KAESER SK 26 02611705**  
Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

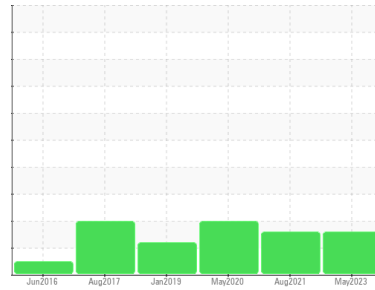

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KC104999</b>	KC89939	KC84594
Sample Date	Client Info	<b>02 May 2023</b>	17 Aug 2021	07 May 2020
Machine Age	hrs	<b>8980</b>	8975	8948
Oil Age	hrs	<b>5</b>	48	0
Oil Changed	Client Info	<b>Changed</b>	Changed	Not Changed
Sample Status		<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

## WEAR METALS

method	limit/base	current	history1	history2
Iron ppm	ASTM D5185m >50	<b>0</b>	<1	<1
Chromium ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum ppm	ASTM D5185m >10	<b>&lt;1</b>	0	<1
Lead ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper ppm	ASTM D5185m >50	<b>0</b>	<1	0
Tin ppm	ASTM D5185m >10	<b>0</b>	0	0
Antimony ppm	ASTM D5185m	<b>---</b>	0	0
Vanadium ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron ppm	ASTM D5185m 0	<b>0</b>	<1	<1
Barium ppm	ASTM D5185m 90	<b>74</b>	60	86
Molybdenum ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium ppm	ASTM D5185m 100	<b>94</b>	90	88
Calcium ppm	ASTM D5185m 0	<b>3</b>	2	3
Phosphorus ppm	ASTM D5185m 0	<b>&lt;1</b>	8	<1
Zinc ppm	ASTM D5185m 0	<b>0</b>	0	0

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm	ASTM D5185m >25	<b>&lt;1</b>	2	2
Sodium ppm	ASTM D5185m	<b>4</b>	7	3
Potassium ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	<1
Water %	ASTM D6304 >0.05	<b>0.034</b>	0.025	0.023
ppm Water	ASTM D6304 >500	<b>344.4</b>	254.4	236.1






## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>13613</b>	30921	29211
Particles >6µm	ASTM D7647 >1300	<b>▲ 5831</b>	▲ 12820	▲ 11528
Particles >14µm	ASTM D7647 >80	<b>▲ 466</b>	▲ 1040	▲ 759
Particles >21µm	ASTM D7647 >20	<b>▲ 97</b>	▲ 219	▲ 112
Particles >38µm	ASTM D7647 >4	<b>3</b>	▲ 5	▲ 12
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	▲ 6
Oil Cleanliness	ISO 4406 (c) >--/17/13	<b>▲ 21/20/16</b>	▲ 21/17	▲ 21/17

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D8045 1.0	<b>0.34</b>	0.316	0.337


# OIL ANALYSIS REPORT

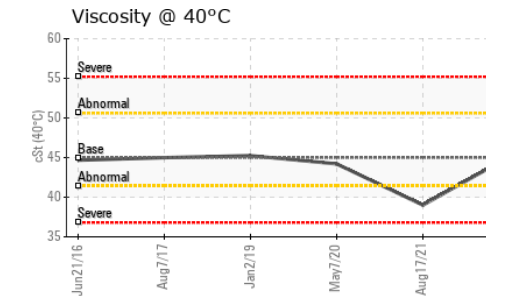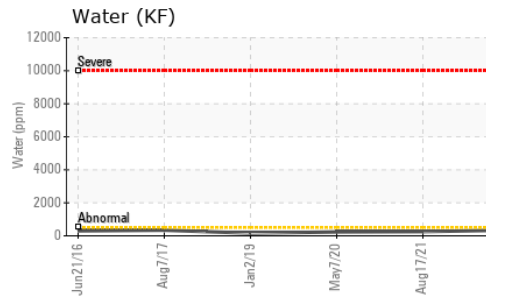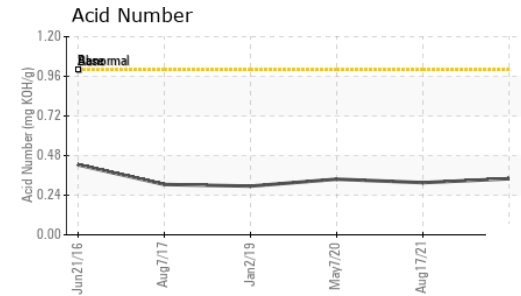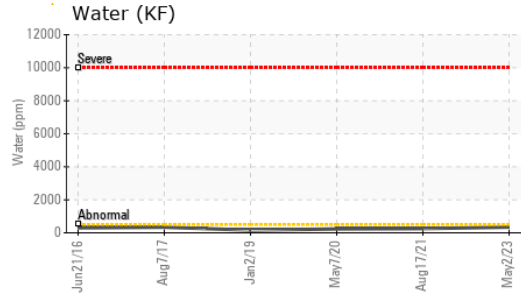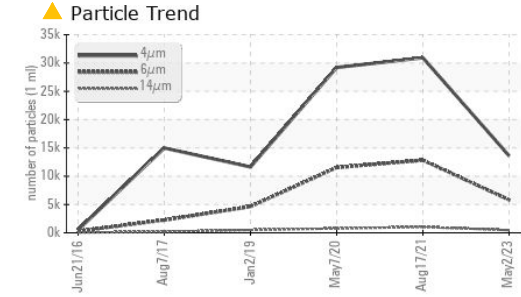





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	45.1	39.0	44.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

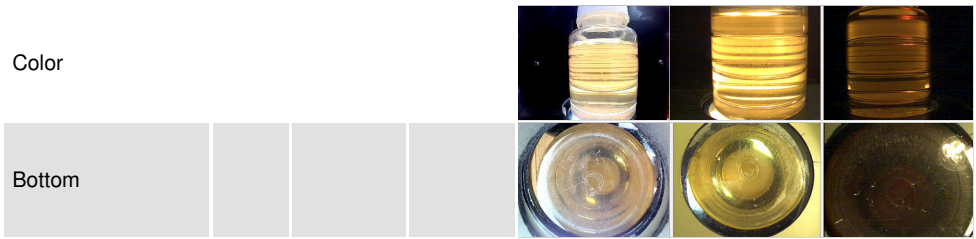

## GRAPHS

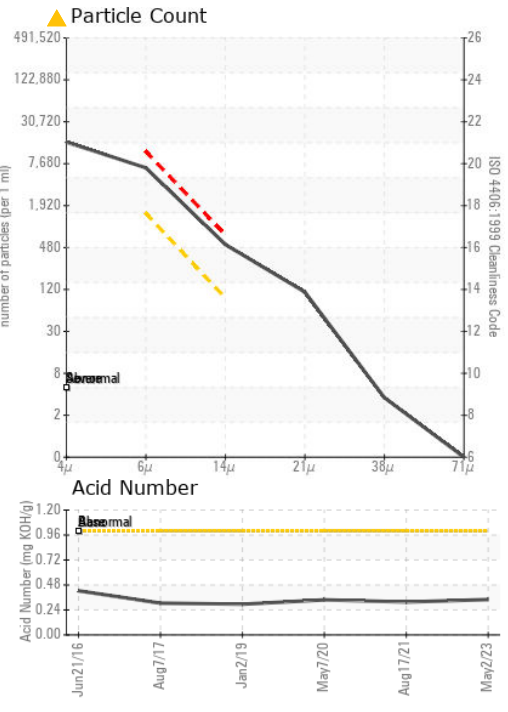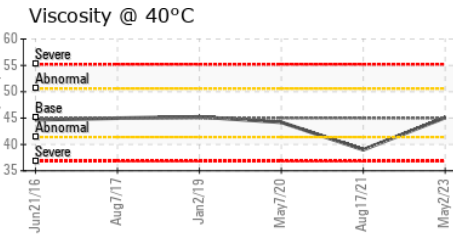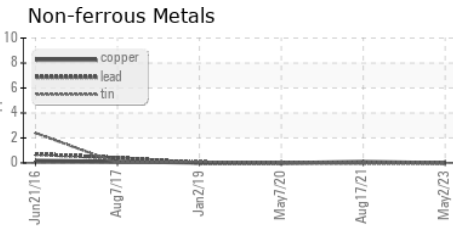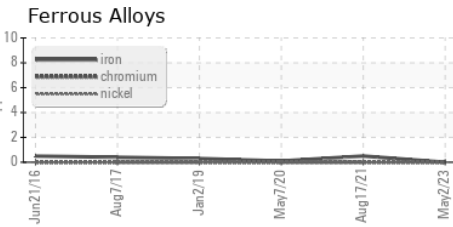

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC104999 **Received** : 01 Nov 2023  
**Lab Number** : 05995613 **Diagnosed** : 02 Nov 2023  
**Unique Number** : 10723973 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**ISOLANTITE**  
 337 WARREN AVE  
 STIRLING, NJ  
 US 07980  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)