




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

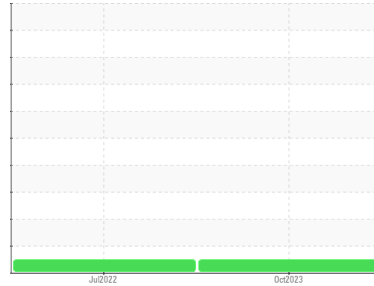

Area  
**MISSION BELL [9265]**  
 Machine Id  
**MYCOM COMP 15 - MISSION BELL (S/N 630275)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**APCCO ISO 68 (5 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0851605</b>	WC0653514	---
Sample Date	Client Info		<b>24 Oct 2023</b>	01 Jul 2022	---
Machine Age	hrs	Client Info	<b>34902</b>	34792	---
Oil Age	hrs	Client Info	<b>0</b>	0	---
Oil Changed	Client Info		<b>N/A</b>	N/A	---
Sample Status			<b>NORMAL</b>	NORMAL	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>12</b>	27	---
Chromium	ppm	ASTM D5185m >2	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	<b>0</b>	0	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >3	<b>1</b>	<1	---
Lead	ppm	ASTM D5185m >2	<b>0</b>	<1	---
Copper	ppm	ASTM D5185m >8	<b>1</b>	<1	---
Tin	ppm	ASTM D5185m >4	<b>0</b>	2	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	<1	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	<b>0</b>	2	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	---
Calcium	ppm	ASTM D5185m	<b>0</b>	6	---
Phosphorus	ppm	ASTM D5185m	<b>0</b>	9	---
Zinc	ppm	ASTM D5185m	<b>0</b>	4	---
Sulfur	ppm	ASTM D5185m	<b>0</b>	110	---

## CONTAMINANTS




	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>8</b>	2	---
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Potassium	ppm	ASTM D5185m >20	<b>1</b>	<1	---
Water	%	ASTM D6304 >0.01	<b>0.001</b>	0.001	---
ppm Water	ppm	ASTM D6304 >100	<b>2.0</b>	8.5	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	<b>0.012</b>	0.027	---




# OIL ANALYSIS REPORT

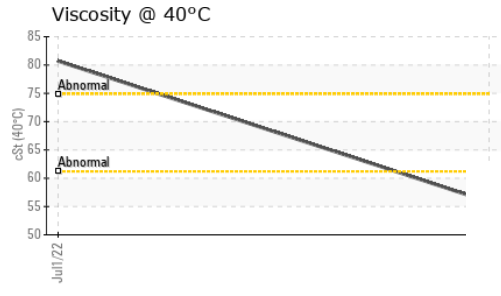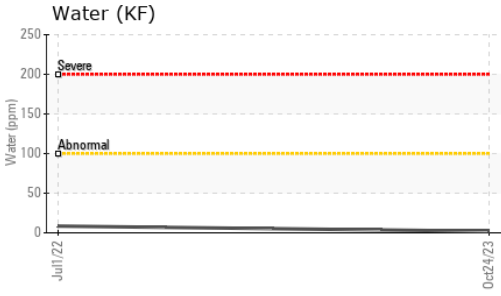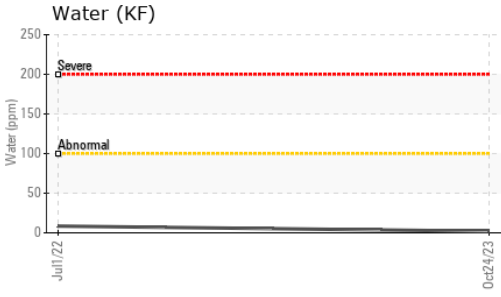






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	55.8	80.7	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

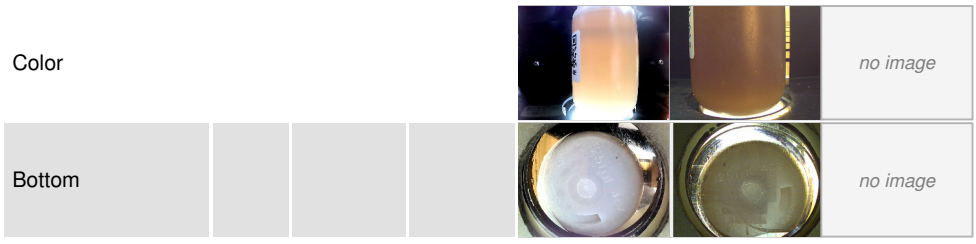

## GRAPHS

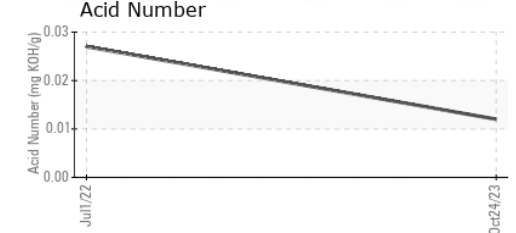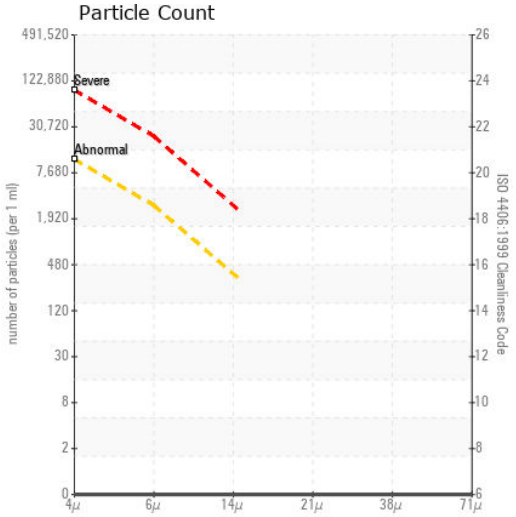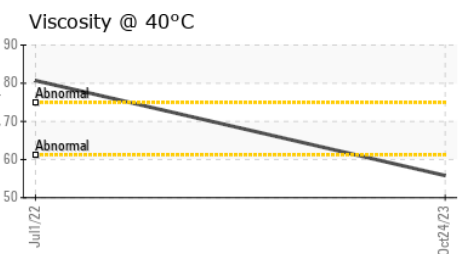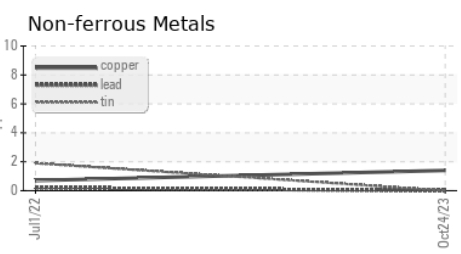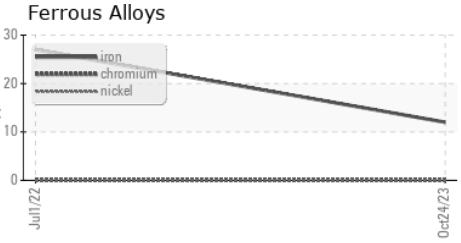

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0851605 **Received** : 01 Nov 2023  
**Lab Number** : 05995678 **Diagnosed** : 03 Nov 2023  
**Unique Number** : 10724038 **Diagnostician** : Jonathan Hester  
**Test Package** : PLANT

**SCHRADER MECHANICAL**  
 1015 BLACK DIAMOND WAY  
 LODI PROVINCE, CA  
 US 95240  
 Contact: Schrader Mechanical  
 amanda.h@smiwest.com  
 T: (209)369-6888  
 F: x:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)