




# PROBLEM SUMMARY


Sample Rating Trend

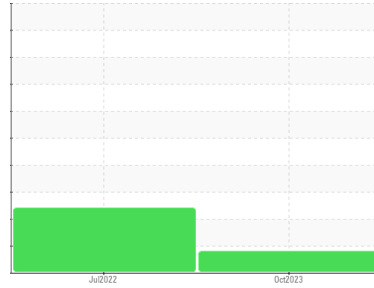

Area  
**MISSION BELL [9265]**  
 Machine Id  
**MYCOM COMP 14 - MISSION BELL (S/N 630121)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**REFRIG COMP OIL ISO 68 (5 GAL)**

## COMPONENT CONDITION SUMMARY

### ▲ Ferrous Alloys

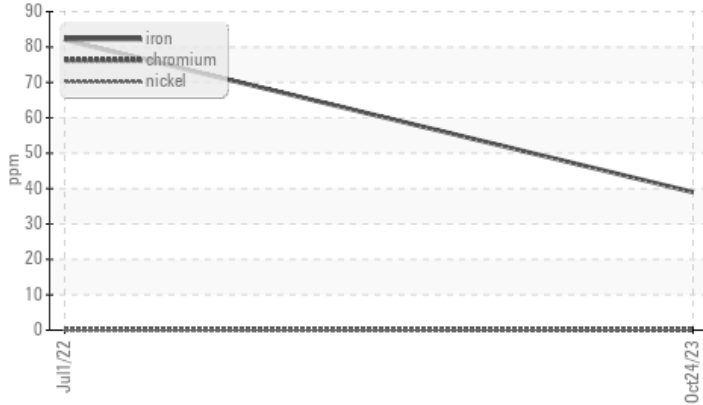

## RECOMMENDATION

No corrective action is recommended at this time. We recommend an early resample to monitor this condition.

## PROBLEMATIC TEST RESULTS

Sample Status				<b>MARGINAL</b>	ABNORMAL	---
Iron	ppm	ASTM D5185m	>8	▲ 39	▲ 82	---

Customer Id: SCHLOD  
 Sample No.: WC0851606  
 Lab Number: 05995680  
 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Jonathan Hester +1 919-379-4092 x4092  
[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Resample	---	---	?	We recommend an early resample to monitor this condition.

## HISTORICAL DIAGNOSIS

01 Jul 2022 Diag: Doug Bogart

WATER



We recommend an early resample in 500 hours to monitor this condition. The iron level is abnormal. There is a light concentration of water present in the oil. The AN level is acceptable for this fluid.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

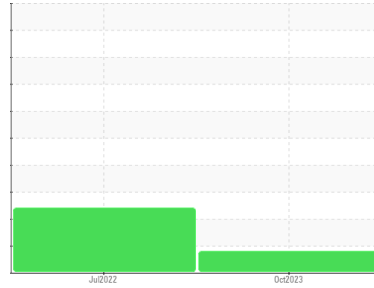

**WEAR**



Area  
**MISSION BELL [9265]**  
 Machine Id  
**MYCOM COMP 14 - MISSION BELL (S/N 630121)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**REFRIG COMP OIL ISO 68 (5 GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. We recommend an early resample to monitor this condition.

### Wear

The iron level has decreased, but is still abnormal. All other component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0851606</b>	WC0653513	---
Sample Date	Client Info		<b>24 Oct 2023</b>	01 Jul 2022	---
Machine Age	hrs	Client Info	<b>29152</b>	28137	---
Oil Age	hrs	Client Info	<b>0</b>	0	---
Oil Changed	Client Info		<b>N/A</b>	N/A	---
Sample Status			<b>MARGINAL</b>	ABNORMAL	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>▲ 39</b>	▲ 82	---
Chromium	ppm	ASTM D5185m >2	<b>0</b>	<1	---
Nickel	ppm	ASTM D5185m	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	<b>0</b>	0	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	<1	---
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	1	---
Lead	ppm	ASTM D5185m >2	<b>0</b>	<1	---
Copper	ppm	ASTM D5185m >8	<b>2</b>	2	---
Tin	ppm	ASTM D5185m >4	<b>2</b>	5	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	<1	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	<b>0</b>	<1	---
Barium	ppm	ASTM D5185m 5	<b>0</b>	2	---
Molybdenum	ppm	ASTM D5185m 5	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	---
Magnesium	ppm	ASTM D5185m 5	<b>0</b>	<1	---
Calcium	ppm	ASTM D5185m 12	<b>0</b>	14	---
Phosphorus	ppm	ASTM D5185m 12	<b>0</b>	13	---
Zinc	ppm	ASTM D5185m 12	<b>0</b>	16	---
Sulfur	ppm	ASTM D5185m 1000	<b>0</b>	109	---

## CONTAMINANTS





	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>3</b>	7	---
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	---
Water	%	ASTM D6304 >0.01	<b>0.00</b>	▲ 0.035	---
ppm Water	ppm	ASTM D6304 >100	<b>0.00</b>	▲ 356.6	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.10	<b>0.037</b>	0.115	---




# OIL ANALYSIS REPORT

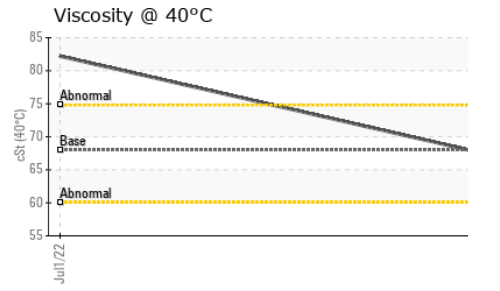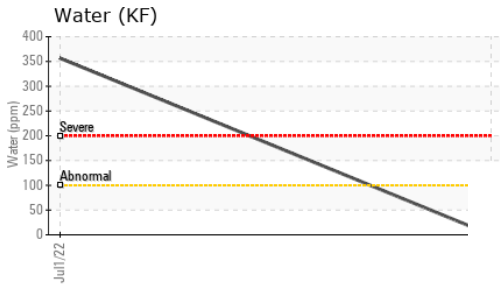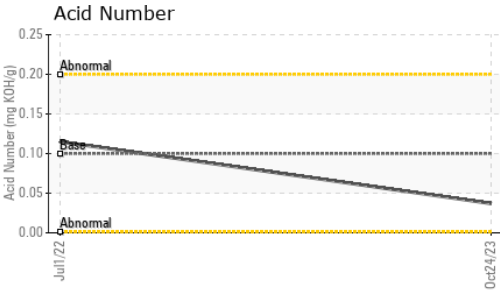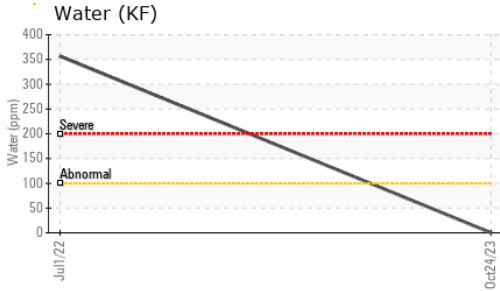






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 68	67.2	82.2	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

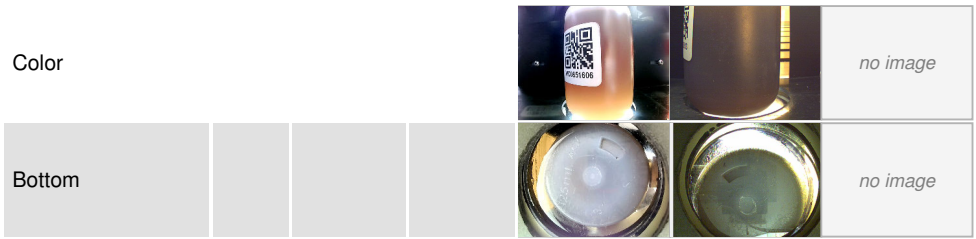

## GRAPHS

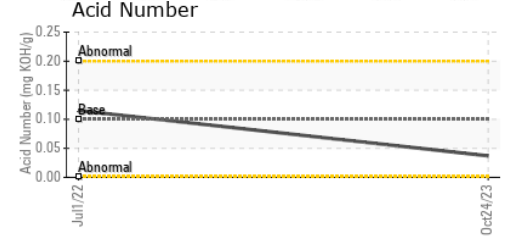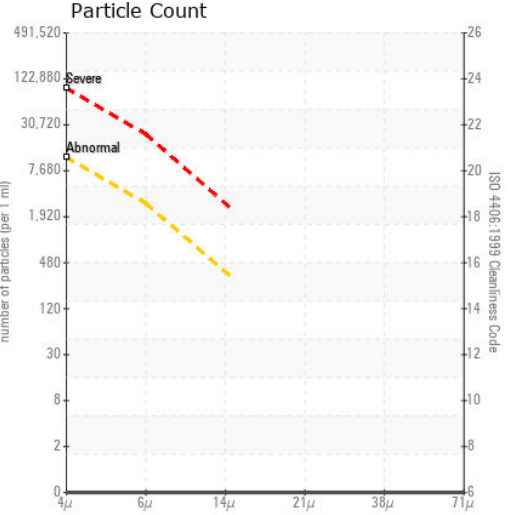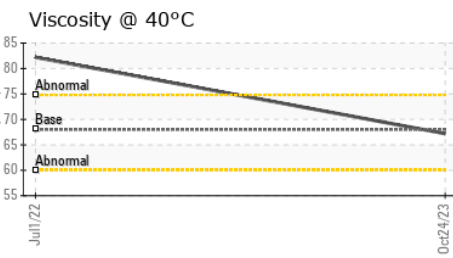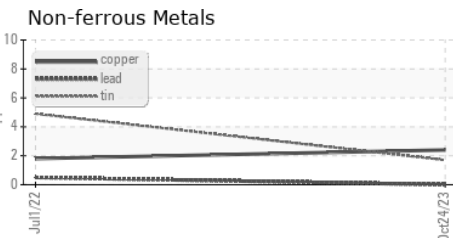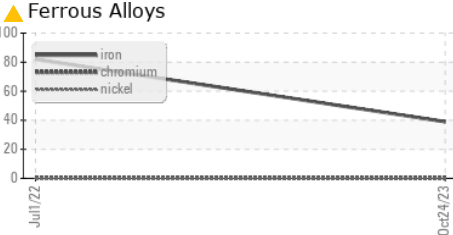

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : WC0851606 Received : 01 Nov 2023  
 Lab Number : 05995680 Diagnosed : 03 Nov 2023  
 Unique Number : 10724040 Diagnostician : Jonathan Hester  
 Test Package : PLANT

**SCHRADER MECHANICAL**  
 1015 BLACK DIAMOND WAY  
 LODI PROVINCE, CA  
 US 95240  
 Contact: Schrader Mechanical  
 amanda.h@smiwest.com  
 T: (209)369-6888  
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)