




OIL ANALYSIS REPORT

Sample Rating Trend

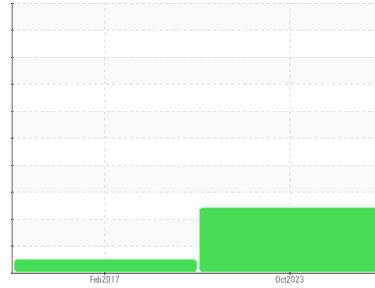

WEAR



Machine Id
13
 Component
Air Compressor
 Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. We recommend an early resample to monitor this condition. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

The iron level is abnormal. Bearing and/or bushing wear is indicated.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0775527	WC04170111	---
Sample Date	Client Info		31 Oct 2023	23 Feb 2017	---
Machine Age	hrs	Client Info	0	0	---
Oil Age	hrs	Client Info	0	0	---
Oil Changed	Client Info		N/A	N/A	---
Sample Status			ABNORMAL	NORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	▲ 36	4	---
Chromium	ppm	ASTM D5185m >4	<1	0	---
Nickel	ppm	ASTM D5185m >4	0	<1	---
Titanium	ppm	ASTM D5185m	<1	0	---
Silver	ppm	ASTM D5185m	0	0	---
Aluminum	ppm	ASTM D5185m >10	<1	<1	---
Lead	ppm	ASTM D5185m >20	▲ 56	2	---
Copper	ppm	ASTM D5185m >40	▲ 45	1	---
Tin	ppm	ASTM D5185m >5	<1	0	---
Antimony	ppm	ASTM D5185m	---	0	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	<1	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	69	<1	---
Barium	ppm	ASTM D5185m	0	0	---
Molybdenum	ppm	ASTM D5185m	27	0	---
Manganese	ppm	ASTM D5185m	<1	<1	---
Magnesium	ppm	ASTM D5185m	362	0	---
Calcium	ppm	ASTM D5185m	820	1	---
Phosphorus	ppm	ASTM D5185m	629	<1	---
Zinc	ppm	ASTM D5185m	675	<1	---
Sulfur	ppm	ASTM D5185m	2392	88	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	8	13	---
Sodium	ppm	ASTM D5185m	7	3	---
Potassium	ppm	ASTM D5185m >20	5	0	---
Water	%	ASTM D6304 >0.6	0.361	---	---
ppm Water	ppm	ASTM D6304 >6000	3610	---	---


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.21	0.058	---




OIL ANALYSIS REPORT


▲ Non-ferrous Metals

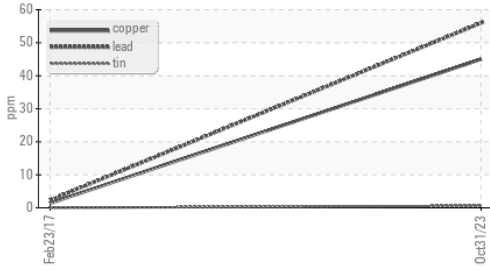


▲ Ferrous Alloys

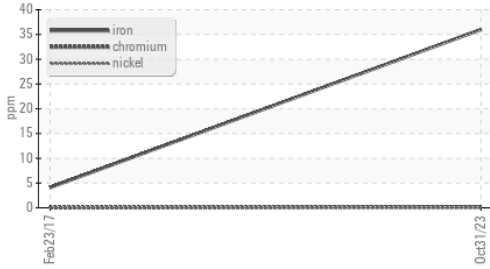


Water (KF)

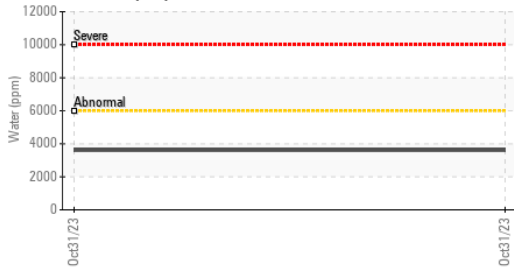

Water (KF)

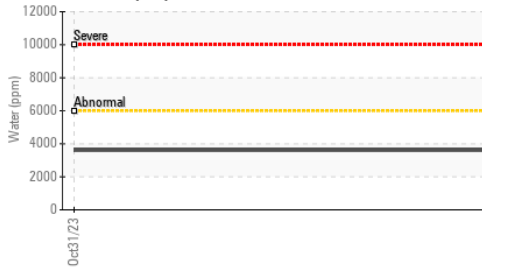

Viscosity @ 40°C

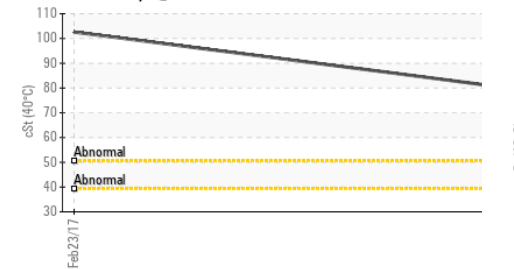

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	0.2%	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	80.2	102.6	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image	no image
Bottom				no image	no image	no image

GRAPHS


▲ Iron (ppm)

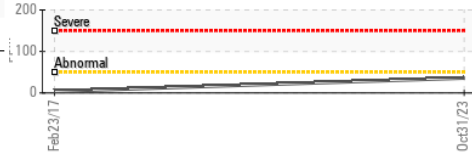


Aluminum (ppm)




▲ Copper (ppm)

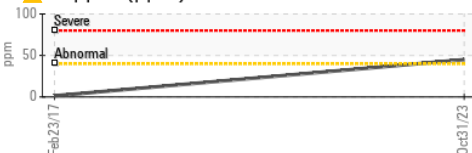

Viscosity @ 40°C

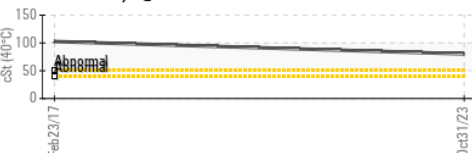

▲ Lead (ppm)

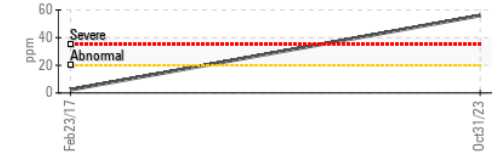


Chromium (ppm)



Silicon (ppm)



Acid Number

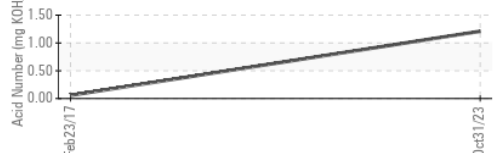

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0775527 **Received** : 01 Nov 2023
Lab Number : 05995855 **Diagnosed** : 03 Nov 2023
Unique Number : 10724215 **Diagnostician** : Don Baldrige
Test Package : MOB 2 (Additional Tests: KF)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

NRE - PADUCAH
 1300 KENTUCKY AVE.
 PADUCAH, KY
 US 42003
 Contact: GREG POYZER
 g.poyzer@nre.com
 T: (270)444-4557
 F: (270)444-4541