




OIL ANALYSIS REPORT

Sample Rating Trend

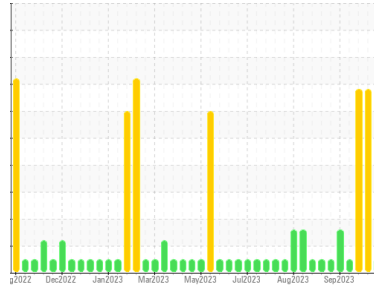

NORMAL



Machine Id
Byron Center CAT 1 BYCM01BE
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 6500 LFG GAS ENGINE OIL (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0640309	WC0640315	WC0614981
Sample Date	Client Info		30 Oct 2023	17 Oct 2023	11 Oct 2023
Machine Age	hrs	Client Info	83346	83130	82986
Oil Age	hrs	Client Info	288	900	780
Oil Changed	Client Info		N/A	Not Changd	N/A
Sample Status			NORMAL	SEVERE	SEVERE

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >15	8	▲ 23	▲ 20
Chromium	ppm	ASTM D5185m >4	<1	<1	<1
Nickel	ppm	ASTM D5185m >2	<1	<1	<1
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m >5	0	0	0
Aluminum	ppm	ASTM D5185m >6	2	2	2
Lead	ppm	ASTM D5185m >9	0	<1	0
Copper	ppm	ASTM D5185m >6	<1	2	2
Tin	ppm	ASTM D5185m >4	3	5	4
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	2	2	3
Barium	ppm	ASTM D5185m	<1	0	0
Molybdenum	ppm	ASTM D5185m	5	1	2
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m	27	28	38
Calcium	ppm	ASTM D5185m	1788	1855	1864
Phosphorus	ppm	ASTM D5185m	296	304	306
Zinc	ppm	ASTM D5185m	361	365	368
Sulfur	ppm	ASTM D5185m	3715	3746	3814

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >181	135	■ 222	■ 212
Sodium	ppm	ASTM D5185m	1	1	2
Potassium	ppm	ASTM D5185m >20	3	<1	0

INFRA-RED




	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0	0.1	0.1
Nitration	Abs/cm	*ASTM D7624 >20	5.4	5.7	5.6
Sulfation	Abs/.1mm	*ASTM D7415 >30	24.0	30.0	28.5

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	13.2	17.0	16.4
Acid Number (AN)	mg KOH/g	ASTM D8045 1.2	1.44	2.43	2.41
Base Number (BN)	mg KOH/g	ASTM D2896 4.5	5.20	▲ 1.55	▲ 2.59











OIL ANALYSIS REPORT

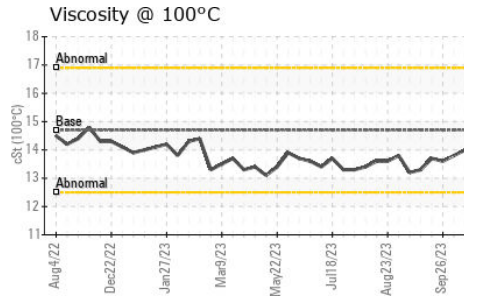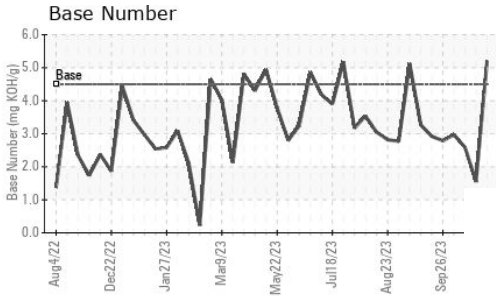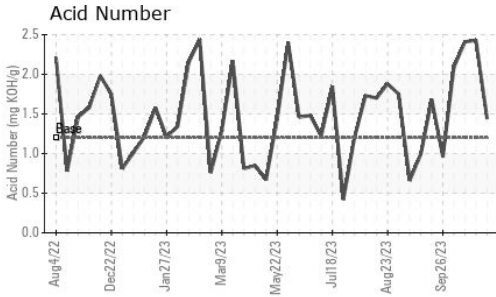

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.7	13.4	13.9

GRAPHS

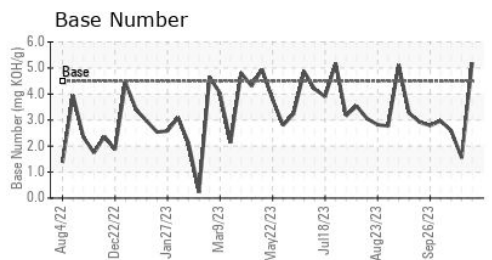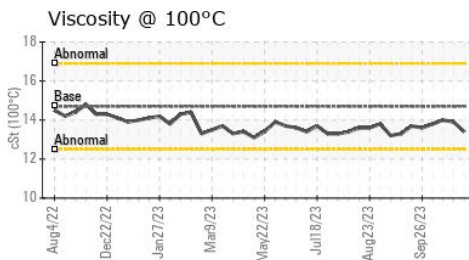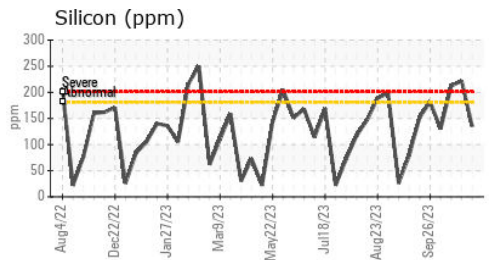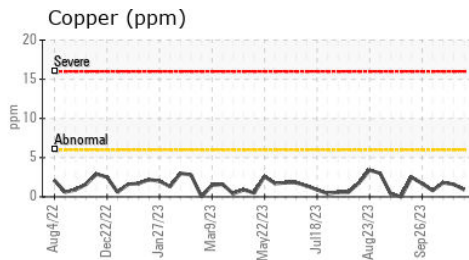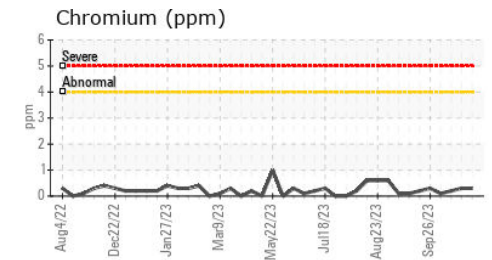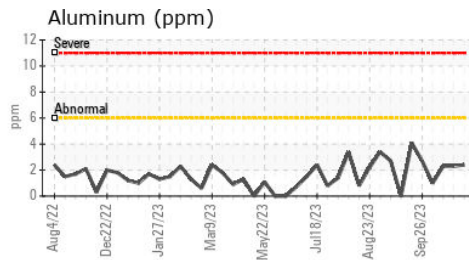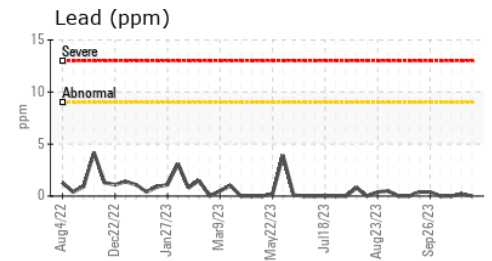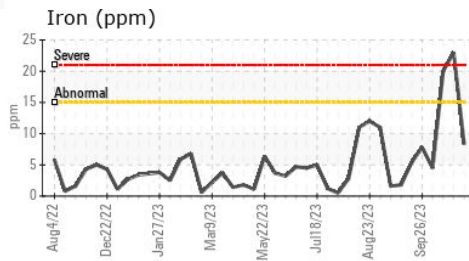

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0640309 Received : 01 Nov 2023
 Lab Number : 05995868 Diagnosed : 03 Nov 2023
 Unique Number : 10724228 Diagnostician : Don Baldrige
 Test Package : MOB 2

EDL NA Recips-Byron Center
 Byron Center Powerstation, 10310 South Kent Road
 Byron Center, MI
 US 49315
 Contact: Jake Ripke
 Jake.Ripke@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: