




# PROBLEM SUMMARY

Sample Rating Trend

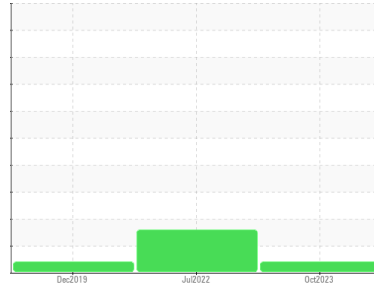

## VIS DEBRIS



Machine Id  
**KAESER 6600679**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

### COMPONENT CONDITION SUMMARY

No relevant graphs to display

### RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### PROBLEMATIC TEST RESULTS

Sample Status		ABNORMAL	ATTENTION	ATTENTION
Debris	scalar *Visual	▲ <b>HEAVY</b>	NONE	NONE

**Customer Id:** USAABE  
**Sample No.:** KCPA007541  
**Lab Number:** 05996301  
**Test Package:** IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Don Baldrige +1  
[don.b505@comcast.net](mailto:don.b505@comcast.net)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 26 Jul 2022 Diag: Don Baldrige

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 02 Dec 2019 Diag: Doug Bogart

ISO




No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



# OIL ANALYSIS REPORT

Sample Rating Trend

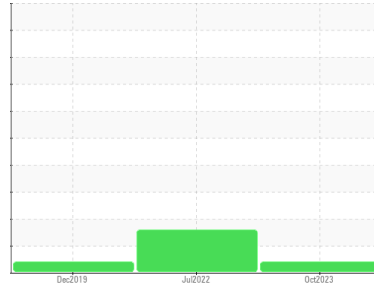

**VIS DEBRIS**



Machine Id  
**KAESER 6600679**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

**DIAGNOSIS**

**▲ Recommendation**

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**▲ Contamination**

There is a high amount of particulates present in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA007541</b>	KCP40638	KC67522
Sample Date	Client Info			<b>18 Oct 2023</b>	26 Jul 2022	02 Dec 2019
Machine Age	hrs	Client Info		<b>20248</b>	14741	2860
Oil Age	hrs	Client Info		<b>0</b>	5559	2860
Oil Changed	Client Info			<b>N/A</b>	Changed	Changed
Sample Status				<b>ABNORMAL</b>	ATTENTION	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>18</b>	<1	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>1</b>	<1	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>16</b>	6	8
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	2	0
Barium	ppm	ASTM D5185m	90	<b>2</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	90	<b>1</b>	<1	0
Calcium	ppm	ASTM D5185m	2	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>2</b>	2	0
Zinc	ppm	ASTM D5185m		<b>5</b>	30	28
Sulfur	ppm	ASTM D5185m		<b>13246</b>	16049	16859

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	<1
Sodium	ppm	ASTM D5185m		<b>3</b>	3	7
Potassium	ppm	ASTM D5185m	>20	<b>5</b>	<1	0
Water	%	ASTM D6304	>0.05	<b>0.006</b>	0.013	0.007
ppm Water	ppm	ASTM D6304	>500	<b>64.0</b>	133.2	72.4

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>---</b>	8928	6907
Particles >6µm		ASTM D7647	>1300	<b>---</b>	▲ 2156	▲ 2071
Particles >14µm		ASTM D7647	>80	<b>---</b>	▲ 139	49
Particles >21µm		ASTM D7647	>20	<b>---</b>	▲ 29	12
Particles >38µm		ASTM D7647	>4	<b>---</b>	3	2
Particles >71µm		ASTM D7647	>3	<b>---</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>---</b>	▲ 20/18/14	▲ 18/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.33</b>	0.35	0.346


# OIL ANALYSIS REPORT

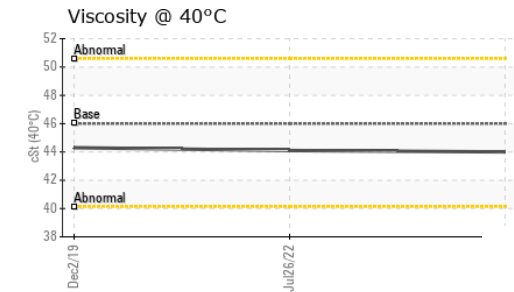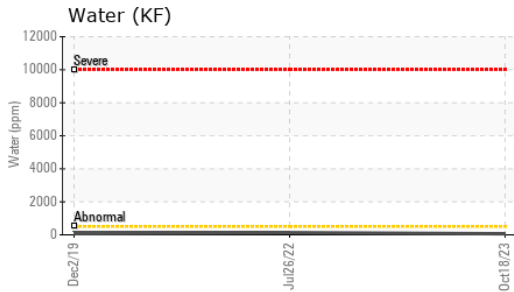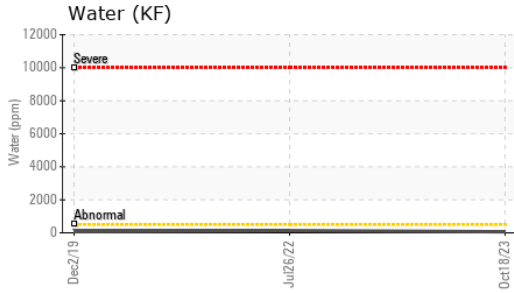





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ HEAVY	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.0	44.1	44.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

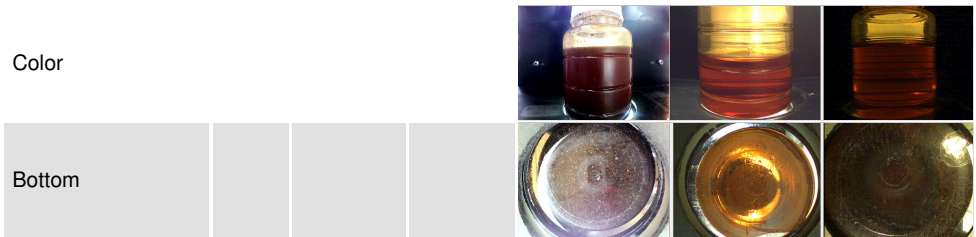

## GRAPHS

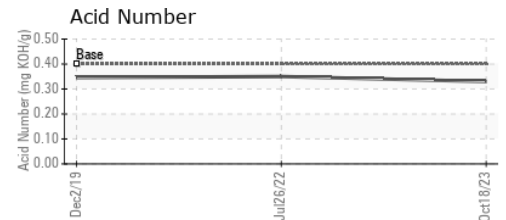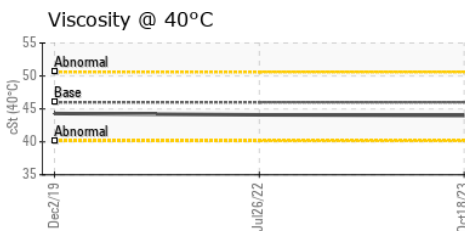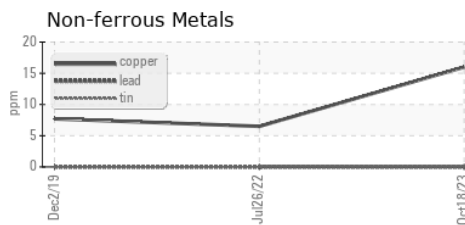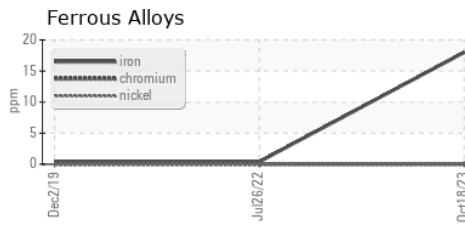

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA007541 **Received** : 01 Nov 2023  
**Lab Number** : 05996301 **Diagnosed** : 03 Nov 2023  
**Unique Number** : 10724661 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**US ARMY RESEARCH LABORATORY**  
 6375 JOHNSON RD  
 ABERDEEN PROVING GROUND, MD  
 US 21005  
 Contact: RICHARD GERDOM  
 richard.b.gerdom.civ@army.mil

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: