

PROBLEM SUMMARY

Sample Rating Trend




3057932 (S/N 1267)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

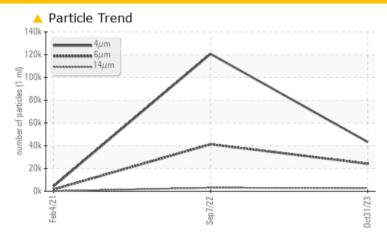

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	ABNORMAL	ATTENTION				
Particles >6μm	ASTM D7647	>1300	<u>24157</u>	<u>41279</u>	<u>▲</u> 1513				
Particles >14μm	ASTM D7647	>80	2744	▲ 3071	<u> </u>				
Particles >21µm	ASTM D7647	>20	438	690	<u>^</u> 32				
Oil Cleanliness	ISO 4406 (c)	>/17/13	23/22/19	24/23/19	<u></u> 18/14				

Customer Id: NEWFRA Sample No.: KCPA006850 Lab Number: 05996305 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

07 Sep 2022 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The condition of the oil is suitable for further service.



04 Feb 2021 Diag: Don Baldridge

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

3057932 (S/N 1267)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		East East	2021	Sep2022 Oct202	2	`
SAMPLE INFORM	AATION					hiotomyO
	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA006850	KCP49349	KCP27855
Sample Date		Client Info		31 Oct 2023	07 Sep 2022	04 Feb 2021
Machine Age	hrs	Client Info		32086	29721	26090
Oil Age	hrs	Client Info		0	3631	3131
Oil Changed		Client Info		N/A ABNORMAL	Changed	Changed
Sample Status				ABNORWAL	ABNORMAL	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m		0	<1	<1
Lead	ppm	ASTM D5185m	>10	0	<1	0
Copper	ppm	ASTM D5185m		6	12	10
Tin	ppm	ASTM D5185m	>10	<1	<1	<1
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	<1	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	12
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	100	41	25	31
Calcium	ppm	ASTM D5185m	0	0	<1	0
Phosphorus	ppm	ASTM D5185m	0	<1	1	2
Zinc	ppm	ASTM D5185m	0	38	47	60
Sulfur	ppm	ASTM D5185m	23500	16443	17942	17823
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	7	10
Sodium	ppm	ASTM D5185m		17	10	5
Potassium	ppm	ASTM D5185m	>20	5	2	0
Water	%	ASTM D6304	>0.05	0.017	0.021	0.015
ppm Water	ppm	ASTM D6304	>500	178.4	216.7	155.9
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		43266	120625	4169
Particles >6µm		ASTM D7647	>1300	<u> </u>	<u>41279</u>	<u></u> 1513
Particles >14μm		ASTM D7647	>80	<u> </u>	△ 3071	<u> </u>
Particles >21µm		ASTM D7647	>20	438	△ 690	△ 32
Particles >38μm		ASTM D7647	>4	3	<u> </u>	2
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	23/22/19	<u>4</u> 24/23/19	<u>▲</u> 18/14
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
					,	,

0.31



OIL ANALYSIS REPORT

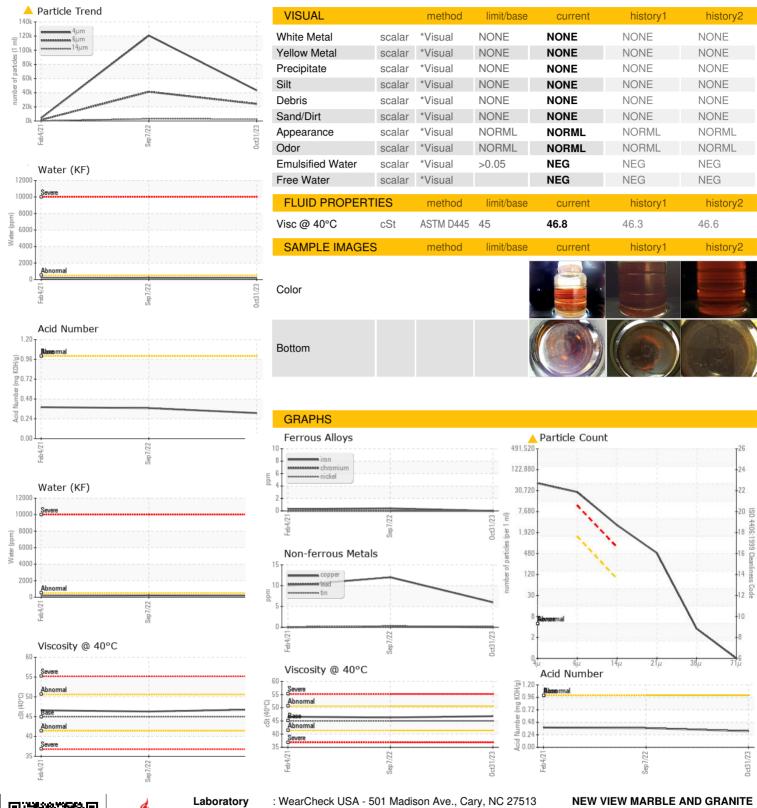





Sample No. Lab Number **Unique Number**

: 05996305

: KCPA006850 : 10724665

Received Diagnosed

: 03 Nov 2023 Diagnostician : Don Baldridge

: 01 Nov 2023

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

1 MASTER DR FRANKLIN, MA US 02038

Contact: Service Manager

newviewgranite1@gmail.com

T:

F: