OIL ANALYSIS REPORT

Sample Rating Trend

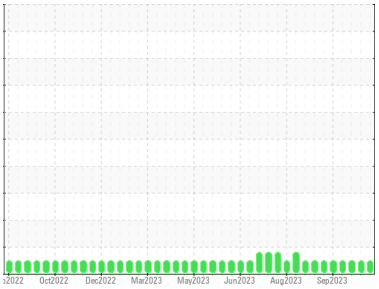

NORMAL

Machine Id
CAPTIS ENERGY ENG 2 (S/N 1251397)
Component
Natural Gas Engine
Fluid
MAHLER Q8 Mahler G8 SAE 40 (--- GAL)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is no indication of any contamination in the oil.

Fluid Condition
The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0835529**	WC0835525	WC0835532
Sample Date		Client Info		**30 Oct 2023**	23 Oct 2023	16 Oct 2023
Machine Age	hrs	Client Info		**21641**	21473	21306
Oil Age	hrs	Client Info		**1034**	866	699
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**NORMAL**	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**0**	<1	<1
Chromium	ppm	ASTM D5185m	>4	**0**	0	<1
Nickel	ppm	ASTM D5185m	>2	**0**	0	<1
Titanium	ppm	ASTM D5185m		**<1**	0	<1
Silver	ppm	ASTM D5185m	>3	**0**	0	0
Aluminum	ppm	ASTM D5185m	>9	**2**	2	2
Lead	ppm	ASTM D5185m	>30	**0**	<1	<1
Copper	ppm	ASTM D5185m	>35	**0**	0	<1
Tin	ppm	ASTM D5185m	>4	**<1**	0	0
Vanadium	ppm	ASTM D5185m		**<1**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	<1

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**0**	<1	<1
Barium	ppm	ASTM D5185m		**0**	0	10
Molybdenum	ppm	ASTM D5185m		**1**	<1	1
Manganese	ppm	ASTM D5185m		**0**	<1	0
Magnesium	ppm	ASTM D5185m		**9**	9	9
Calcium	ppm	ASTM D5185m		**1942**	2091	2188
Phosphorus	ppm	ASTM D5185m		**357**	425	494
Zinc	ppm	ASTM D5185m		**442**	565	548
Sulfur	ppm	ASTM D5185m		**2047**	2346	2848

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+100	**6**	3	4
Sodium	ppm	ASTM D5185m		**2**	1	0
Potassium	ppm	ASTM D5185m	>20	**2**	0	2

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		**0.5**	0	0
Nitration	Abs/cm	*ASTM D7624	>20	**6.7**	7.5	7.5
Sulfation	Abs/.1mm	*ASTM D7415	>30	**17.1**	15.7	15.4

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	**9.6**	11.3	11.1
Acid Number (AN)	mg KOH/g	ASTM D8045		**0.34**	0.42	1.126
Base Number (BN)	mg KOH/g	ASTM D2896	8.0	**6.29**	7.52	7.41

OIL ANALYSIS REPORT

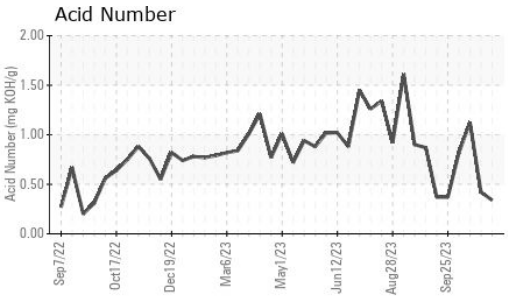

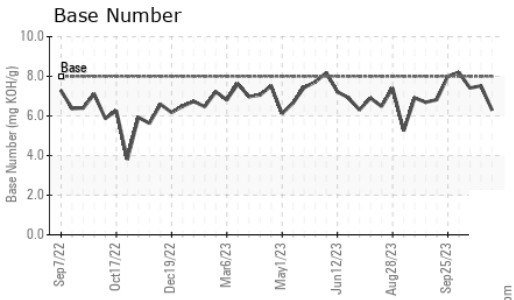

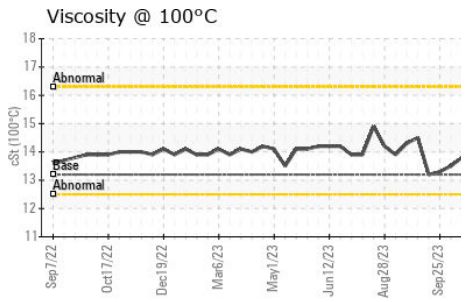

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.2	**13.8**	13.8	13.8

GRAPHS

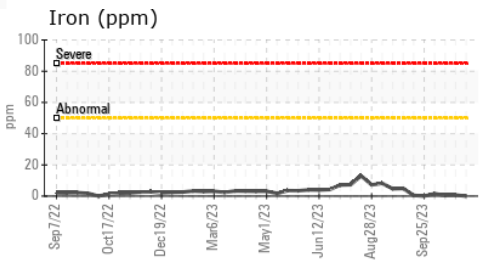

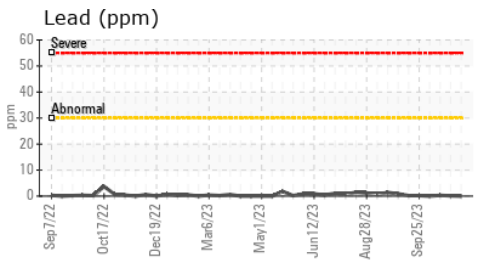

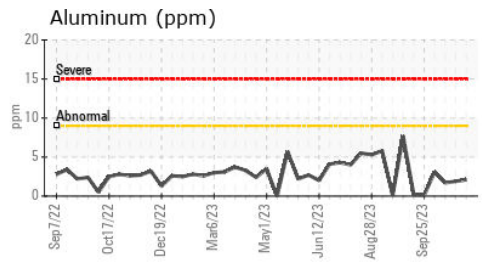

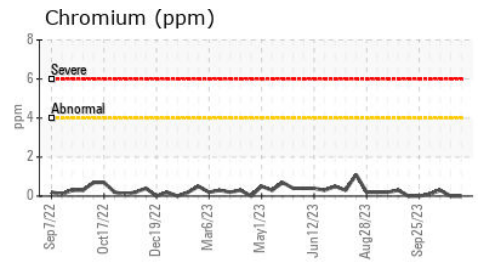

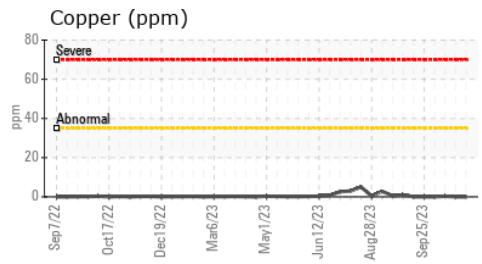

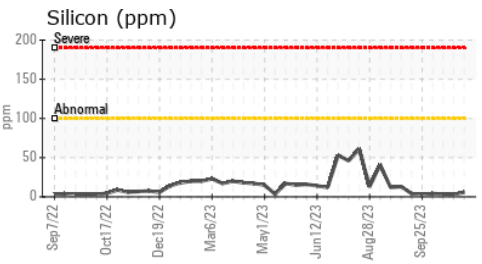

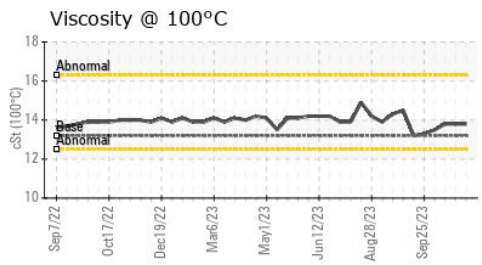

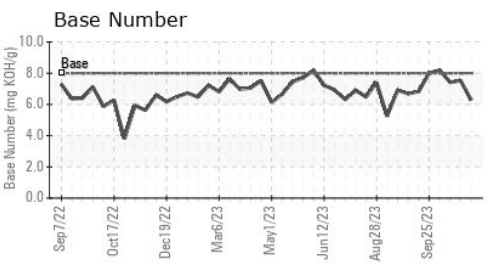

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0835529
Lab Number : 05996360
Unique Number : 10724720
Test Package : MOB 2

Received : 01 Nov 2023
Diagnosed : 03 Nov 2023
Diagnostician : Wes Davis

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

CUBE DISTRICT ENERGY
1000 WINDWARD CONCOURSE SUITE 150
ALPHARETTA, GA
US 30005
Contact: RYAN INGALLS
ryan.ingalls@cubedistrictenergy.com
T: (217)433-4972
F: