




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

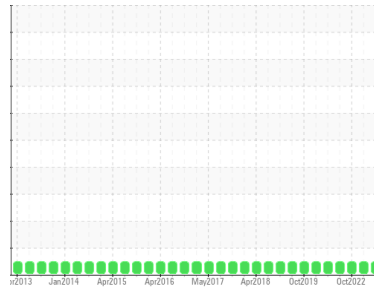

Area  
**E8**  
 Machine Id  
**CUMMINS E8-CF-G-70008**  
 Component  
**Diesel Engine**  
 Fluid  
**DIESEL ENGINE OIL SAE 15W40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0771994</b>	WC0670637	WC0686723
Sample Date	Client Info			<b>27 Oct 2023</b>	30 Apr 2023	29 Oct 2022
Machine Age	hrs	Client Info		<b>3713</b>	3713	0
Oil Age	hrs	Client Info		<b>132</b>	127	0
Oil Changed	Client Info			<b>N/A</b>	Not Changd	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>3.0		<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.2		<b>NEG</b>	NEG	NEG
Glycol	WC Method			<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>90	<b>&lt;1</b>	2	2
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m	>2	<b>89</b>	89	89
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>20	<b>&lt;1</b>	1	<1
Lead	ppm	ASTM D5185m	>40	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>330	<b>0</b>	<1	<1
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	2
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	250	<b>175</b>	152	148
Barium	ppm	ASTM D5185m	10	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	100	<b>0</b>	<1	<1
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m	450	<b>650</b>	702	665
Calcium	ppm	ASTM D5185m	3000	<b>1299</b>	1368	1376
Phosphorus	ppm	ASTM D5185m	1150	<b>971</b>	1045	996
Zinc	ppm	ASTM D5185m	1350	<b>1152</b>	1245	1212
Sulfur	ppm	ASTM D5185m	4250	<b>3478</b>	4710	4187



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>4</b>	4	5
Sodium	ppm	ASTM D5185m	>158	<b>2</b>	3	2
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	4	4

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	>6	<b>0.1</b>	0	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>6.4</b>	6.1	7.0
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>18.0</b>	16.6	19.5

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>12.8</b>	12.5	13.9
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	<b>9.76</b>	9.99	9.27







# OIL ANALYSIS REPORT

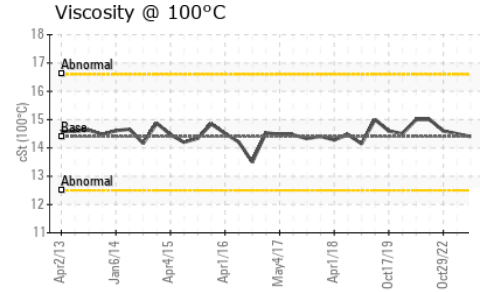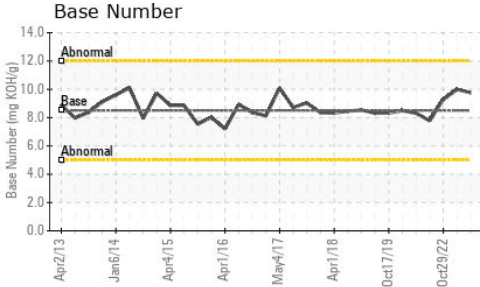

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	14.5	14.6

## GRAPHS

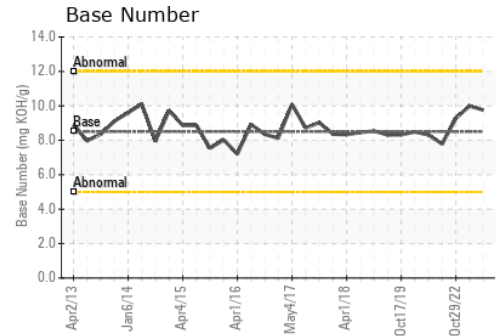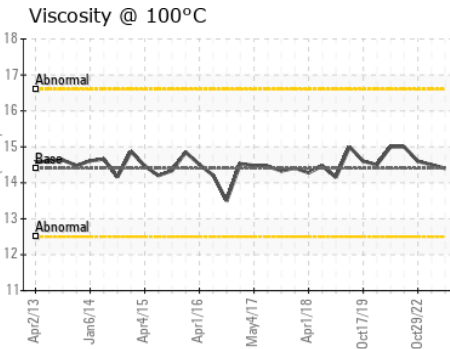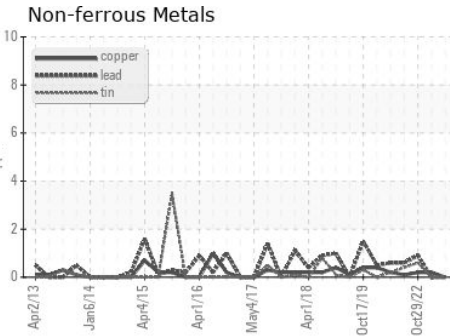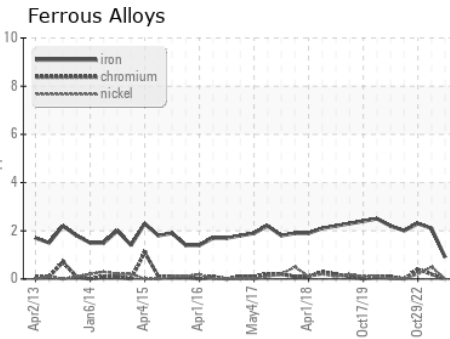

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : WC0771994  
 Lab Number : 05996395  
 Unique Number : 10724755  
 Test Package : IND 2 ( Additional Tests: PrtCount )

Received : 01 Nov 2023  
 Tested : 03 Nov 2023  
 Diagnosed : 03 Nov 2023 - Sean Felton

**Conoco Phillips ALASKA INC**  
 C/O LAF (ALPINE), 6441 S AIRPARK PL  
 ANCHORAGE, AK  
 US 99502  
 Contact: GREG MARKLE HEATH CABANSKI  
 alp1279@conocophillips.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (907)670-4143  
 F: (907)670-4143