




# OIL ANALYSIS REPORT

Sample Rating Trend

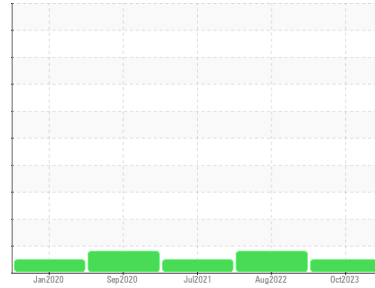

**NORMAL**



Area  
**MT**  
Machine Id  
**TEST CELL A1**  
Component  
**Hydraulic System**  
Fluid  
**MOBIL DTE 25 (30 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0810906</b>	WC0611434	WC0502683
Sample Date	Client Info		<b>31 Oct 2023</b>	11 Aug 2022	01 Jul 2021
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>Not Changed</b>	Not Changd	Not Changed
Sample Status			<b>NORMAL</b>	ABNORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >40	<b>0</b>	<1	2
Chromium	ppm	ASTM D5185m >4	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m >20	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >4	<b>&lt;1</b>	<1	0
Lead	ppm	ASTM D5185m >10	<b>0</b>	1	<1
Copper	ppm	ASTM D5185m >60	<b>&lt;1</b>	1	<1
Tin	ppm	ASTM D5185m >4	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	<1	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	<1
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	2	<1
Calcium	ppm	ASTM D5185m	<b>64</b>	73	152
Phosphorus	ppm	ASTM D5185m	<b>321</b>	358	505
Zinc	ppm	ASTM D5185m	<b>527</b>	536	726
Sulfur	ppm	ASTM D5185m	<b>1804</b>	4583	5815

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >20	<b>0</b>	<1	0
Sodium	ppm	ASTM D5185m	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>1</b>	7	0

## FLUID CLEANLINESS





	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>640	<b>159</b>	▲ 2382	533
Particles >6µm	ASTM D7647	>160	<b>60</b>	157	61
Particles >14µm	ASTM D7647	>20	<b>10</b>	9	5
Particles >21µm	ASTM D7647	>4	<b>4</b>	2	2
Particles >38µm	ASTM D7647	>3	<b>0</b>	1	0
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>16/14/11	<b>14/13/10</b>	▲ 18/14/10	16/13/10

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.38</b>	0.66	1.090




# OIL ANALYSIS REPORT

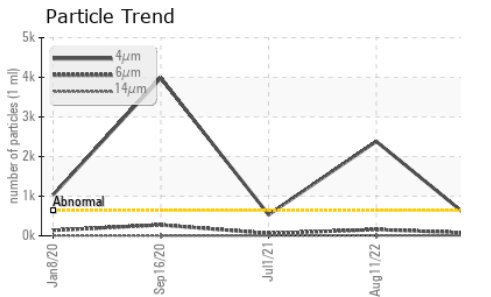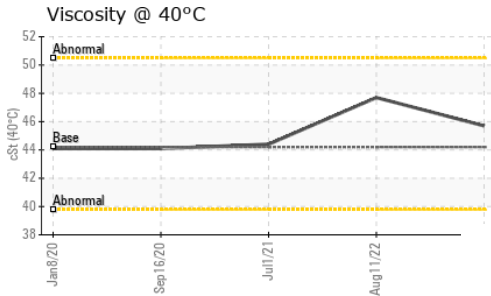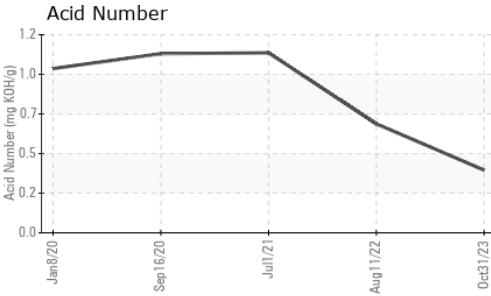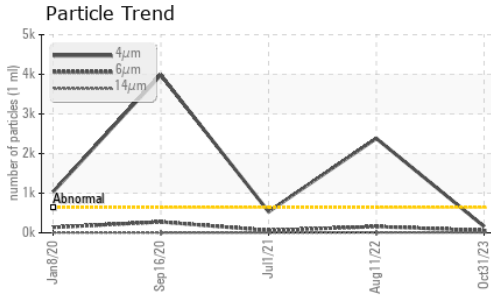






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	44.2	45.7	47.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

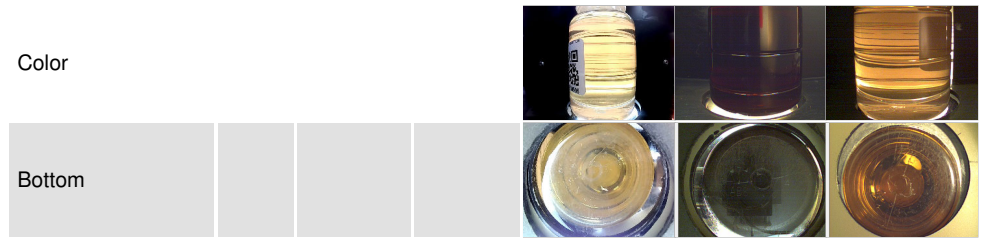

## GRAPHS

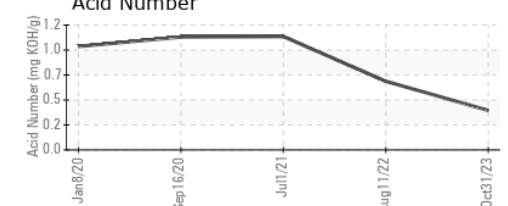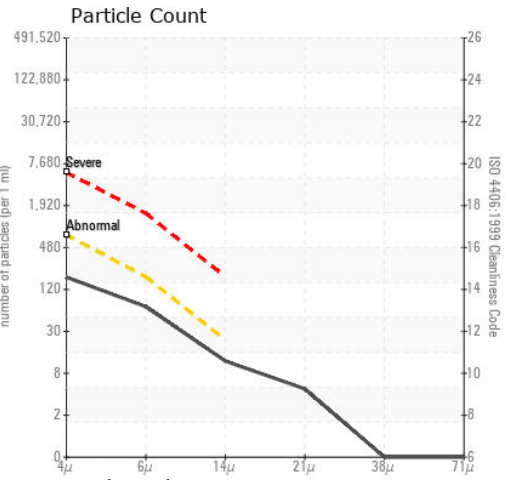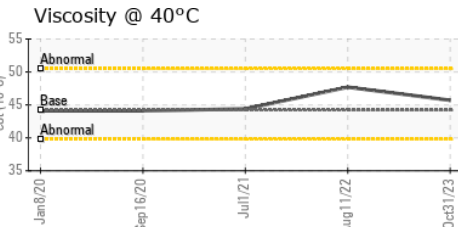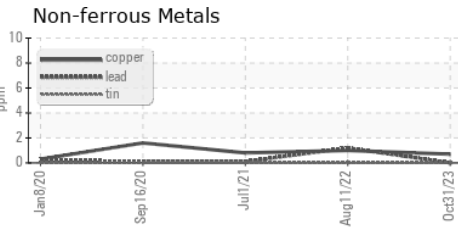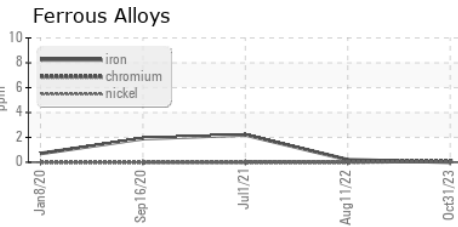

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0810906 **Received** : 02 Nov 2023  
**Lab Number** : 05996644 **Diagnosed** : 03 Nov 2023  
**Unique Number** : 10725004 **Diagnostician** : Wes Davis  
**Test Package** : IND 2

**Michelin Americas Research Company**  
 515 Michelin Road  
 Greenville, SC  
 US 29605  
 Contact: Vince Wilson  
 vince.wilson@michelin.com  
 T: (864)422-3913  
 F: (864)422-3518

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)