KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Sample Rating Trend

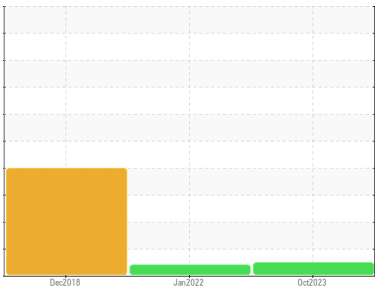

NORMAL

Machine Id
KAESER SM10T 3759907 (S/N 1324)
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**KC05996676**	KC100120	KC75021
Sample Date		Client Info		**09 Oct 2023**	31 Jan 2022	06 Dec 2018
Machine Age	hrs	Client Info		**57820**	49904	36661
Oil Age	hrs	Client Info		**0**	8300	2600
Oil Changed		Client Info		**N/A**	Changed	Not Changd
Sample Status				**NORMAL**	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**0**	<1	0
Chromium	ppm	ASTM D5185m	>10	**<1**	0	0
Nickel	ppm	ASTM D5185m	>3	**0**	<1	0
Titanium	ppm	ASTM D5185m	>3	**0**	0	0
Silver	ppm	ASTM D5185m	>2	**0**	<1	0
Aluminum	ppm	ASTM D5185m	>10	**<1**	<1	0
Lead	ppm	ASTM D5185m	>10	**0**	0	0
Copper	ppm	ASTM D5185m	>50	**2**	11	5
Tin	ppm	ASTM D5185m	>10	**0**	0	0
Antimony	ppm	ASTM D5185m		**---**	2	0
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**0**	0	0
Barium	ppm	ASTM D5185m	90	**1**	6	0
Molybdenum	ppm	ASTM D5185m		**0**	0	0
Manganese	ppm	ASTM D5185m		**0**	<1	0
Magnesium	ppm	ASTM D5185m	90	**33**	34	43
Calcium	ppm	ASTM D5185m	2	**1**	<1	17
Phosphorus	ppm	ASTM D5185m		**0**	10	0
Zinc	ppm	ASTM D5185m		**2**	20	11

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**<1**	4	<1
Sodium	ppm	ASTM D5185m		**7**	23	16
Potassium	ppm	ASTM D5185m	>20	**3**	3	0
Water	%	ASTM D6304	>0.05	**0.016**	0.015	▲ 0.125
ppm Water	ppm	ASTM D6304	>500	**163.6**	153.3	▲ 1250

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		**1229**	---	2718
Particles >6µm		ASTM D7647	>1300	**561**	---	▲ 1480
Particles >14µm		ASTM D7647	>80	**79**	---	▲ 252
Particles >21µm		ASTM D7647	>20	**28**	---	▲ 85
Particles >38µm		ASTM D7647	>4	**2**	---	▲ 13
Particles >71µm		ASTM D7647	>3	**1**	---	1
Oil Cleanliness		ISO 4406 (c)	>--/17/13	**17/16/13**	---	▲ 18/15

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	**0.22**	0.24	0.287

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

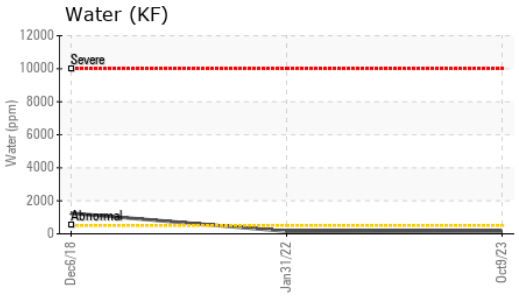

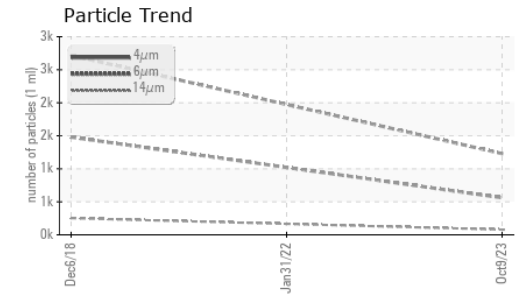

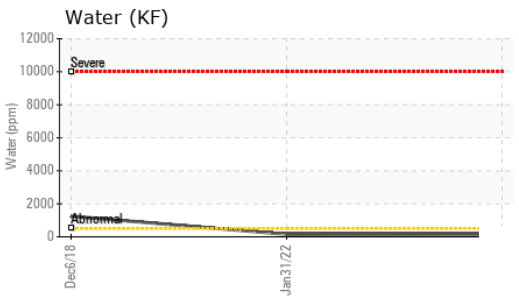

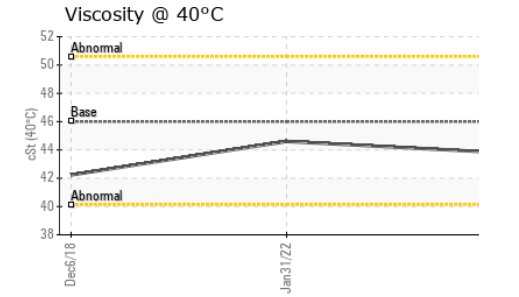

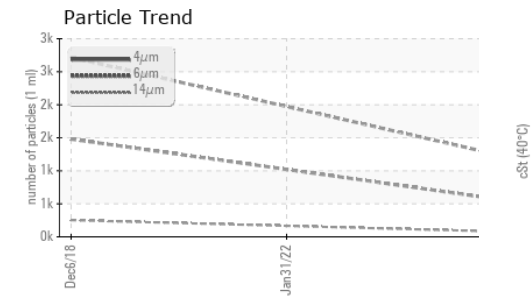

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**LIGHT**	▲ MODER	LIGHT
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	▲ HAZY
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	**NEG**	NEG	▲ 0.2%
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	**43.8**	44.6	42.23

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color			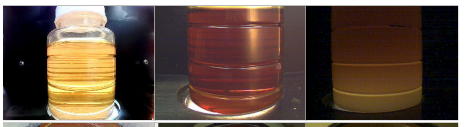		
Bottom			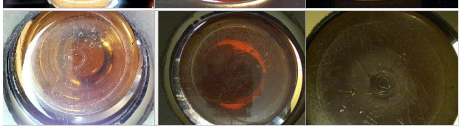		

GRAPHS

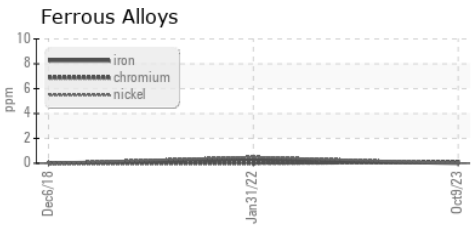

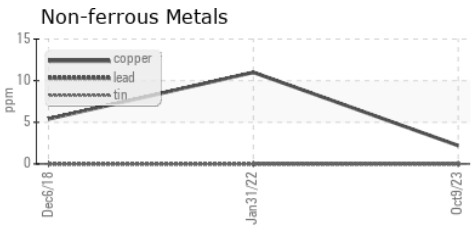

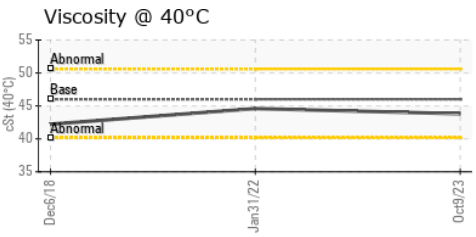

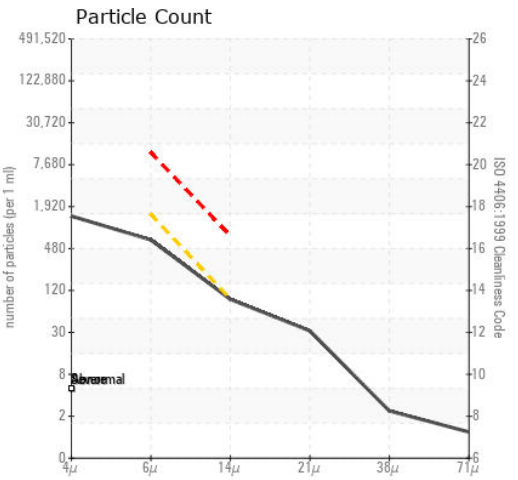

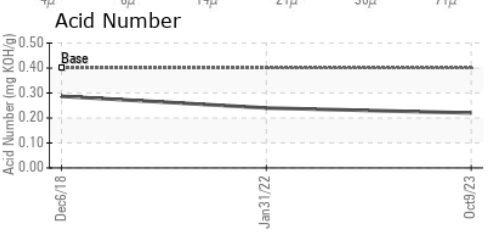

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC05996676
Lab Number : 05996676
Unique Number : 10725036
Test Package : IND 2

Received : 02 Nov 2023
Diagnosed : 04 Nov 2023
Diagnostician : Don Baldridge

Certificate L2367

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

MELE PRINTING
619 N TYLER ST
COVINGTON, LA
US 70433
Contact: Service Manager

T:
F: