


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

KAESER SM10T 3759907 (S/N 1324)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Dec201	8 Jan 2022	Oct2023 0	rt2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC05996682	KC05996676	KC100120
Sample Date		Client Info		09 Oct 2023	09 Oct 2023	31 Jan 2022
Machine Age	hrs	Client Info		57820	57820	49904
Oil Age	hrs	Client Info		0	0	8300
Oil Changed		Client Info		N/A	N/A	Changed
Sample Status				NORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	<1	<1	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	<1	<1	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	7	2	11
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m				2
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	6	1	6
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	90	55	33	34
Calcium	ppm	ASTM D5185m	2	2	1	<1
Phosphorus	ppm	ASTM D5185m		0	0	10
Zinc	ppm	ASTM D5185m		8	2	20
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	<1	4
Sodium	ppm	ASTM D5185m		15	7	23
Potassium	ppm	ASTM D5185m	>20	5	3	3
Water	%	ASTM D6304	>0.05	0.024	0.016	0.015
ppm Water	ppm	ASTM D6304	>500	241.3	163.6	153.3
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1868	1229	
Particles >6µm		ASTM D7647	>1300	542	561	
Particles >14μm		ASTM D7647	>80	51	79	
Particles >21µm		ASTM D7647	>20	14	28	
Particles >38μm		ASTM D7647	>4	1	2	
Particles >71µm		ASTM D7647	>3	0	1	
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/13	17/16/13	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.26	0.22	0.24



OIL ANALYSIS REPORT

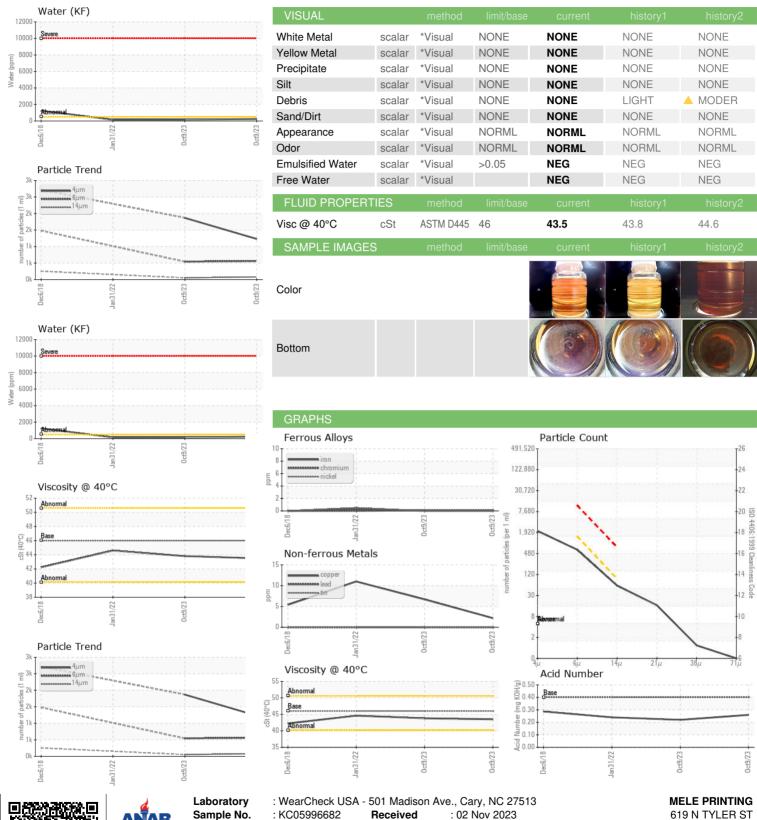



Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

: 05996682 : 10725042 : IND 2

: 02 Nov 2023 Received Diagnosed : 03 Nov 2023

: Don Baldridge Diagnostician

US 70433

Contact: Service Manager

COVINGTON, LA

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: