



# PROBLEM SUMMARY

Sample Rating Trend



ISO



Machine Id  
**T-3 SOUTH VAC MILL (SOUTH PLANT)**

Component


**Auger**

Fluid

**JAX MAGNA-PLATE 220 FG (--- GAL)**

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

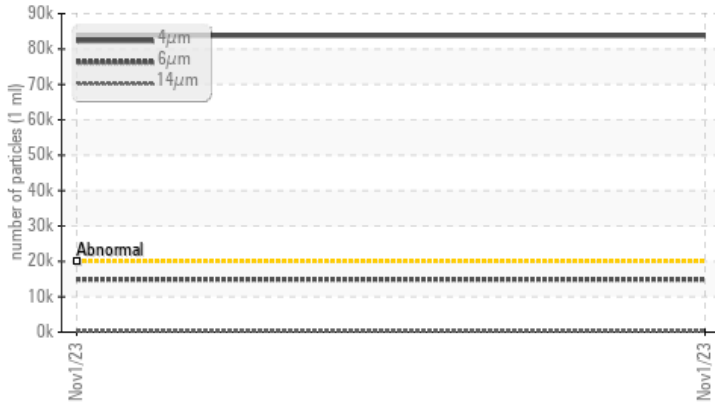

## RECOMMENDATION

Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			<b>ABNORMAL</b>	---	---
Particles >4µm	ASTM D7647	>20000	▲ <b>83777</b>	---	---
Particles >6µm	ASTM D7647	>5000	▲ <b>14896</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ <b>24/21/15</b>	---	---

Customer Id: TYSSAI  
Sample No.: USP0003051  
Lab Number: 05996714  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Doug Bogart +1 (800)237-1369 x4016  
[dougb@wearcheckusa.com](mailto:dougb@wearcheckusa.com)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS



# OIL ANALYSIS REPORT

Sample Rating Trend



ISO

Machine Id  
**T-3 SOUTH VAC MILL (SOUTH PLANT)**

Component

**Auger**

Fluid

**JAX MAGNA-PLATE 220 FG (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USP0003051</b>	---	---
Sample Date	Client Info	<b>01 Nov 2023</b>	---	---
Machine Age	hrs Client Info	<b>0</b>	---	---
Oil Age	hrs Client Info	<b>0</b>	---	---
Oil Changed	Client Info	<b>N/A</b>	---	---
Sample Status		<b>ABNORMAL</b>	---	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>150	<b>13</b>	---	---
Chromium ppm ASTM D5185m	>10	<b>&lt;1</b>	---	---
Nickel ppm ASTM D5185m	>10	<b>0</b>	---	---
Titanium ppm ASTM D5185m		<b>0</b>	---	---
Silver ppm ASTM D5185m		<b>0</b>	---	---
Aluminum ppm ASTM D5185m	>25	<b>&lt;1</b>	---	---
Lead ppm ASTM D5185m	>100	<b>0</b>	---	---
Copper ppm ASTM D5185m	>50	<b>&lt;1</b>	---	---
Tin ppm ASTM D5185m	>10	<b>0</b>	---	---
Vanadium ppm ASTM D5185m		<b>0</b>	---	---
Cadmium ppm ASTM D5185m		<b>0</b>	---	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		<b>0</b>	---	---
Barium ppm ASTM D5185m		<b>&lt;1</b>	---	---
Molybdenum ppm ASTM D5185m		<b>0</b>	---	---
Manganese ppm ASTM D5185m		<b>0</b>	---	---
Magnesium ppm ASTM D5185m		<b>&lt;1</b>	---	---
Calcium ppm ASTM D5185m		<b>1</b>	---	---
Phosphorus ppm ASTM D5185m		<b>376</b>	---	---
Zinc ppm ASTM D5185m		<b>2</b>	---	---
Sulfur ppm ASTM D5185m		<b>408</b>	---	---

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>50	<b>9</b>	---	---
Sodium ppm ASTM D5185m		<b>0</b>	---	---
Potassium ppm ASTM D5185m	>20	<b>2</b>	---	---
Water % ASTM D6304	>0.1	<b>0.004</b>	---	---
ppm Water ppm ASTM D6304	>1000	<b>43.6</b>	---	---






## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm ASTM D7647	>20000	<b>▲ 83777</b>	---	---
Particles >6µm ASTM D7647	>5000	<b>▲ 14896</b>	---	---
Particles >14µm ASTM D7647	>640	<b>311</b>	---	---
Particles >21µm ASTM D7647	>160	<b>54</b>	---	---
Particles >38µm ASTM D7647	>40	<b>1</b>	---	---
Particles >71µm ASTM D7647	>10	<b>0</b>	---	---
Oil Cleanliness ISO 4406 (c)	>21/19/16	<b>▲ 24/21/15</b>	---	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045		<b>0.66</b>	---	---

# OIL ANALYSIS REPORT

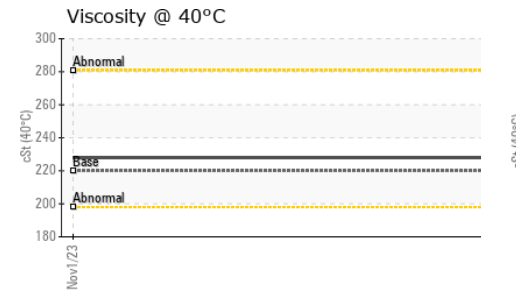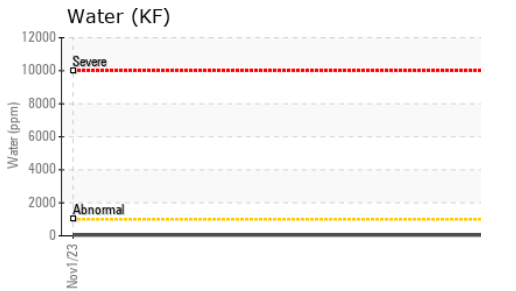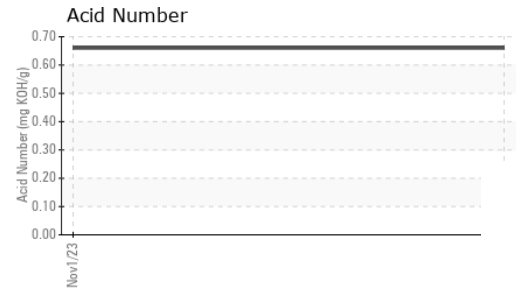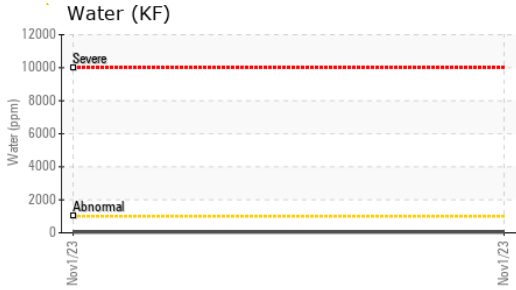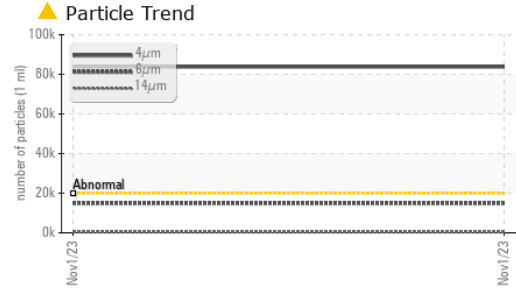





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	220	228	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

### GRAPHS

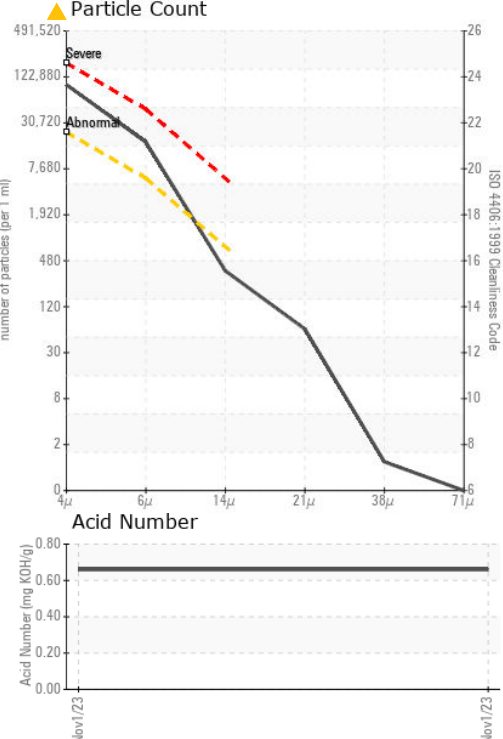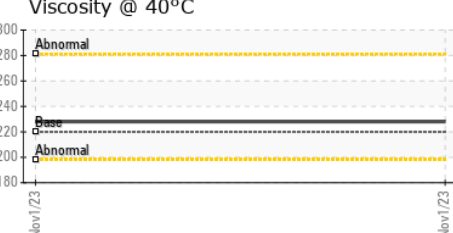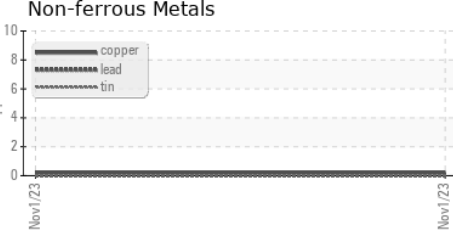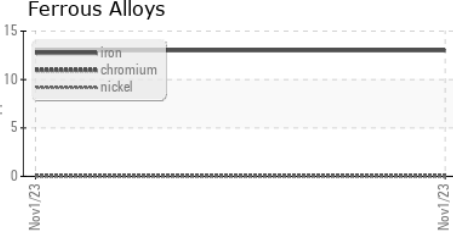

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0003051     **Received** : 02 Nov 2023  
**Lab Number** : 05996714     **Diagnosed** : 06 Nov 2023  
**Unique Number** : 10725074     **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**TYSON HILLSHIRE - SAINT JOSEPH**  
 5807 MITCHELL AVE  
 SAINT JOSEPH, MO  
 US 64507  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)