




# PROBLEM SUMMARY

Sample Rating Trend

WEAR




Machine Id  
**RC-1 (S/N 0046)**  
Component  
**Refrigeration Compressor**  
Fluid  
**FRICK COMPRESSOR OIL #11 (--- GAL)**

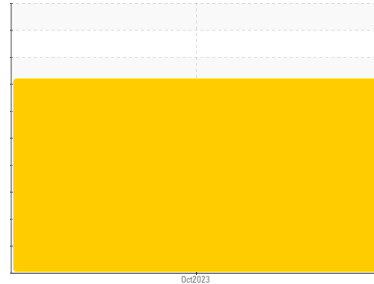


## COMPONENT CONDITION SUMMARY

### Ferrous Alloys

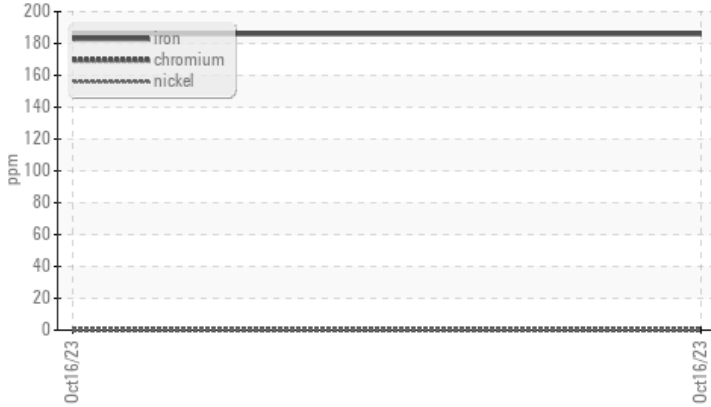

### Particle Trend

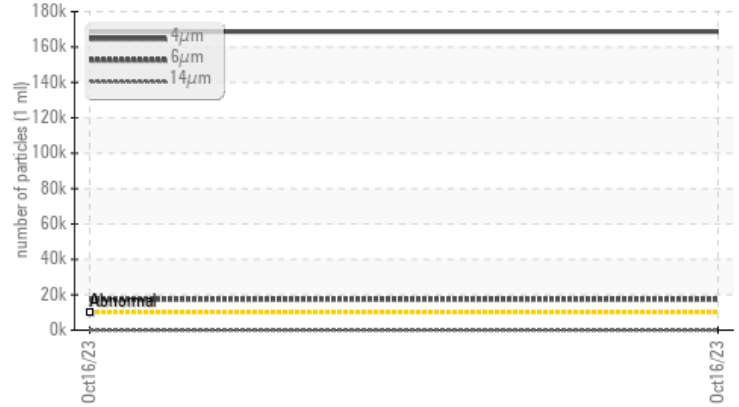

## RECOMMENDATION

No corrective action is recommended at this time. We recommend you service the filters on this component if applicable. We recommend an early resample to monitor this condition.

## PROBLEMATIC TEST RESULTS

Sample Status				SEVERE	---	---
Iron	ppm	ASTM D5185m	>8	186	---	---
Particles >4µm		ASTM D7647	>10000	168671	---	---
Particles >6µm		ASTM D7647	>2500	17440	---	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	25/21/12	---	---

Customer Id: TYSKEYGAD  
Sample No.: USP0003003  
Lab Number: 05996769  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Doug Bogart +1 (800)237-1369 x4016  
[dougb@wearcheckusa.com](mailto:dougb@wearcheckusa.com)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component if applicable.
Resample	---	---	?	We recommend an early resample to monitor this condition.

## HISTORICAL DIAGNOSIS



# OIL ANALYSIS REPORT

Sample Rating Trend

WEAR



Machine Id  
**RC-1 (S/N 0046)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**FRICK COMPRESSOR OIL #11 (--- GAL)**



## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. We recommend you service the filters on this component if applicable. We recommend an early resample to monitor this condition.

### Wear

The iron level is severe.

### Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP0003003</b>	---	---
Sample Date	Client Info		<b>16 Oct 2023</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>SEVERE</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>186</b>	---	---
Chromium	ppm	ASTM D5185m >2	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >3	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m >2	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >8	<b>3</b>	---	---
Tin	ppm	ASTM D5185m >4	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	<b>1</b>	---	---
Magnesium	ppm	ASTM D5185m	<b>0</b>	---	---
Calcium	ppm	ASTM D5185m	<b>4</b>	---	---
Phosphorus	ppm	ASTM D5185m	<b>0</b>	---	---
Zinc	ppm	ASTM D5185m	<b>20</b>	---	---
Sulfur	ppm	ASTM D5185m	<b>0</b>	---	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>2</b>	---	---
Sodium	ppm	ASTM D5185m	<b>0</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>1</b>	---	---
Water	%	ASTM D6304 >0.01	<b>0.002</b>	---	---
ppm Water	ppm	ASTM D6304 >100	<b>24.6</b>	---	---

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>168671</b>	---	---
Particles >6µm	ASTM D7647	>2500	<b>17440</b>	---	---
Particles >14µm	ASTM D7647	>320	<b>39</b>	---	---
Particles >21µm	ASTM D7647	>80	<b>5</b>	---	---
Particles >38µm	ASTM D7647	>20	<b>0</b>	---	---
Particles >71µm	ASTM D7647	>4	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>25/21/12</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	<b>0.085</b>	---	---



# OIL ANALYSIS REPORT

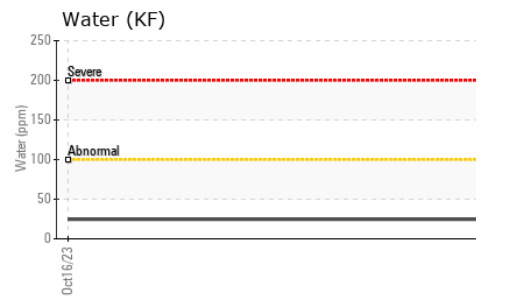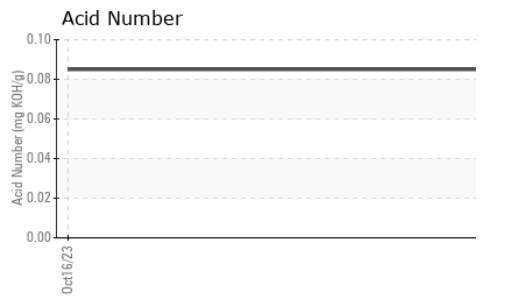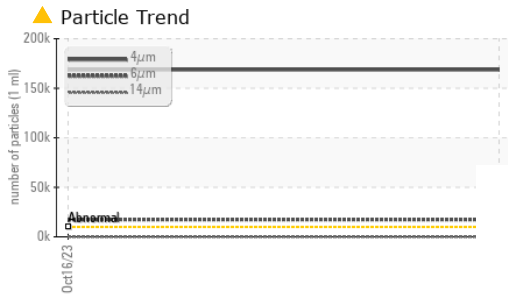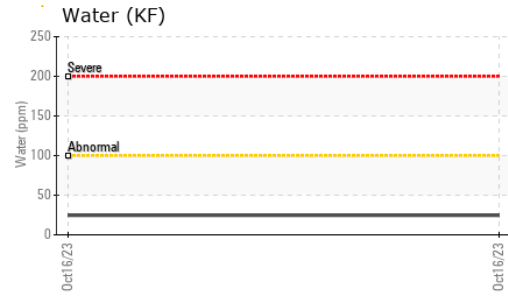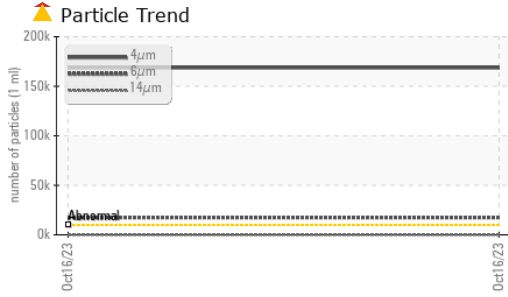





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	44.0	50.3	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

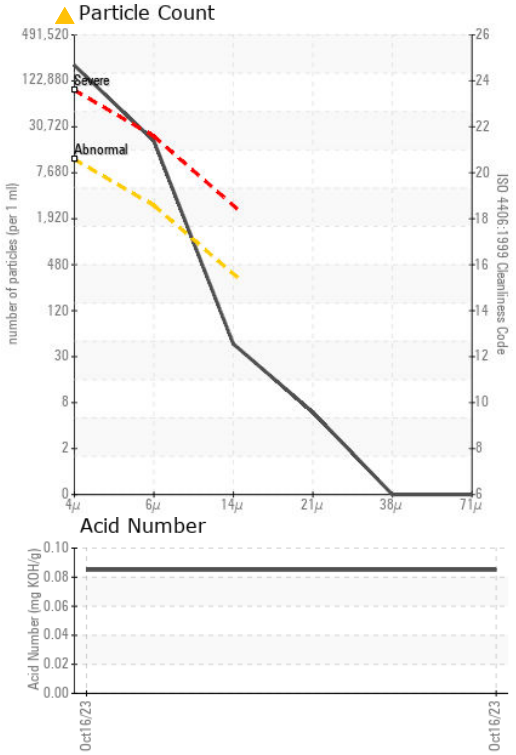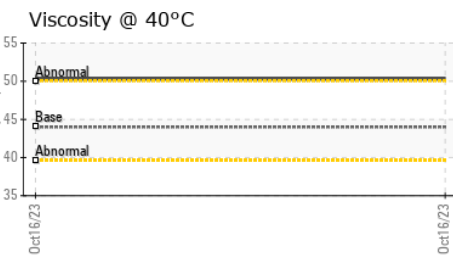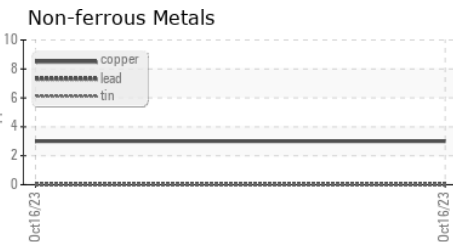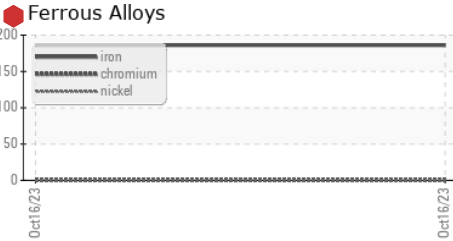

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0003003 **Received** : 02 Nov 2023  
**Lab Number** : 05996769 **Diagnosed** : 06 Nov 2023  
**Unique Number** : 10725129 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**TYSON KEYSTONE - GADSDEN**  
 2281 STEELE STATION RD  
 RAINBOW CITY, AL  
 US 35906  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: