



PROBLEM SUMMARY

Sample Rating Trend

WATER




Machine Id
RC-5 (S/N 0575)
Component
Refrigeration Compressor
Fluid
FRICK (--- GAL)



COMPONENT CONDITION SUMMARY

▲ Particle Trend

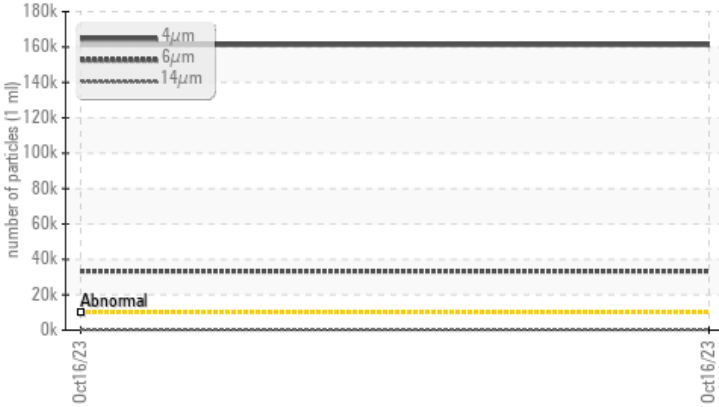

RECOMMENDATION

We advise that you follow the water drain-off procedure for this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	---	---
Particles >4µm	ASTM D7647	>10000	▲ 161325	---	---	---
Particles >6µm	ASTM D7647	>2500	▲ 33308	---	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 25/22/15	---	---	---
Free Water	scalar	*Visual	▲ 1.0	---	---	---

Customer Id: TYSKEYGAD
Sample No.: USP0003002
Lab Number: 05996770
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Water Drain-off	---	---	?	We advise that you follow the water drain-off procedure for this component.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend



WATER



Machine Id
RC-5 (S/N 0575)
 Component
Refrigeration Compressor
 Fluid
FRICK (--- GAL)

DIAGNOSIS

▲ Recommendation

We advise that you follow the water drain-off procedure for this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil. There is a trace of moisture present in the oil. Free water present.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		USP0003002	---	---
Sample Date	Client Info		16 Oct 2023	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			ABNORMAL	---	---

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	2	---	---
Chromium	ppm	ASTM D5185m >2	<1	---	---
Nickel	ppm	ASTM D5185m	0	---	---
Titanium	ppm	ASTM D5185m	0	---	---
Silver	ppm	ASTM D5185m >2	0	---	---
Aluminum	ppm	ASTM D5185m >3	<1	---	---
Lead	ppm	ASTM D5185m >2	0	---	---
Copper	ppm	ASTM D5185m >8	<1	---	---
Tin	ppm	ASTM D5185m >4	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	---	---
Barium	ppm	ASTM D5185m	0	---	---
Molybdenum	ppm	ASTM D5185m	0	---	---
Manganese	ppm	ASTM D5185m	0	---	---
Magnesium	ppm	ASTM D5185m	0	---	---
Calcium	ppm	ASTM D5185m	0	---	---
Phosphorus	ppm	ASTM D5185m	0	---	---
Zinc	ppm	ASTM D5185m	2	---	---
Sulfur	ppm	ASTM D5185m	0	---	---






CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	1	---	---
Sodium	ppm	ASTM D5185m	0	---	---
Potassium	ppm	ASTM D5185m >20	1	---	---
Water	%	ASTM D6304 >0.01	0.015	---	---
ppm Water	ppm	ASTM D6304 >100	150	---	---

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 161325	---	---
Particles >6µm	ASTM D7647	>2500	▲ 33308	---	---
Particles >14µm	ASTM D7647	>320	301	---	---
Particles >21µm	ASTM D7647	>80	31	---	---
Particles >38µm	ASTM D7647	>20	1	---	---
Particles >71µm	ASTM D7647	>4	0	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 25/22/15	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.015	---	---



OIL ANALYSIS REPORT

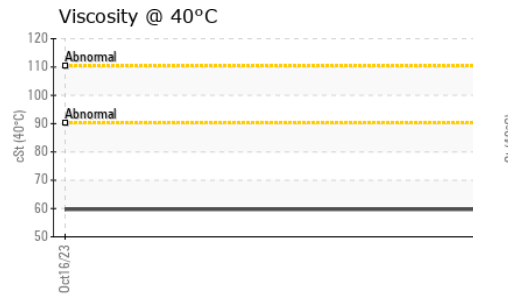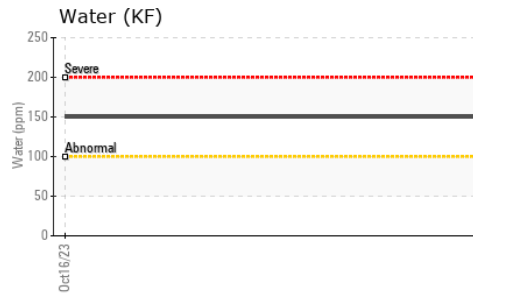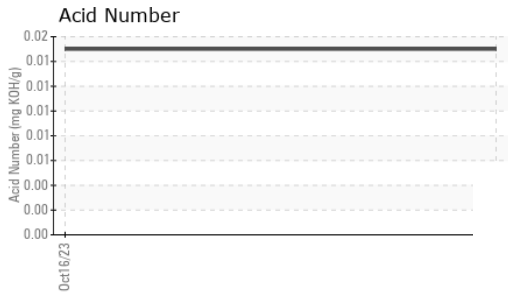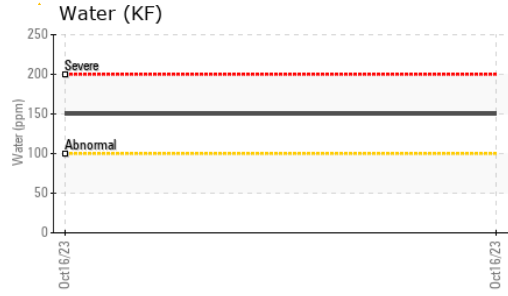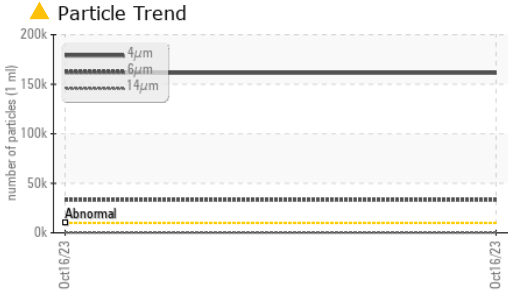






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	0.2%	---
Free Water	scalar	*Visual		▲ 1.0	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	59.7	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

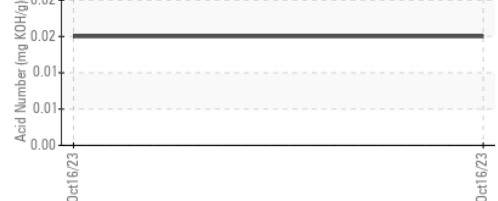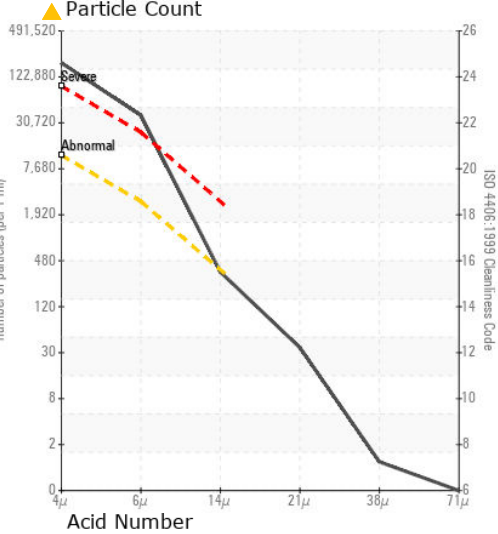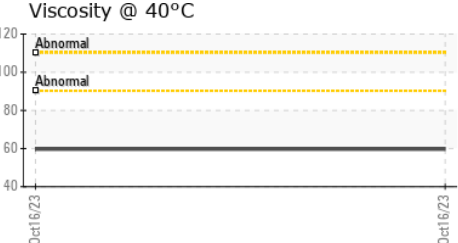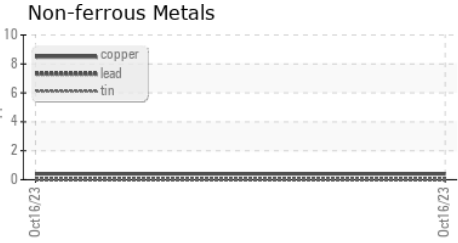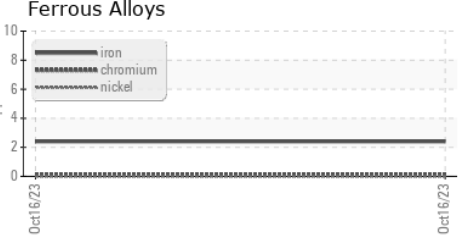

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USP0003002 **Received** : 02 Nov 2023
Lab Number : 05996770 **Diagnosed** : 06 Nov 2023
Unique Number : 10725130 **Diagnostician** : Doug Bogart
Test Package : IND 2

TYSON KEYSTONE - GADSDEN
 2281 STEELE STATION RD
 RAINBOW CITY, AL
 US 35906
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)