

# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Machine Id  
**ELLIOTT C-202**  
Component  
**Rotary Compressor**  
Fluid  
**CHEVRON GST OIL ISO 32 (--- GAL)**

**DIAGNOSIS**

**Recommendation**  
Resample at the next service interval to monitor.

**Wear**  
All component wear rates are normal.

**Contamination**  
The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

**Fluid Condition**  
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

**SAMPLE INFORMATION** method limit/base current history1 history2

Sample Number	Client Info	<b>TO90003097</b>	---	---
Sample Date	Client Info	<b>24 Oct 2023</b>	---	---
Machine Age	hrs Client Info	<b>0</b>	---	---
Oil Age	hrs Client Info	<b>0</b>	---	---
Oil Changed	Client Info	<b>N/A</b>	---	---
Sample Status		<b>NORMAL</b>	---	---

**WEAR METALS** method limit/base current history1 history2

Iron	ppm	ASTM D5185m	>70	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m		<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>0</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>3	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m	>4	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m	>3	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---

**ADDITIVES** method limit/base current history1 history2

Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>0</b>	---	---
Calcium	ppm	ASTM D5185m		<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>0</b>	---	---
Zinc	ppm	ASTM D5185m		<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>0</b>	---	---

**CONTAMINANTS** method limit/base current history1 history2

Silicon	ppm	ASTM D5185m	>45	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m		<b>0</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	---	---
Water	%	ASTM D6304	>0.6	<b>0.002</b>	---	---
ppm Water	ppm	ASTM D6304		<b>21.6</b>	---	---






**FLUID CLEANLINESS** method limit/base current history1 history2

Particles >4µm	ASTM D7647	>10000	<b>665</b>	---	---
Particles >6µm	ASTM D7647	>2500	<b>142</b>	---	---
Particles >14µm	ASTM D7647	>320	<b>11</b>	---	---
Particles >21µm	ASTM D7647	>80	<b>4</b>	---	---
Particles >38µm	ASTM D7647	>20	<b>0</b>	---	---
Particles >71µm	ASTM D7647	>4	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>17/14/11</b>	---	---

**FLUID DEGRADATION** method limit/base current history1 history2

Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.041</b>	---	---
------------------	----------	------------	--	--------------	-----	-----

# OIL ANALYSIS REPORT

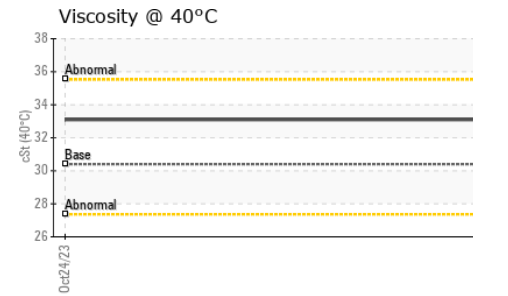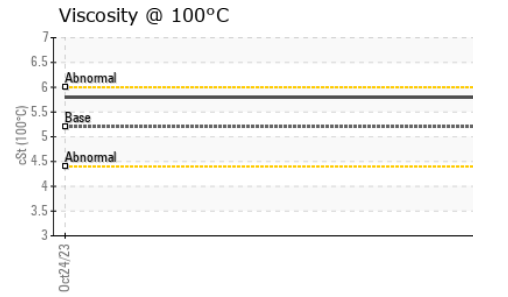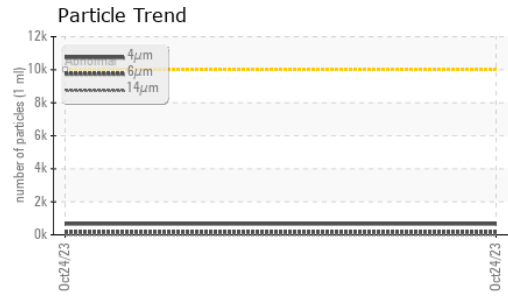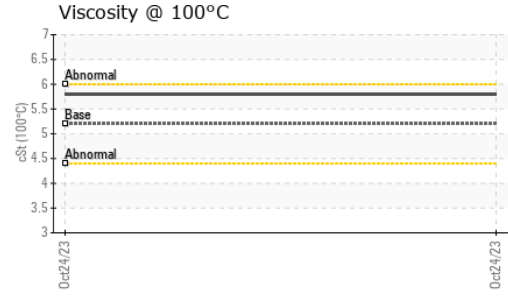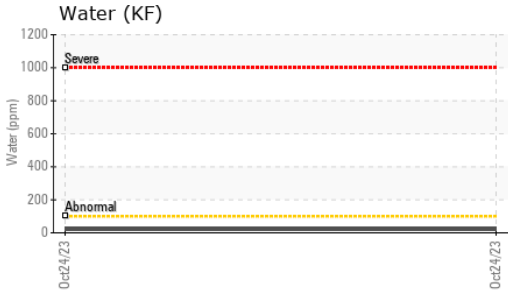





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.6	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	30.4	33.1	---
Visc @ 100°C	cSt	ASTM D445	5.2	5.8	---
Viscosity Index (VI)	Scale	ASTM D2270	102	117	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

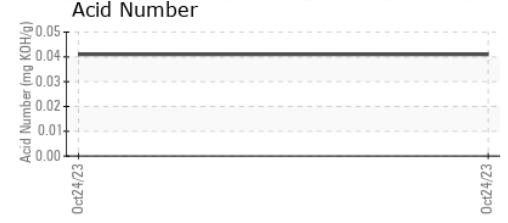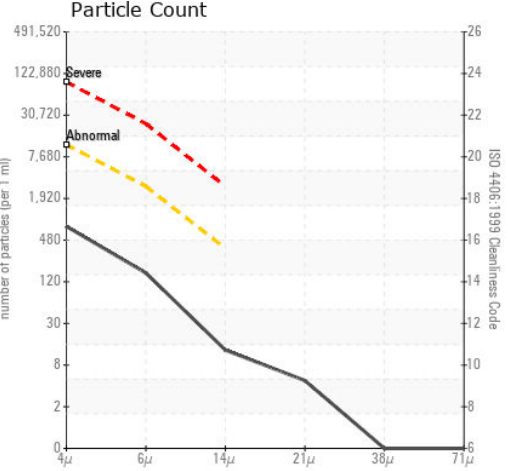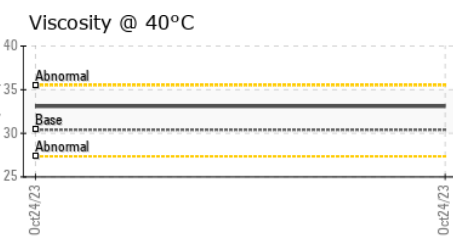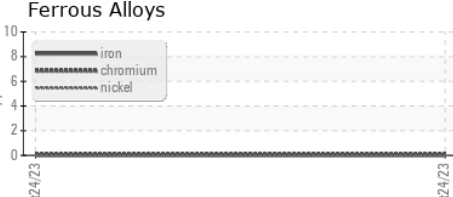

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : TO90003097 **Received** : 02 Nov 2023  
**Lab Number** : 05996790 **Diagnosed** : 04 Nov 2023  
**Unique Number** : 10725150 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, KV100, PrtCount, VI )

**ENERGY TRANSFER - NEDERLAND**  
 2300 N TWIN CITY HWY  
 NEDERLAND, TX  
 US 77627  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: