




PROBLEM SUMMARY

Sample Rating Trend


WEAR

Area
NOT GIVEN [1390737]
Machine Id
ATLAS COPCO AIF118259 - NISCO
Component
Compressor

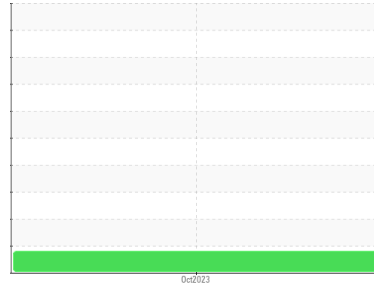

COMPONENT CONDITION SUMMARY

▲ Aluminum (ppm)

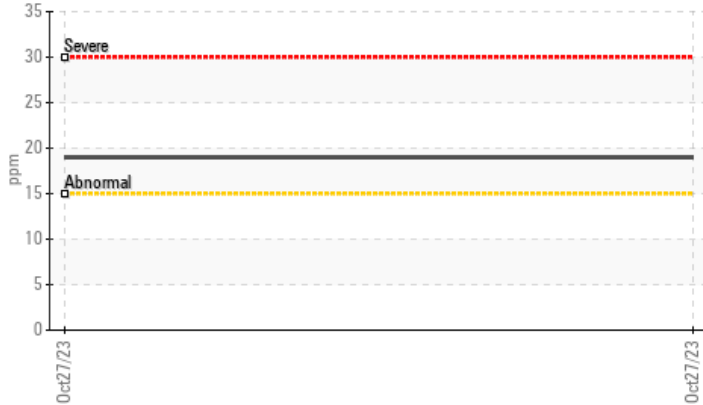

RECOMMENDATION

No corrective action is recommended at this time.
Resample at the next service interval to monitor.
Please specify the brand, type, and viscosity of the oil on your next sample.

PROBLEMATIC TEST RESULTS

Sample Status				ATTENTION	---	---
Aluminum	ppm	ASTM D5185m	>15	▲ 19	---	---

Customer Id: UCDIRMID
Sample No.: UCH05996809
Lab Number: 05996809
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Information Required	---	---	?	Please specify the brand, type, and viscosity of the oil on your next sample.

HISTORICAL DIAGNOSIS




OIL ANALYSIS REPORT

Sample Rating Trend

WEAR

Area
NOT GIVEN [1390737]
 Machine Id
ATLAS COPCO AIF118259 - NISCO
 Component
Compressor

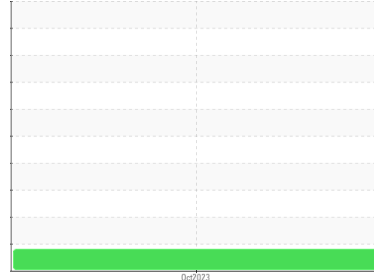

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

▲ Wear

The aluminum level is abnormal. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			UCH05996809	---	---
Sample Date	Client Info			27 Oct 2023	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Oil Changed	Client Info			N/A	---	---
Sample Status				ATTENTION	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	43	---	---
Chromium	ppm	ASTM D5185m	>5	<1	---	---
Nickel	ppm	ASTM D5185m		0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>15	▲ 19	---	---
Lead	ppm	ASTM D5185m	>65	0	---	---
Copper	ppm	ASTM D5185m	>65	8	---	---
Tin	ppm	ASTM D5185m	>10	<1	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
Cadmium	ppm	ASTM D5185m		0	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		2	---	---
Barium	ppm	ASTM D5185m		39	---	---
Molybdenum	ppm	ASTM D5185m		0	---	---
Manganese	ppm	ASTM D5185m		0	---	---
Magnesium	ppm	ASTM D5185m		<1	---	---
Calcium	ppm	ASTM D5185m		7	---	---
Phosphorus	ppm	ASTM D5185m		34	---	---
Zinc	ppm	ASTM D5185m		44	---	---
Sulfur	ppm	ASTM D5185m		538	---	---




CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	9	---	---
Sodium	ppm	ASTM D5185m		7	---	---
Potassium	ppm	ASTM D5185m	>20	16	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.45	---	---



VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---








OIL ANALYSIS REPORT

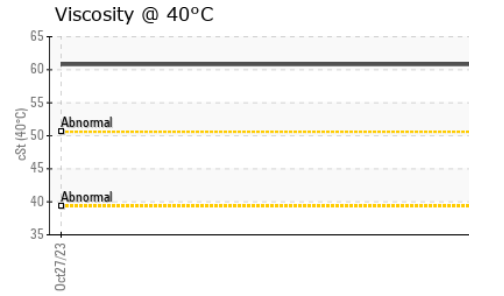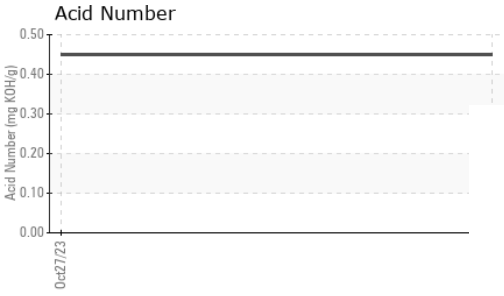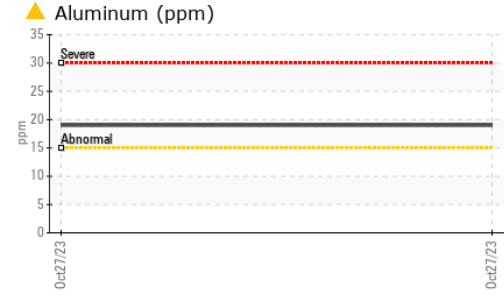

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	60.8	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

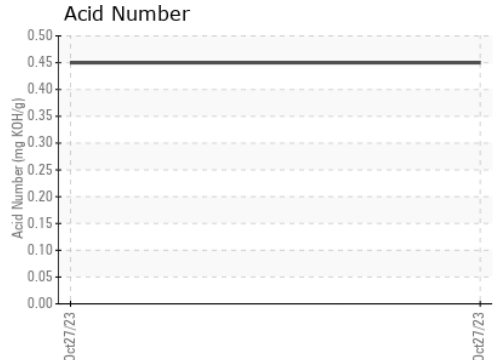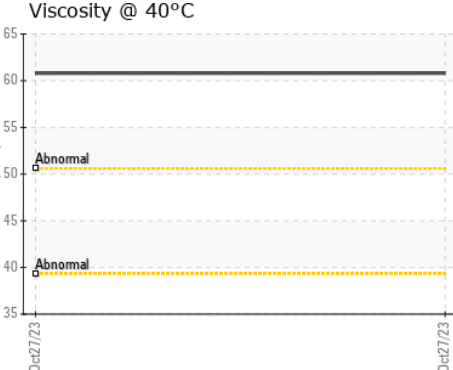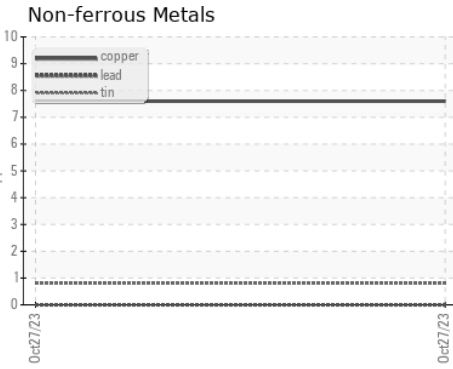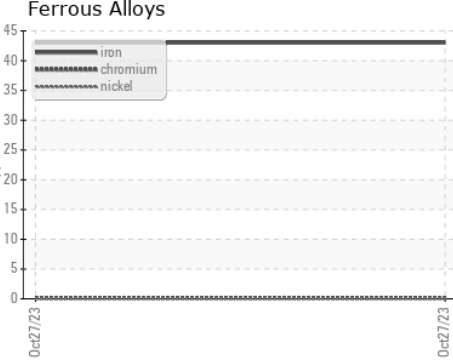

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCH05996809 **Received** : 02 Nov 2023
Lab Number : **05996809** **Diagnosed** : 04 Nov 2023
Unique Number : 10725169 **Diagnostician** : Don Baldrige
Test Package : IND 2

DIRECT AIR - AIR TECHNOLOGIES
 400 WRIGHT AVE
 MIDDLETOWN, OH
 US 45044
 Contact: DAVID DUNCAN
 david.duncan@aircompressors.com
 T: (502)254-2520
 F: (513)539-6040

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)