


OIL ANALYSIS REPORT

Area 115 VC

Compressor

INGERSOLL RAND CBV415043





Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Det2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
	VIATION		IIIIII/Dase			
Sample Number		Client Info		UCH05996812		
Sample Date		Client Info		23 Oct 2023		
Machine Age	hrs	Client Info		49651		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>15	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVEO	• • • • • • • • • • • • • • • • • • • •		12 25 /1		12.4	111
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		13		
Zinc	ppm	ASTM D5185m		118		
Sulfur	ppm	ASTM D5185m		62		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	12		
Sodium	ppm	ASTM D5185m		9		
Potassium	ppm	ASTM D5185m	>20	<1		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.49		
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	LIGHT		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.1	NEG		
Free Water	scalar	*Visual	20.1	NEG		



OIL ANALYSIS REPORT

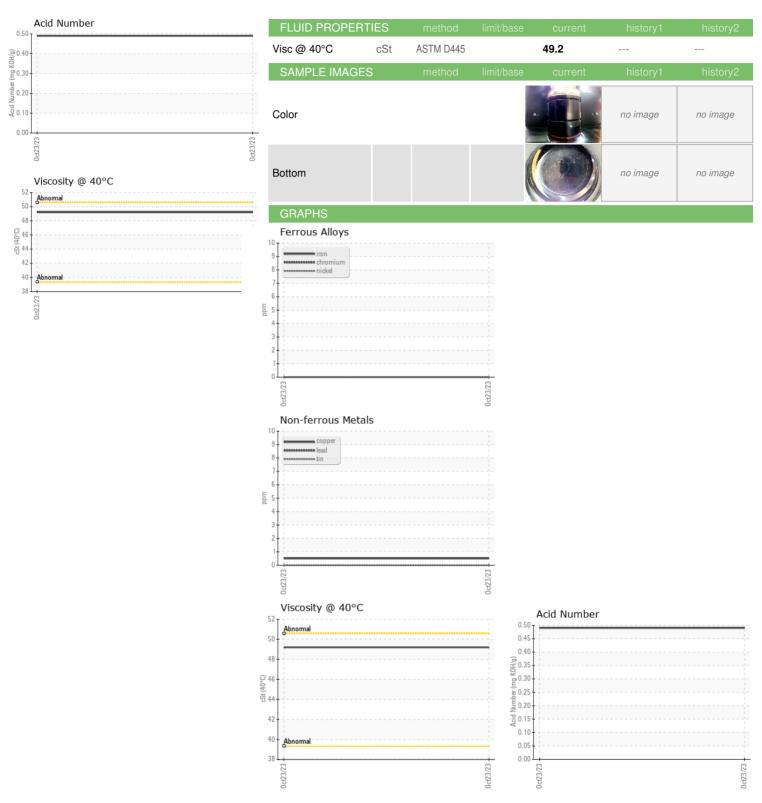





Report Id: UCADVTOM [WUSCAR] 05996812 (Generated: 11/04/2023 11:32:10) Rev: 1

Laboratory Sample No. Lab Number Unique Number : 10725172

: UCH05996812 : 05996812 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 02 Nov 2023 Diagnosed Diagnostician : Don Baldridge

: 04 Nov 2023

ADVANCED COMPRESSED AIR SOLUTIONS (ACAS) 9421 FM 2920 RD BLDG 23

TOMBALL, TX US 77375

Contact: JIM SUAREZ jim@advancedcompressedair.com

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: